
TECHNICAL CATALOG

Ekip UP

The low voltage digital unit
for next generation of plants



Ekip UP

Consultation guide



Chapter 1

Main characteristics

Overview of the Ekip UP family, distinctive features of the series, product conformity and service.



Chapter 6

Dimensional drawings

Overall dimensions for Ekip UP family and description of mounting.



Chapter 2

The ranges

Latest generation of Ekip UP series for a new all-in-one concept.



Chapter 7

Wiring diagrams

Wiring diagrams of the family and of the accessories.



Chapter 3

Software functions

New generation of functionalities ready for every type of system and simple to use.



Chapter 8

Ordering codes

Ordering codes with configuration examples.



Chapter 4

Commissioning and Connectivity

Supervision, Energy Management and complete integration in the systems with the possibility of communicating with several protocols and with internet.



Chapter 5

Accessories

Accessories for Ekip UP family (signaling, control, connectivity, measurements, protection, etc).



Table of contents

MAIN
CHARACTERISTICS

01

THE RANGES

02

SOFTWARE
FUNCTIONS

03

COMMISSIONING
AND CONNECTIVITY

04

ACCESSORIES

05

DIMENSIONS

06

WIRING DIAGRAMS

07

ORDERING CODES

08

Main characteristics

- 1/2** **Designed for the latest market trends**
- 1/4** **Leveraging our digital innovation**
- 1/6** **One unit, more markets**
- 1/8** **Product overview**

Designed for the latest market trends

New electrical grid architectures and system device connectivity are changing the energy flows.

Power distribution is continuously evolving from the traditional grid architecture to the new system design. The centralized grid with top-down energy flow has been changing towards the distributed multi-source configuration.

Power grids combines more and more the presence of big size powerhouses, spread-out high voltage transmission lines and bulk load centres together with a constellation of distributed areas of local production and consumption at the distribution layer. Sections of the electrical network have bidirectional energy flows thanks to low voltage generation resources installed in buildings, factories and communities.

In particular, the growing of renewables is promoted by technology cost and environmental pollution emissions reductions in comparison with fuel fossil sources.

The **Microgrid** concept is the answer to this market trend. Distributed energy resources and loads mainly in low voltage network defined by specific boundaries that can work together in a controlled and coordinated way, either connected to weak/strong main grid or in "islanded" mode depending on the scenario. Speeding up the innovation, microgrids simplify the higher power distribution complexity ensuring lower cost, optimizing the resources and the services.

Today more than 1.5GW of low-voltage Microgrids are installed worldwide and these will increase to more than 6GW by 2020.



In order to get as much as possible the energy efficiency and self-consumption, in parallel of the new electrical layouts, communication networks and **Internet of Things** (IoT) technology unlocks the power of data to make people understand energy consumption and allocate resources. Indeed, connectivity has become in the last ten years a must to have in energy distribution.

Up to 33 billion internet-connected devices will be used by 2020, that means 4.3 devices for every person on the planet. This trend regards not only the consumer but also the business world.

The digital transformation is coming to power. What cannot be missed are, of course, the switching devices, like the circuit breakers or the switch disconnectors located at the different Microgrid electrical points, so that they naturally become the leaders for the grid speed evolution.

In the last ten years, more than 50M of Air Circuit Breakers and 300M of Molded Case Circuit Breakers have been installed worldwide from all the different brands, without advanced features for monitoring or resources optimization.

As almost more than 95% are conventional devices, there is a big potential for technology upgrade on existing facilities, avoiding big impact on investment as in the case of device replacement. In addition, around 15% of switching devices are not equipped with any electronics on board.



Leveraging our digital innovation

Ekip UP is the low-voltage digital unit able to monitor, protect and control the next generation of plants.

Thanks to the built-in software-based function, part of ABB Ability™ portfolio of connected and software enabled solutions, Ekip UP digitizes the plant performance. Sharing the electronics capabilities of “all-in-one” ABB platform, Ekip UP enables the integration of advanced functionalities into the switchgear.

The traditional approaches of industrialists towards the installed base is quite conservative. The cultural inertia for the innovation and the barrier of retrofitting cost make them not change the power distribution philosophy, losing all the chances offered by new solutions. In case of switchgear with traditional breakers, still suitable for the mechanical performances but old for the electronics capabilities, trusting the end user to replace the whole device is more than complex. On the other side, there are many projects that need customization and engineering efforts, which are not usually addressed to the solutions embedded in switching devices but, generally, are related to external devices. Ekip UP edge units are fitted for all the market opportunities.

As multifunctional unit, Ekip UP monitors, protects and controls the power distribution and automation applications. Thanks to its plug&play design, it guarantees ease of use, modularity and flexibility.

• Metering

- Measurement capability of main energy parameters.
- Network analyzer to evaluate the power quality.
- Datalogger based on event triggers for fast fault diagnosis.
- Connectivity for system integration up to 8 field-bus protocols, plus a property bus for power automation applications that require advanced cyber-security.
- Embedded gateway that ensures power understanding by cloud-based energy management system.

• Protection

- Distribution protection (mains and feeders) based on current and voltage measurement.
- Generator protection and interface protection systems.
- Adaptive threshold according to grid topology.
- Digital selectivity for resource coordination.
- Load shedding algorithms to prevent blackouts.
- Programmable logics to manage transfer-switching operations and maximize service continuity.
- Synchrocheck function of different power sources inside.

• Control

- Power management systems to optimize plant resources and enable Demand Response applications.

The evolution of ABB external units sets a new standard for the multi-functional relays' market, leveraging the value of digital innovations.



—

Ekip UP makes every switchgear smart adding value for everyone.



UP-date basic switchgear

Ekip UP updates basic switchboards with new monitoring, protection and power control solutions.

- Compatible with all switching devices, ABB or not.
- 100% applicable for every low-voltage scenario.



UP-load your electrical system

Ekip UP uploads your system data to the cloud-connected ABB Ability platform.

- Enabling full microgrid control.
- In less than 10 minutes without any external gateway.



UP-grade your facilities

Ekip UP is the unit that upgrades the electronics of old facilities making them digital.

- 40% operational cost saving via the energy management system and predictive maintenance.
- Cost-effective solution compared with traditional retrofitting approach.



Maximize UP-time

Ekip UP maximizes uptime for system integration as a plug & play unit. with easy installation

- 50% time saving when retrofitting, with reduced impact on switchboard design.
- Almost zero downtime during commissioning.

For example of integration of Ekip UP with switches and fusegear, please refer to the brochure "ABB Ability in action" - 1SCC011013C0201.



One unit, more markets

—

Ekip UP is ready to meet any requirement and cover spread market opportunities worldwide.

Commercial buildings

Ekip UP monitors the energy consumption of existing hotels, shopping malls, campuses or office facilities that become immediately connected to the cloud.

Thanks to the remote energy management system and smart power management algorithm embedded in the digital unit, facility managers and end users can increase the energy efficiency of the electrical plant. Even in new infrastructures with e-mobility chargers, Ekip UP is the solution to understand current flows, enabling peak shaving and load shifting strategies.

Industrial and utility plants

Ekip UP protects plant power systems and automation processes with the direct interface to every switching devices. The unit satisfies a complete list of distribution and generation ANSI protections as well as it embeds programmable logic.

For example, sending tripping commands to switch disconnectors is a typical case for oil & gas industries. Besides, Ekip UP can also add granted backup protections to breakers so to increase reliability with complete redundancy, as in utility power stations.

Having both DIN-rail and door-mounted options in the same unit, it fits the installation requirements of OEMs and panel builders with small space requirements.





Marine

Ekip UP easily revamps the electronics of old breakers installed onboard ships, offering a cost-effective solution in respect to traditional approaches.

The unit maximizes the time for maintenance & operation technicians during the installation compared with other retrofitting solution.

The mechanical vibration performances of the unit match the marine application specifications. Besides, through adaptive protections and digital buses, the unit enables complete coordination of motors, generators and distribution bus-bars.

Microgrids

Ekip UP controls urban or remote communities, coordinating the different resources from loads to generators.

Thanks to the all-in-one software functions, Ekip UP maximizes the service continuity of critical power microgrids, like datacenters, hospitals or solar factories.

Leveraging on advanced connectivity capability, system integrators can easily introduce the digital unit in plant networks.

Package selling upload-model guarantees modularity and flexibility in every microgrid project for design institutes.



Product overview

Ekip UP is CE-marked and cULus listed. It conforms to the Standard IEC 60255 - "Measuring relays and protection equipment" and UL 508, CSA C22.2 No. 14-13 - "Standard for Industrial Control Equipment".

IEC 60255 certification makes Ekip UP suitable globally being recognized by other local regulatory organizations, while cULus compliance enables the access to North America market. Ekip UP Protect+ and Control+ versions are in compliance with grid-connection standard, in particular CEI 0-16 - "Reference technical rules for the connection of active and passive consumers to the HV and MV electrical networks of distribution company". All the Ekip UP range is approved by marine registers (RINA and DNV-GL).

Ekip UP operates in low voltage grids according to the following ranges and characteristics:

Operating voltage, U_e [V]	Up to 1150
Operating current, I_n [A]	From 100 to 6300
Operating frequency [Hz]	50 - 60
Operating temperature [°C]	From -25 to +70*
Protection degree	IP40**

* +60 according to UL

** For IP54 protection, use external cover like Rittal FT 2784.000 or equivalent

More technical and standard features are available in the dedicated manual, doc. 1SDH002003A2001.



Ekip UP unit is standard provided in the optimized bag-packaging with:

- ABB current sensors, offered in four types, and cabling kit
- insertion bridge for voltage sockets
- power supply cartridge module
- measurement module
- four I/O programmable contacts.

Ekip UP is also able to be equipped with optional:

- communication and gateway modules
- synchrocheck cartridge module
- embedded or external signalling modules
- software functions
- external differential or homopolar toroids.

If required, commercial voltage sensors can be applied into the specific sockets, clearly identified to ensure correct installation.

All the details of the accessories are described in Chapter 5 and ordering instructions are listed in Chapter 8.




The same Ekip UP unit may be DIN-rail or door-mounted according to the specific requirement. Many clips fix the unit guaranteeing stability in every installation.

Rotating capability of digital contacts and two dedicated labels ensure easy of use in both the mounting options.

Serial Number information is available in the label applied on the unit side as well as in the touch-screen display. Indeed, all the configurations are possible from the display or using the commissioning software Ekip Connect.

Additional labels help to identify the cartridge module plugged into the unit.

1. Door mounted, door open




Front view, door open

2. DIN mounted



Front view



The ranges

- 2/2 Ekip UP units**
- 2/6 Technical characteristics for measurement functions**
- 2/8 Technical characteristics for protection functions**
- 2/18 Description of protection functions**

Ekip UP units

The innovative Ekip UP digital units are the new benchmark for the measurement, protection and control for low voltage electrical systems.






The result is a single unit suitable for any demanding application without the need for other external devices.

The ABB plug&play solution improves the plant efficiency, increases awareness of resources and process behaviors, and delivers an easier, more intuitive user experience.

As multifunctional unit, there are five different commercial versions that guarantee flexibility and modularity to meet the needs of all measurement, protection and control applications.

- **Ekip UP Monitor**
- **Ekip UP Protect**
- **Ekip UP Protect +**
- **Ekip UP Control**
- **Ekip UP Control +**

All units can also be equipped with optional connectivity and signally modules, in addition to the standard accessories. The main software functions can also be uploaded into Ekip UP Protect, Protect+ and Control+. These versions are ready for external toroids that enable more earth fault protections.

					
	Ekip UP Monitor	Ekip UP Protect	Ekip UP Protect +	Ekip UP Control	Ekip UP Control +
Control				●	●
Protection		●	●		●
Metering	●	●	●	●	●

● = standard functions
● = advanced functions

METERING

Ekip UP Monitor is more than a measurement unit:

- Power quality Network Analyzer according to IEC61000-4-30 ed. 2 (up to 50th harmonics)
- Fault analysis Datalogger based on events with two independent memory buffers
- Maximum, minimum and average value registers.

Ekip UP Accuracy		
Measure	Ekip UP unit	→ with Sensors *
Current	0.50%	1.00%
Voltage	0.50%	0.70%
Power	1.00%	2.00%

* With Type C current sensors based on installation conditions mentioned in dedicated manual, doc 1SDH002003A1001 and in case of VT (voltage transformer) used cl. 0.2 or below.

Advanced communication capabilities are compatible with 8 fieldbus and Ethernet protocol + 1 property bus for easy system integration. Ekip UP has four slots for plug and play modules to

quickly and easily share up to 3000 data with supervision systems, guaranteeing modularity for each application.


Using an optional gateway module, it can be connected to the cloud-platform ABB Ability™ Electrical Distribution Control System thanks to a simple architecture able to connect most of the ABB low and medium voltage devices to the energy management web-app.

This follows the technology focus for big data in the commercial and industrial market segments. Ekip UP Monitor is the hub of the plant providing full connectivity and easy integration into any supervision system making every switchgear smart.

For more information for power quality metering, please refer to the product note for Network Analyzer - 1SDC210106D0201.



-  Commercial buildings (shopping malls, offices, hospital, stadium)
-  Multi-site facilities (police stations, campuses & universities, oil stations)
-  Industry (food & beverage, water & waste treatment, textile, manufacturing)

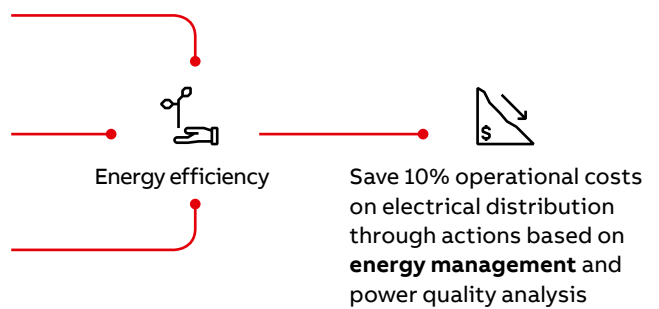

Ekip UP units

PROTECTION


Ekip UP Protect and Protect+ add the protection functions above and beyond monitoring and connectivity ones.

Ekip UP Protect enables protection based on current, voltage, frequency and power as a protective relay for power feeders. Ekip UP Protect+ adds generator protections, adaptive and overcurrent directional ones for power distribution and generation. Using Ekip Protect+ the ability to get digital selectivity with proprietary bus, plus distinguish restricted/unrestricted earth fault is guaranteed. Ekip UP Protect and Ekip UP Protect+ can be equipped with the software kits from the "all-in-one" ABB platform, like load shedding innova-

tions, synchrocheck capability, interface certified protections. Those advanced features can ensure service continuity and energy efficiency in the plants, reducing the complexity of different device installation.

Typical application of Ekip UP Protect and Ekip UP Protect+ are:

- Adding protection functionalities to switch-disconnectors, guaranteeing short-circuit breaking capacity as their short time withstand current.
 - Leveraging on more ANSI protections and other innovations for installed circuit breaker with simple trip unit, like thermal-magnetic, with the possibility to maintain current short-circuit values.
- Ekip UP is also the perfect solution when trip unit spare parts no longer available or as a backup relay.

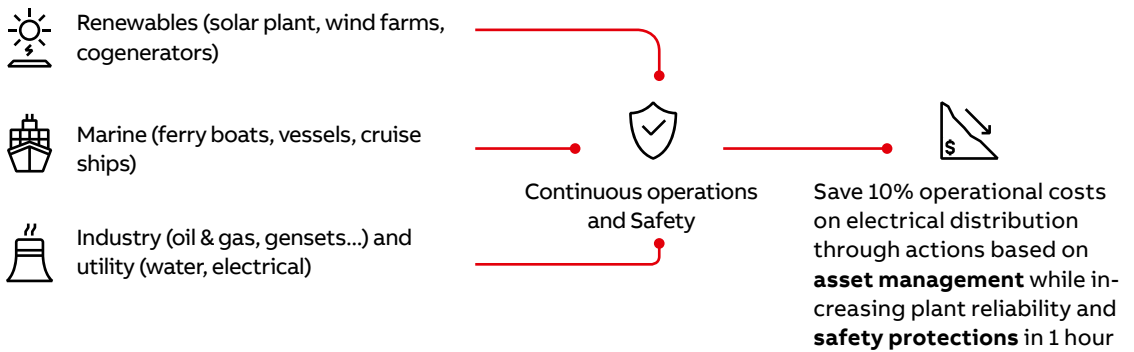

CONTROL

Ekip UP Control adds the power management algorithm. This demand management function cuts power bills and makes the plant ready for demand response programs.

Demand response application consists of remote power management: utilities or load aggregators change the power consumption or generation of the plant sites sending specific signals, according to grid service requirements, weather forecasts or pricing strategies.



Using embedded protocols, Ekip UP is able to control remotely power loads based on fixed thresholds.

Besides, Ekip UP Control enables electricity bill reduction thanks to peak shaving and load shifting strategies.

This capability is also supervised in ABB Ability™ Electrical Distribution Control System, so that it can be managed directly for the webapp everywhere directly from tablet or smartphone.

Ekip UP Control+ is the top version of the Ekip UP family. It completes the Ekip Protect+ with control features, making it really a Microgrid controller. Ekip UP Control+ is ready for "all-in-one" software functions so to achieve every target in power distribution and automation.

Ekip UP Control and Ekip UP Control+ answer the requests of energy efficiency, understanding power and acting to enhance plant productivity with optimization logics.

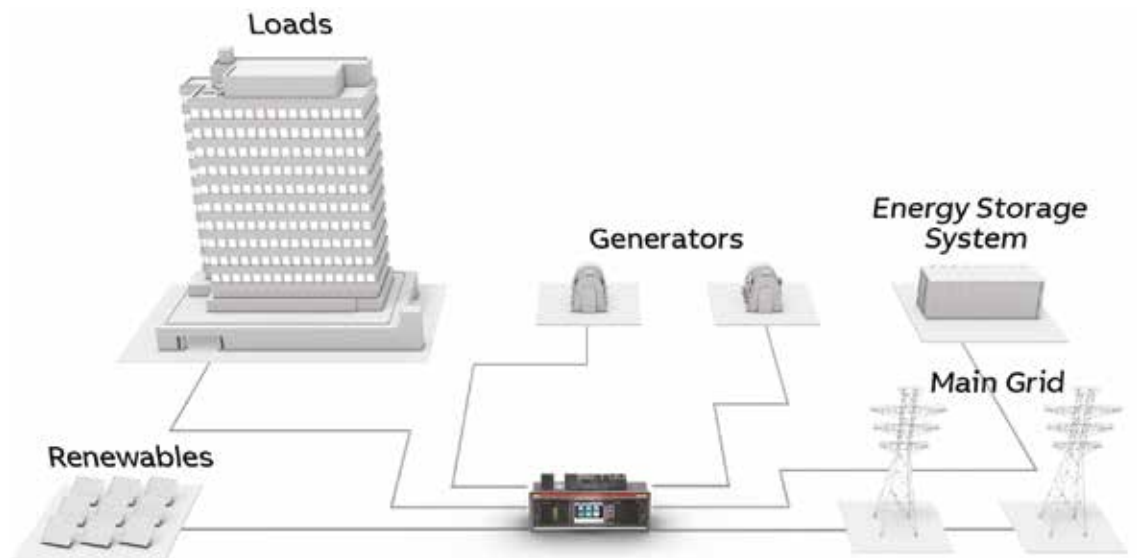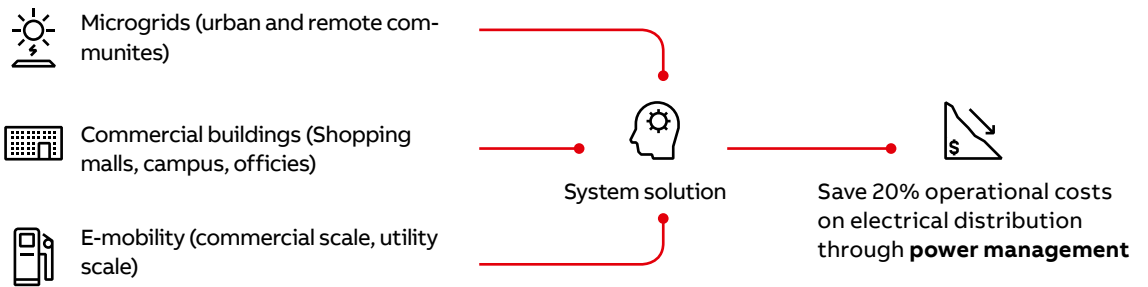

Technical characteristics for measurement functions

Instantaneous measurements	Parameters	Precision with sensors ⁽¹⁾
Currents (RMS)	[A] L1, L2, L3, Ne	1%
Earth fault current (RMS)	[A] I _g	2%
Phase-phase voltage (RMS)	[V] U ₁₂ , U ₂₃ , U ₃₁	0.7%
Phase-neutral voltage (RMS)	[V] U ₁ , U ₂ , U ₃	0.7%
Phase sequence		
Frequency	[Hz] f	0,2%
Active power	[kW] P ₁ , P ₂ , P ₃ , P _{tot}	2%
Reactive power	[kVAR] Q ₁ , Q ₂ , Q ₃ , Q _{tot}	2%
Apparent power	[KVA] S ₁ , S ₂ , S ₃ , S _{tot}	2%
Power factor	Total	2%
Peak factor	L1, L2, L3, Ne	

Counters recorded from installation or from the last reset	Parameters	Precision
Active energy	[kWh] E _p total, E _p positive, E _p negative	2%
Reactive energy	[kVARh] E _q total, E _q positive, E _q negative	2%
Apparent energy	[KVAh] E _s total	2%

Network Analyzer	Parameters	Intervals
Hourly average voltage value	[V] U _{min} = 0.75...0.95 x U _n [no] U _{max} = 1.05...1.25 x U _n Events counter (nr. of events day by day in the last year plus the total events in the breaker's lifetime)	t = 5...120min
Short voltage interruptions	[no] U _{min} = 0.75...0.95 x U _n Events counter (nr. of events day by day in the last year plus the total events in the breaker's lifetime)	t <40ms
Short voltage spikes	[no] U _{max} = 1.05...1.25 x U _n Events counter (nr. of events day by day in the last year plus the total events in the breaker's lifetime)	t <40ms
Slow voltage sags and swells	[no] U _{min1} = 0.75...0.95 x U _n U _{min2} = 0.75...0.95 x U _n U _{min3} = 0.75...0.95 x U _n U _{max1} = 1.05...1.25 x U _n U _{max2} = 1.05...1.25 x U _n Events counter (nr. of events day by day in the last year plus the total events in the breaker's lifetime)	t = 0.02s...60s
Voltage unbalance	[V] U _{neg. seq.} = 0.02...0.10 x U _n [no] Events counter (nr. of events day by day in the last year plus the total events in the breaker's lifetime)	t = 5...120min
Harmonic analysis	Current and Voltage up to 50° Alarm THD: 5...20% Single harmonic alarm: 3...10% plus a count of minutes the harmonic has been exceeded	

(1) With Type C current sensors based on installation conditions mentioned in the dedicated manual, doc 1SDH002003A1001 and in case of VT used cl. 0.2 or below.

Record of values: of the parameter for each interval with time-stamping	Parameters	Window	Intervals
Current: minimum and maximum	[A] Min, I Max	Fixed synchronizable by remote	Duration: 5...120min Number of intervals: 24
Phase-phase voltage: minimum and maximum	[V] U Min, U max		
Reactive power: average and maximum	[KVAR] Q Mean, Q Max		
Apparent power: average and maximum	[KVA] S Mean, S Max		
Data logger: record of high sampling rate parameters	Parameters		
Currents	[A] L1, L2, L3, Ne, Ig		
Voltages	[V] U12, U23, U31		
Active power: average and maximum	[kW] P Mean, P Max		
Sampling rate	[Hz] 1200-2400-4800-9600		
Maximum recording duration	[s] 16		
Recording stop delay	[s] 0-10s		
Number of registers	[no] 2 independent		
Information on trip and opening data:	Parameters		
Type of protection tripped ¹⁾	eg. L, S, I, G, UV, OV		
Fault values per phase ¹⁾	[A/V/Hz w/VAR] eg. I1, I2, I3, neutral for S protection V12, V23, V32 for UV protection		
Time-stamping	Date, time and progressive number		
Maintenance indicators	Parameters		
Information on last 30 trips ¹⁾	Type of protection, fault values and time-stamping		
Information on last 200 events	Type of event, time-stamping		
Number of mechanical operations	[no] Can be associated to alarm		
Total number of trips ¹⁾	[no]		
Total operating time	[h]		
Date of maintenance operations performed	Last		
Indication of maintenance operation needed			
Unit I.D.	Type of unit, assigned device name, serial number		
Self-diagnosis	Parameters		
Check of continuity of internal connections	Alarm due to disconnection: rating plug, sensors, trip coil	Note: Opening of switching device can be set in the event of alarm	
Failure of circuit-breaker to open (ANSI 50BF) ¹⁾	Alarm following non-tripping of protection functions		
Temperature (OT)	Prealarm and alarm for abnormal temperature		

(1) for Protect, Protect+, Control+ only

Technical characteristics for protection functions

ABB Code	ANSI Code	Function	Threshold	Threshold step	Tripping time
L	49	Overload Protection	$I1 = 0.4...1 \times I_n$	$0.001 \times I_n$	with $I = 3 I1$, $t1 = 3...144 \text{ s}$
		Thermal Memory			
	Tolerance	Trip between 1.05 and $1.2 \times I1$		$\pm 10\% I \leq 6 \times I_n$ $\pm 20\% I > 6 \times I_n$	
	49	Overload Protection	$I1 = 0.4...1 \times I_n$	$0.001 \times I_n$	with $I = 3 I1$, $t1 = 3...144 \text{ s}$ Standard inverse SI: $k=0.14 \cdot \alpha=0.02$ Very Inverse VI: $k=13.5 \alpha=1$ Extremely Inverse EI: $k=80 \alpha=2$ $t=k/I4$: $k=80 \alpha=4$
		Tolerance	Trip between 1.05 e $1.2 \times I1$		$\pm 10\% I \leq 6 \times I_n$ $\pm 20\% I > 6 \times I_n$
S	50TD	Time-delayed overcurrent protection	$I2 = 0.6...10 \times I_n$	$0.1 \times I_n$	with $I > I2$, $t2 = 0.05...0.8 \text{ s}$
	68	Zone selectivity			$t2sel = 0.04...0.2 \text{ s}$
		Start up	Activation: $0.6...10 \times I_n$	$0.1 \times I_n$	Range: $0.1...30 \text{ s}$
		Tolerance	$\pm 7\% I \leq 6 \times I_n$ $\pm 10\% I > 6 \times I_n$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms}$
51	Time-delayed overcurrent protection	$I2 = 0.6...10 \times I_n$	$0.1 \times I_n$	with $I = 10 I_n$, $t2 = 0.05...0.8 \text{ s}$	
	Thermal Memory				
		Tolerance	$\pm 7\% I \leq 6 \times I_n$ $\pm 10\% I > 6 \times I_n$	$\pm 15\% I \leq 6 \times I_n$ $\pm 20\% I > 6 \times I_n$	
I	50	Istantaneous overcurrent protection	$I3 = 1.5...15 \times I_n$	$0.1 \times I_n$	with $I > I3$ Instantaneous
		Start up	Activation: $1.5...15 \times I_n$	$0.1 \times I_n$	Range: $0.1...30 \text{ s}$
		Tolerance	$\pm 10\%$		$\leq 30 \text{ ms}$
G	50N TD	Earth fault protection	$I4 = 0.1...1 \times I_n$	$0.001 \times I_n$	with $I > I4$ $t4 = \text{Instantaneous (with vaux)} + 0.1...1 \text{ s}$
		Zone selectivity			$t4sel = 0.04...0.2 \text{ s}$
	68	Start up	Activation: $0.2...1 \times I_n$	$0.02 \times I_n$	range: $0.1...30 \text{ s}$
		Tolerance	$\pm 7\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms}$ or 50 ms with $t4 = \text{Instantaneous}$
	51N	Earth fault protection	$I4 = 0.1...1 \times I_n$	$0.001 \times I_n$	with $I = 4 I_n$, $t4 = 0.1...1 \text{ s}$
		Tolerance	$\pm 7\%$		$\pm 15\%$
IU	46	Current unbalance protection	$I6 = 2...90\% I_n$ unbalance	$1\% I_n$	with unbalance $> I6$ $t6 = 0.5...60 \text{ s}$
		Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
2I	50	Programmable Istantaneous overcurrent protection	$I31 = 1.5...15 \times I_n$	$0,1 \times I_n$	with $I > I31$, Instantaneous
		Tolerance	$\pm 10\%$		$\leq 30 \text{ ms}$
MCR		Closing on short-circuit protection	$I3 = 1.5...15 \times I_n$	$0,1 \times I_n$	with $I > I3$ Instantaneous Monitor time Range: $40...500 \text{ ms}$
		Tolerance	$\pm 10\%$		$\leq 30 \text{ ms}$

Time Step	Excludibility	Excludibility trip	Blocks	Pre-allarm	Trip curve	Monitor	Protect	Protect+	Control	Control+
1s	yes	no	no	50...90% I1 step 1%	$t = k / I^2$	●	●			●
	yes					●	●			●
1s	yes	no	no	50...90% I1 step 1%	$t = \frac{kxt1}{\left(\frac{If}{I1}\right)^{n-1}}$	●	●			●
0.01s	yes	yes	yes	no	$t = k$	●	●			●
0.01s	yes					●	●			●
0.01s	yes					●	●			●
0.01s	yes	yes	yes	no	$t = k / I^2$	●	●			●
	yes					●	●			●
-	yes	no	yes	no	$t = k$	●	●			●
0.01s	yes					●	●			●
0.05s	yes	yes	yes	50.....90% I4 step 1%	$t = k$	●	●			●
0.01s	yes					●	●			●
0.01s	yes					●	●			●
0.05s	yes	yes		50.....90% I4 step 1%	$t = k / I^2$	●	●			●
0.5s	yes	yes	no	no	$t = k$	●	●			●
	yes	no	no		$t = k$	●	●			●
0.01s	yes	no	yes	no	$t = k$	●	●			●

Technical characteristics for protection functions

ABB Code	ANSI Code	Function	Threshold	Threshold step	Tripping time
Gext	50G TD	Earth fault protection	$I_{41}^{(1)} = 0.1...1 \times I_n$ Toroid	$0.001 \times I_n$ Toroid	with $I > I_{41}$, $t_{41} = 0.1...1s$
		Zone selectivity			$t_{41sel} = 0.04...0.2s$
	68	Start up	Activation: $0.1...1 \times I_n$	$0.02 \times I_n$	range: $0.1...30s$
		Tolerance	$\pm 7\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms}$
51G	Earth fault protection	$I_{41}^{(1)} = 0.1...1 \times I_n$	$0.001 \times I_n$	with $I = 4 I_n$, $t_{41} = 0.1...1s$	
	Tolerance	$\pm 7\%$		$\pm 15\%$	
Rc	64 50N TD 87N	Residual current protection	$I_{\Delta n} = 3 - 5 - 7 - 10 - 20 - 30A$		with $I > I_{\Delta n}$ $t_{\Delta n} = 0.06 - 0.1 - 0.2 - 0.3 - 0.4 - 0.5 - 0.8s$
		Differential ground fault protection			
		Tolerance	$-20\% \div 0\%$		140ms@0.06s (maximum trip time) 950ms@0.80s (maximum trip time)
LC1/2 Iw1/2		Current threshold LC	LC1=50%...100% I1 LC2=50%...100% I1	1% 1%	
		Current threshold Iw	Iw1= 0.1...10 I_n Activation Iw1: Up/Down Iw2= 0.1...10 I_n Activation Iw2: Up/Down	0.01 x I_n 0.01 x I_n	
		Tolerance	$\pm 10\%$		
UV	27	Undervoltage Protection	$U_8 = 0.5...0.98 \times U_n$	$0.001 \times U_n$	with $U < U_8$, $t_8 = 0.05...120s$
		Tolerance	$\pm 2\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
OV	59	Overvoltage protection	$U_9 = 1.02...1.5 \times U_n$	$0.001 \times U_n$	with $U > U_9$ $t_9 = 0.05...120s$
		Tolerance	$\pm 2\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
VU	47	Voltage unbalance protection	$U_{14} = 2...90\% U_n$ unbalance	$1\% U_n$	with unbalance $> U_{14}$, $t_{14} = 0.5...60s$
		Tolerance	$\pm 5\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
UF	81L	Underfrequency protection	$f_{12} = 0.9...0.999 \times f_n$	$0.001 \times f_n$	with $f < f_{12}$ $t_{12} = 0.15...300s$
		Tolerance	$\pm 1\%$ (with $f_n \pm 2\%$)		The better of the two data: $\pm 10\% \text{ (min = 30ms) o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
OF	81H	Overfrequency protection	$f_{13} = 1.001...1.1 \times f_n$	$0.001 \times f_n$	with $f > f_{13}$, $t_{18} = 0.15...300s$
		Tolerance	$\pm 1\%$ (with $f_n \pm 2\%$)		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
RP	32R	Reverse active power protection	$P_{11} = -1...-0.05 S_n$	$0.001 S_n$	$P > P_{11}$, $t_{11} = 0.5...100s$
		Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
Cyclical direction	47	Cyclical direction of the phases	1-2-3 o 3-2-1		
Power factor	78	3phase Power factor	$PF_3 = 0.5...0.95$	0.01	
S2	50TD	Time-delayed overcurrent protection	$I_5 = 0.6...10 \times I_n$	$0.1 \times I_n$	with $I > I_5$, $t_5 = 0.05...0.8s$
		Zone selectivity			$t_{5sel} = 0.04...0.2s$
	68	Start up	Activation: $0.6...10 \times I_n$	$0.1 \times I_n$	Range: $0.1...30s$
		Tolerance	$\pm 7\% I \leq 6 \times I_n$ $\pm 10\% I > 6 \times I_n$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms}$

Time Step	Excludibility	Excludibility trip	Blocks	Pre-allarm	Trip curve	Monitor	Protect	Protect+	Control	Control+
0.05s	yes	yes	yes	50.....90% I41 step 1%	t = k			●		●
0.01s								●		●
0.01s	yes							●		●
0.05s	yes	yes	yes	50.....90% I41 step 1%	t = k / I ²			●		●
	Attivabile with rating plug Rc no			no	t = k			●		●
	yes	only signalling	no	no	-			●		●
	yes	only signalling	no	no	-			●		●
0.01s	yes	yes	yes	no	t = k			●		●
0.01s	yes	yes	yes	no	t = k			●		●
0.5s	yes	yes	yes	no	t = k			●		●
0.01s	yes	yes	yes	no	t = k			●		●
0.01s	yes	yes	yes	no	t = k			●		●
0.1s	yes	yes	yes	no	t = k			●		●
	yes	only signalling	no	no	-			●		●
	yes	only signalling	no	no	-			●		●
0.01s	yes	yes	yes	no	t = k			●		●
0.01s	yes							●		●
0.01s	yes							●		●


Technical characteristics for protection functions

ABB Code	ANSI Code	Function	Threshold	Threshold step	Tripping time
D	67	Directional overcurrent protection (Forward & backward)	$I7 = 0.6...10 \times I_n$	$0.1 \times I_n$	with $I > I7$, $t7 = 0.1...0.8s$
		Zone selectivity			$t7sel = 0.1...0.8s$
	68	Start up (Forward & backward)	Activation: $0.6...10 \times I_n$	$0.1 \times I_n$	range: $0.1...30s$
		Trip direction	Forward or/& backward		
		Minimum angle direction	3.6, 7.2, 10.8, 14.5, 18.2, 22, 25.9, 30, 34.2, 38.7, 43.4, 48.6, 54.3, 61, 69.6 (°)		
	Tolerance	$\pm 7\% I \leq 6 \times I_n$ $\pm 10\% I > 6 \times I_n$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms}$	
UV2	27	Undervoltage Protection	$U15 = 0.5...0.98 \times U_n$	$0.001 \times U_n$	with $U < U15$, $t15 = 0.05...120s$
		Tolerance	$\pm 2\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
OV2	59	Overvoltage protection	$U16 = 1.02...1.5 \times U_n$	$0.001 \times U_n$	with $U > U16$, $t16 = 0.05...120s$
		Tolerance	$\pm 2\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
UF2	81L	Underfrequency protection	$f17 = 0.9...0.999 \times f_n$	$0.001 \times f_n$	with $f < f17$, $t17 = 0.15...300s$
		Tolerance	$\pm 1\%$ (with $f_n \pm 2\%$)		The better of the two data: $\pm 10\% \text{ (min=30ms) o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
OF2	81H	Overfrequency protection	$f18 = 1.001...1.1 \times f_n$	$0.001 \times f_n$	with $f > f18$, $t18 = 0.15...300s$
		Tolerance	$\pm 1\%$ (with $f_n \pm 2\%$)		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
S(V)	51V	Voltage controlled overcurrent protection	$I20 = 0.6...10 \times I_n$	$0.1 \times I_n$	with $I > I20$, $t20 = 0.05...30s$
		Step Mode	$U1 = 0.2...1 \times U_n$	$0.01 \times U_n$	
			$Ks = 0.1...1$	0.01	
		Linear Mode	$U1 = 0.2...1 \times U_n$	$0.01 \times U_n$	
			$U_h = 0.2...1 \times U_n$	$0.01 \times U_n$	
Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$		
RV	59N	Residual overvoltage protection	$U22 = 0.05...0.5 \times U_n$	$0.001 \times U_n$	with $U > U22$, $t22 = 0.05...120s$
		Tolerance	$\pm 5\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
OP	32OF	Active overpower protection	$P26 = 0.4...2 \text{ Sn}$	0.001 Sn	$P > P26$, $t26 = 0.5...100s$
		Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
OQ	32OF	Reactive overpower protection	$Q27 = 0.4...2 \text{ Sn}$	0.001 Sn	$Q > Q27$, $t27 = 0.5...100s$
		Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
UP	32LF	Active underpower protection	$P23 = 0.1...1 \times \text{Sn}$	$0.001 \times \text{Sn}$	with $P < P23$ $t23 = 0.5...100s$
		Start up			range: $0.1...30s$
		Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$

Technical characteristics for protection functions

ABB Code	ANSI Code	Function	Threshold	Threshold step	Tripping time
RQ	40/32R	Loss of field or reverse reactive power protection	$Q_{24} = -1...-0.1 S_n$ $K_q = -2...2$	0.001 S_n 0.01	$Q > Q_{24}, t_{24} = 0.5...100s$
		Loss of field or reverse reactive power protection	$Q_{25} = -1...-0.1 S_n$ $K_{q2} = -2...2$	0.001 S_n 0.01	$Q > Q_{25}$
		Voltage minimum threshold	$V_{min} = 0.5...1.2$	0.01	
		Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
		Secondary voltage	100.....120	100. 110. 115. 120	
S2(V)	51V	Voltage controlled overcurrent protection	$I_{21} = 0.6...10 \times I_n$	0.1 $\times I_n$	with $I > I_{21}$ $t_{21} = 0.05...30s$
		Step Mode	$U_{I2} = 0.2...1 \times U_n$ $K_{s2} = 0.1...1$	0.01 $\times U_n$ 0.01	
		Linear Mode	$U_{I2} = 0.2...1 \times U_n$ $U_{h2} = 0.2...1 \times U_n$ $K_{s2} = 0.1...1$	0.01 $\times U_n$ 0.01 $\times U_n$ 0.01	
		Tolerance	$\pm 10\%$		The better of the two data: $\pm 10\% \text{ o } \pm 40 \text{ ms (for } t < 5 \text{ s) / } \pm 100 \text{ ms (for } t \geq 5 \text{ s)}$
		ROCOF	81R	Rate of change of frequency protection	$f_{28} = 0.4...10 \text{ Hz/s}$
		Trip direction	Up or down up&down		
		Tolerance	$\pm 5\%$		The better of the two data: $\pm 20\% \text{ o } \pm 200 \text{ ms}$
Synchro-check SC	25	Synchrocheck (Live busbars)	$U_{live} = 0.5...1.1 U_n$ $\Delta U = 0.02...0.12 U_n$ $\Delta f = 0.1...1 \text{ Hz}$ $\Delta \varphi = 5...50^\circ \text{ elt}$	0.001 U_n 0.001 U_n 0.1 Hz 5° elt	Stability voltage time for live state = 100...30000s minimum matching Time= 100...3000s
		Synchrocheck (Live,Dead busbars)	$U_{live} = 0.5...1.1 U_n$ $U_{dead} = 0.02...0.2 U_n$	0.001 U_n 0.001 U_n	$t_{ref} = 0.1...30s$
		Frequency check off			
		Fase check off			
		Dead bar configuration	Reversed/standard		
Primary voltage	100.....1150			100. 115. 120. 190. 208. 220. 230. 240. 277. 347. 380. 400. 415.440. 480. 500. 550. 600. 660. 690. 910. 950. 1000. 1150	
				Secondary voltage	100.....120
		Tolerance	$\pm 10\%$		
Lock out relay	86	With external dedicated auxiliary relay, like Artech type BJ-8-125VDC or equivalent			


Technical characteristics for protection functions

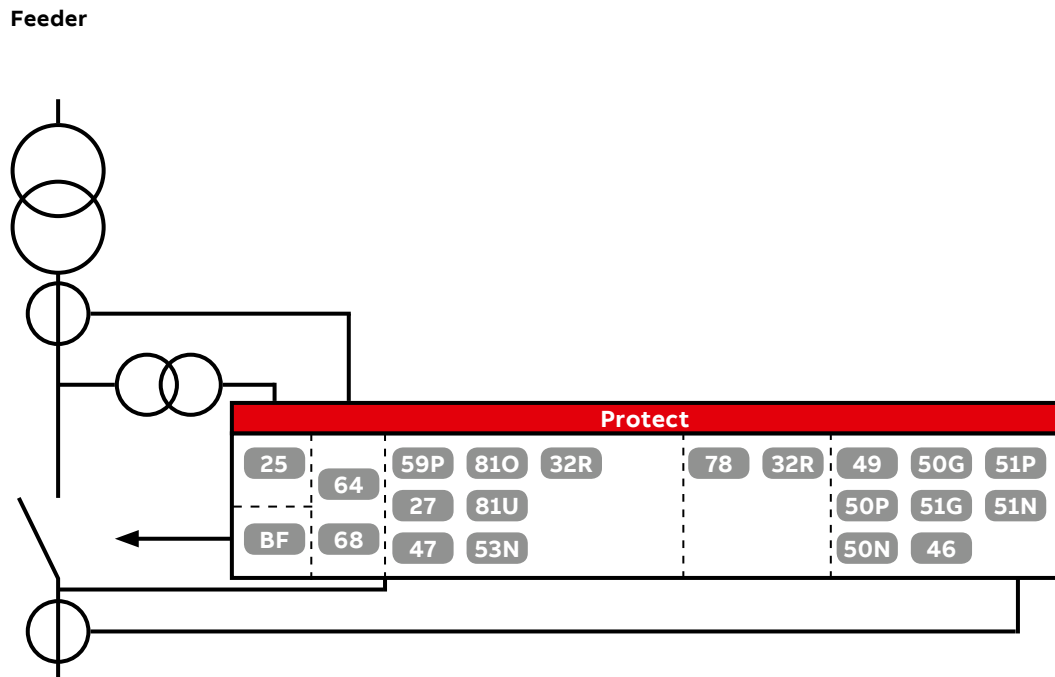

Protection list from ANSI words

BF:	breaker failure	59N:	residual voltage
49:	thermal model	81O:	over frequency
50P/N:	phase/neutral instantaneous over-current	81U:	under frequency
50G:	ground instantaneous over-current	78:	power factor
51G:	ground over-current	32R:	reverse power
46:	current unbalance	68:	zone selectivity
64:	residual current	25:	synchrocheck
59:	over voltage		
27:	under voltage		
47:	voltage unbalance		

Generator

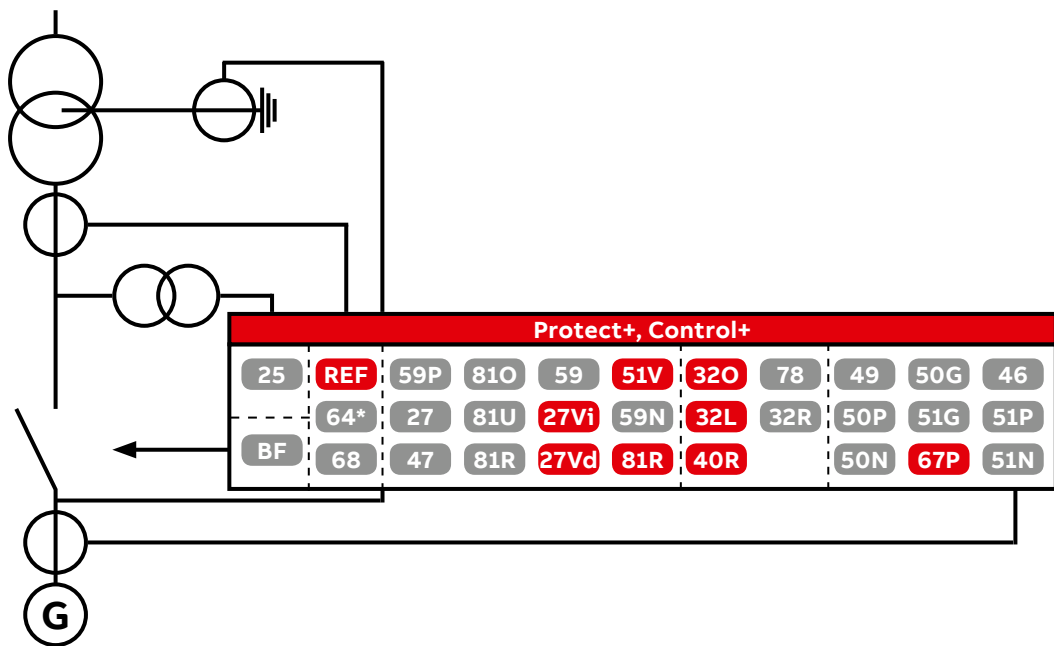

Protection list in addition to Ekip UP Protect


- 67P: directional over-current
- 87REF: restricted earth fault
- 27Vi: negative sequence under voltage
- 27Vd: positive sequence under voltage
- 51V: volts per hertz
- 81R: rocof (rate of change of frequency)
- 32O: over reactive/active power
- 32L: under active power
- 40R: reverse reactive power

Dual settings

* 87REF or 64

Description of protection functions


Ekip UP offers current, voltage and power based protection functions. These functions can be set with a few simple steps directly from the wide touchscreen display or using Ekip Connect commissioning software. All the protections can be excluded if necessary. Information on trip and opening data as well as maintenance indicators are available through the Ekip UP memory.




Overload (L - ANSI 49): available with three different types of trip curve:

1. $t = k/I^2$ with inverse long time;
2. IDMT in accordance with the Standard IEC 60255-151 for coordination with medium voltage protection, which are available according to the Standard Inverse (SI), Very Inverse (VI) and Extremely Inverse (EI) curves;
3. with $t = k/I^4$ curve for better coordination with upstream switching devices or with fuses.


The thresholds can be fine tuned. There are adjustable pre-alarm indicators to provide notification prior a protection reaching the threshold and tripping the unit. All timing settings can also be adjusted, directly from the display.



Time-delayed overcurrent (S - ANSI 51 & 50TD): with constant tripping time ($t = k$), or with constant specific let-through energy ($t = k/I^2$), this provides 15 current thresholds and 8 curves, for fine adjustment.




Thermal memory: for protections L and S it is used to protect the components, such as transformers, against overheating following overloads. The protection adjusts the trip time of the protection according to how much time has elapsed after the first overload, taking account of the overheating caused.




Instantaneous overcurrent (I - ANSI 50): with trip curve without intentional delay, it offers 15 tripping thresholds.

Closing on short-circuit (MCR): the protection uses the same algorithm as the protection I, limiting operation to a settable time window from the closing of the switching device. The protection can be disabled, also alternatively to protection I.


The function is active with an auxiliary supply.




Earth fault (G - ANSI 51N & 50NTD): with trip time independent of the current ($t = k$) or with constant specific let-through energy ($t = k/I^2$). A pre-alarm indication is also available when 90% of the threshold is reached to activate corrective measures before the protection is tripped. The function also enables the trip to be excluded so that only the alarm is indicated, for use in installations where continuity of service is an essential requirement.




Instantaneous Earth Fault (G-ANSI 50N): with trip curve without instantaneous delay.



Earth fault on toroid (G ext - ANSI 51G & 50GTD): with trip time independent of the current ($t = k$) or with constant specific let-through energy ($t = k/I^2$). Pre-alarm that 90% threshold has been reached permits the fault to be reported to supervision systems without interruption of continuity. The protection uses the external toroid installed, for example, on the star center of the transformer, and is an alternative to the G and Rc functions. The function is active with an auxiliary supply.




Neutral protection: available at 50%, 100%, 150% or 200% of the phase currents, or disabled, it is applied to the overcurrent protections L, S and I.




Start-up function: enables protections S, I and G to operate with higher trip thresholds during the starting phase, avoiding untimely trips due to high inrush currents of certain loads (motors, transformers, lamps). The starting phase lasts 100 ms to 30 s and is recognized automatically by the trip unit:

- at the closing of the switching device with a self-supplied trip unit;
- when the peak value of the maximum current exceeds the set threshold ($0.1...10 \times I_n$) with an externally supplied trip unit; a new start-up is possible after the current falls below the threshold.



Current unbalance (IU - ANSI 46): with constant trip time ($t = k$), protects from an unbalance between the currents of the single phases protected by the switching device.



Zone selectivity for S and G protection (ANSI 68): can be used to minimize circuit-breaker trip times closer to the fault. The protection is provided by connecting all the zone selectivity outputs of the trip units belonging to the same zone and taking this signal to the trip unit input that is immediately upstream.

Each switching device that detects a fault reports it to the switching device upstream; the circuit-breaker thus detects the fault but does not receive any communication from those downstream and opens without waiting for the set delay to elapse. It is possible to enable zone selectivity if the fixed-time curve has been selected and the auxiliary supply is present.

Current thresholds: this function enables four independent thresholds to be indicated in order to enable corrective action implementation before the overload L protection trips the switching device. For example, by disconnecting loads located downstream of the switching device that are controlled by Ekip Signalling.

Description of protection functions


Protection functions with Ekip Measuring

Ekip UP protection functions can be further increased thanks to the embedded Ekip Measuring module. With this module, all the protection functions linked to voltage, frequency and power can be enabled, thus making Ekip UP a complete protection unit that can measure, control and protect even the most complex installation.


A different operating mode can be chosen for each protection function:

1. Active: protection enabled by opening of the circuit-breaker when the threshold is reached;
2. Only alarm: protection active, with only alarm indication when the threshold is reached;
3. Deactivated: protection disabled.


Furthermore, when the voltage and frequency protections are activated, they indicate an alarm status even when the switching device is open so that a fault can be identified before the switching device closes.




Undervoltage (UV - ANSI 27): with constant trip time ($t = k$), function is tripped when phase voltage falls below set threshold.




Overvoltage (OV - ANSI 59): with constant trip time ($t = k$), function is tripped when phase voltage exceeds the set threshold.




Underfrequency (UF - ANSI 81L): with constant trip time ($t = k$), function is tripped when network frequency falls below set threshold.




Overfrequency (OF - ANSI 81H): with constant trip time ($t = k$), function is tripped when network frequency exceeds the set threshold.



Voltage unbalance (VU - ANSI 47): with constant trip time ($t = k$), protects against an unbalance between the voltages of the individual phases that are protected by the circuit-breaker.




Residual current (Rc – ANSI 64 & 50NDT): with constant temperature ($t=k$) protects against indirect contacts and is integrated into Ekip UP Protect and Ekip UP Protect+ by a dedicated residual current rating plug and external toroid. The protection is an alternative to the functions G and Gext and it is activated by dedicated rating plugs.



Reverse active power (RP - ANSI 32R): with constant trip time ($t = k$), function is tripped when total active power – in the opposite direction of the current - exceeds the set threshold.

In addition to the protection functions, the following indication and control functions are available to warn the user that a given condition has been reached. The active indications are always shown on the display and are also available by communication on the system bus (with Ekip Com modules) or electrical indication (with Ekip Signalling modules).




Synchrocheck (SC - ANSI 25): the synchronism control function compares the voltages in the modules as well as the frequencies and phases of two switching devices to which the switching device is connected. Ekip UP indicates that conditions have been reached also with display synchronism indicators that enable the two lines to be made parallel.

The function is available with two work modes:

- In systems with both busbars supplied, where synchronism is determined by:
 1. voltage of the two half-busbars above the U_{live} threshold for the set time
 2. difference of the module of the two voltages below the threshold ΔU
 3. difference in the frequency of the two voltages below the threshold Δf
 4. difference in the phase of the two voltages below the threshold Δ
 5. desirable time for synchronism condition t_{syn}
 6. switching device open
- In systems with an out-of-service line (dead busbar), where the synchronism condition is determined by the concurrence of the following conditions for the t_{ref} set time:
 1. voltage of the active half-busbar above threshold U_{live}
 2. voltage of the dead half-busbar below threshold U_{dead}
 3. switching device open

In both cases, synchronism consent is withdrawn when one of the above conditions is missing and it has not been less than 200ms from the change of the circuit-breaker condition (when the relationship has been set).

The indication of reached synchronism is available directly as an electrical indication via a contact that is always supplied with the module. The function can be activated simply by connecting the Ekip Synchrocheck module to any Ekip UP Protect or Protect+.




Cyclical direction of the phases (ANSI 47): indicates an alarm through inversion of the phases sequence.

Power factor (ANSI 78): available with a three-phase threshold, warns when the system operates with a power factor that is less than the set power factor.

Description of protection functions

The following protections are also available:


Second time-delayed overcurrent protection (S2 – ANSI 50TD): in addition to the standard protection S, a second (excludable) time-constant protection is available that enables two independent thresholds to be set in order to ensure precise selectivity, especially in highly critical conditions.



Second protection against earth fault (ANSI 50GTD/51G & 64REF): whereas with Ekip UP Protect the user can choose the implementation of the protection G by own current sensors (calculating the vector sum of the currents), Ekip UP Protect+ offers the simultaneous management of both configurations by two independent earth fault protection curves. Owing to this characteristic, the trip unit is able to distinguish a non-restricted earth fault and then activate the opening of low voltage switching device, from a restricted earth fault, and to thus command the opening of the medium voltage switching device.


Another possible configuration is with the residual current protection replacing the Gext protection, whilst the G protection remains active. The residual current protection is activated in the presence of the residual current rating-plug and of the toroid.

Directional overcurrent (D – ANSI 67): the protection is able to recognize the direction of the current during the fault period and thus detect if the fault is upstream or downstream of the circuit-breaker. The protection, with fixed time trip curve ($t=k$), intervenes with two different time delays (t_{7bw} and t_{7fw}), according to the current direction. In ring distribution systems, this enables the distribution portion to be identified in which the fault occurred and to disconnect it while maintaining the operation of the rest of the installation.




Zone selectivity for protection D (ANSI 68): enables the possibility to interconnect switching devices so that, in the event of a fault, the fault area can be rapidly isolated. Disconnection only occurs at the level close to the fault and operation to the rest of the operation continues uninterrupted. The function is particularly useful in ring and grid installations where, in addition to the zone, it is also essential to define the flow direction of the power that supplies the fault. It is possible to enable directional zone selectivity alternatively to the zone selectivity of the protections S and G, and in the presence of an auxiliary supply.

Start-up function for protection D: enables higher trip thresholds to be set at the outgoing point, as available for protections S, I and G.



Second protection against undervoltage and overvoltage (UV2 and OV2 – ANSI 27 and 59): enables two minimum and maximum voltage thresholds to be set with different delays in order to be able to discriminate, for example, between voltage dip transients due to the start-up of a motor and an actual fault.




Second protection against underfrequency and overfrequency (UF2 and OF2 – ANSI 81L and 87H):

enables two minimum and maximum frequency thresholds to be set simultaneously. For example, only an alarm can be set to be tripped when the first threshold is reached, and the switching device can be set to be opened when the second threshold is reached.


Dual setting of protections: Ekip UP Protect+ can store a set of alternative parameters for all protections. This second series (set B) can replace, if necessary, the default series (set A) by an external command. The command can be given when the network configuration is edited, for example when an emergency source is activated in the system, changing the load capacity and the short-circuit levels. Another typical application is protecting the operator opposite the switchgear against the electric arc. In this case, protection delays are minimized to safeguard the operator (Set A), whereas in the absence of an operator the protections are set to ensure selectivity with the switching devices downstream (Set B). It is possible to activate series B by:

- Digital input available with an Ekip Signalling module;
- Communication network, by means of one of the Ekip Com communication modules;
- Directly from the Ekip UP display;
- By a settable internal time, after the circuit-breaker has closed.




Differential ground fault (Rc - ANSI 87N): protects against internal earth fault on generator winding. It is required that the toroid hugs the active conductors and the ground conductor. Rc protection is integrated by a dedicated residual current rating plug and the external toroid.

The specific functions for generator protections are described below. For each of these it is possible to choose the operating mode: active, only alarm or deactivated. All the voltage and frequency protections also operate when the circuit-breaker is open, enabling the fault to be identified before the closing of the switching device.




Voltage controlled overcurrent protection (S(V) - ANSI 51V): protection from maximum current with a constant trip time ($t = k$) that is sensitive to the voltage value. The set current threshold, following a voltage drop, decreases by steps or linearly.




In step mode (controlled mode) the protection is tripped at the set threshold (I_{20}) if the voltage is above U , whereas it is tripped at the lower threshold of the factor K_s ($I_{20} * K_s$) if the voltage is below U .


Description of protection functions




On the other hand, in linear mode (restrained mode) two voltage limits are selected within which the protection is tripped at the set threshold (I_{20}) reduced by the factor K corresponding to the measured voltage. The variation of the factor K is proportional to the voltage, and for voltages greater than the upper threshold (U_h) the threshold I_{20} works, whereas for voltages below the lower threshold (U_l) the minimum threshold ($I_{20} * K_s$) applies.




Residual overvoltage (RV – ANSI 59N): with constant trip time ($t = k$), protects against insulation loss in systems with insulated neutral or with neutral earthed with impedance.




Loss of field or reverse reactive power (RQ – ANSI 40 or 32RQ): with constant trip time ($t = k$), the switching device tripped when the total reactive power absorbed by the generator exceeds the set threshold. It is possible to select the constant threshold ($k=0$) or a function of the delivered active power of the generator ($k \neq 0$).



Reactive overpower (OQ – ANSI 32OF): with constant trip time ($t = k$), the function is tripped when reactive power exceeds the set threshold in the generator to network direction.




Active overpower (OP – ANSI 32OF): with constant trip time ($t = k$), the function is tripped when the active power exceeds the threshold set in the delivering direction of the generator.




Active underpower (UP – ANSI 32LF): with constant trip time ($t = k$), the function is tripped when the active power delivered by the generator is lower than the set threshold. It is possible to disable the protection temporarily, to manage the start-up phase, by setting a time window from the closing of the switching device, by using an electrical signal or via incoming communication to a relay.


In addition, the following protections are also available:



Rate of change of frequency (ROCOF – ANSI 81R): enables both positive and negative frequency variations to be rapidly detected. The protection is constant and is tripped when the frequency variation in Hz/s is greater than the set threshold.



Second protection against voltage controlled overcurrent protection (S2(V) - ANSI 51V): available in addition to the protection S(V), enables total selectivity to be achieved in all installations.



Second protection against loss of field or reverse reactive power (RQ – ANSI 40 or 32R): enables the generator’s de-energization curve to be followed very accurately, thereby avoiding any unnecessary disconnection.

For more information on generator protections, please refer to the product note for Ekip G - 1SDC210108D0201.



Software functions

- 3/2** **Introduction**
- 3/4** **Interface Protection System**
- 3/6** **Adaptive Protections**
- 3/8** **Load Shedding**
- 3/10** **Synchrocheck**
- 3/12** **Power Controller**


Introduction

Renewables have been growing during the last ten years reducing pollution for a greener environment. Due to environmental changes, people have started thinking about ecology and sustainability, increasing their awareness of energy self-consumption and efficiency.

Ekip UP is the first unit to upgrade low-voltage plants with advanced protection, programmable logic, full connectivity, easy integration and comprehensive energy management in a single revolutionary device.

Installed downstream of the MV/LV transformer, Ekip UP works like a certified **Interface Protection System** in order to check the Main Grid conditions and disconnect the facility whenever grid voltage and frequency are out of the ranges prescribed by the local Standards.

Ekip UP and its **Adaptive Protections** recognize the network change and automatically set new thresholds to guarantee protection and coordination in on-grid and off-grid conditions.

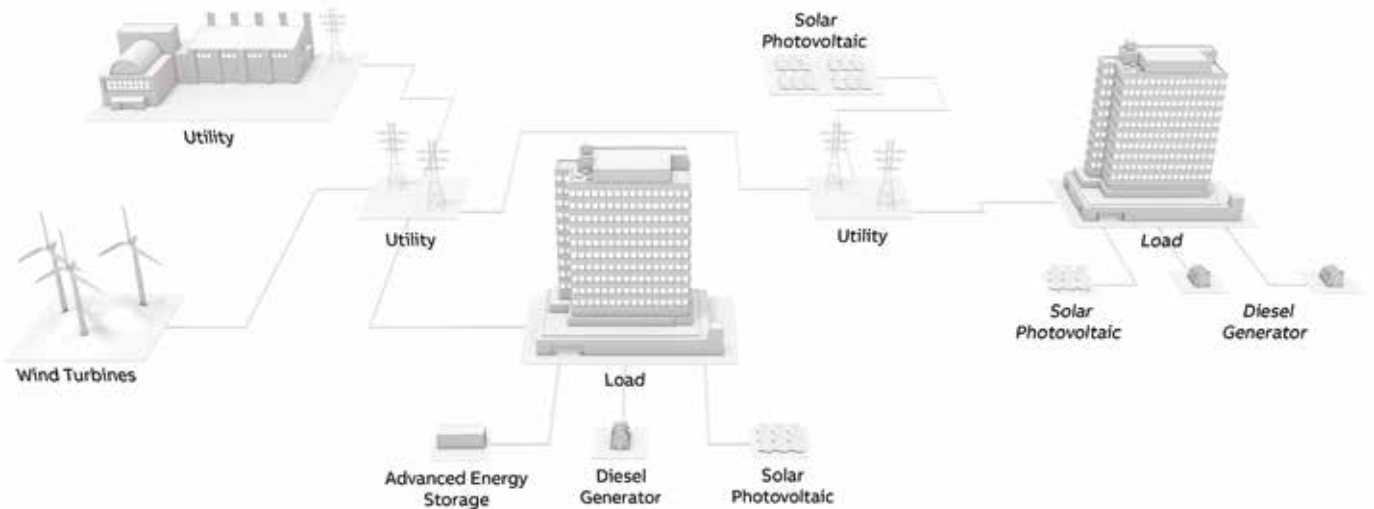

In order to maximize the service continuity, local generation starts to supply the islanded plant. Ekip UP integrates programmable status based on measurements, events and protections, so it is possible to create transfer switching logics. It can be also easily integrated with ATS controller in revamping projects.

The **Load Shedding** embedded algorithm is able to manage the power system for comprehensive microgrid energy management.

Before the transfer from the main grid to local line, selected loads are shed to support power balance. Ekip UP, using slope of frequency, can disconnect loads in case of emergency unbalance condition.

When the main grid comes back stable, thanks to When the main grid is stable again, Synchrocheck logics manages voltage and frequency to allow plant reconnection to the Utility.

In grid-connected operation, Ekip UP manages the **Power Controller** algorithm to shave peaks and shift loads in order to optimize system performance and productivity.

Ekip UP advanced features are easily customized thanks to commissioning software tools which do not require high level engineering competencies. Ready to use templates enable the download of all the logics directly into the unit. The solutions become plug & play, increasing modularization and standardization for design and installation.

Software function compatibility table

	Interface Protection	Load Shedding	Synchrocheck	Power Controller
Interface Protection		●		●
Load Shedding	●		●	●
Synchrocheck		●		●
Power Controller	●	●	●	

Interface Protection System

Ekip UP embeds interface protections for active plant or renewable sources connected to medium voltage grid.

Purpose

The Interface Protection System provides the protections necessary to connect Prosumers (end user with local generation available) to the Utility. The generating units installed in the facility plant will be disconnected from the grid whenever voltage and frequency values of the grid itself are out of the Standards' range. Such a disconnection is usually carried out by means of an Interface Device (air circuit breaker, molded case circuit breaker, switch disconnecter or contactor) that trips after receiving an opening command provided by an external Interface Protection System. ABB Ekip UP Protect+ or Control+ is able to perform the functions of Interface Protection System as a unique flexible solution. This advanced feature is possible thanks to the implementation of the several interface protections into the trip unit installed on board Ekip UP. Today Ekip UP is suitable for Standard CEI 0-16, the most important Standard for the connection of Active Users. CEI 0-16 is a reference for a lot of other local standards, in particular in Italy and harmonized for European countries. In many other Countries the IPS function can very useful as well.

Application examples

ABB has been able to integrate in a single device the following functions to be used in the scenarios described below. Thanks to these embedded functions, the number of devices for feeder or generator protection, energy and asset management to be installed is reduced, with consequent component saving inside the switchboard. Ekip UP with embedded Interface Protection System has been tested and certified in compliance with the Standard CEI 0-16 and are suitable for the following scenarios.

Ekip UP as Microgrid Main protection unit

In this scenario, Ekip UP with embedded Interface Protection System can fulfill the function of Interface Protection System (IPS). In case of IPS tripping, microgrid, downstream Ekip UP main unit, remains active thanks to both the local generation and the load shedding feature also embedded in the main unit.

Ekip UP as local generation protection unit

In this scenario, there are non-operating loads in islanding condition, so, when there is an Utility outage, Ekip UP detects that voltage and frequency values are out of the range prescribed. According to the standard the local generation must be disconnected from the Utility, so Ekip UP opens, acting as interface device, thanks to the IPS embedded. In this condition loads are not operating as there is no voltage on the secondary of the MV/LV transformer and no local generation connected.

Benefits


Thanks to Ekip UP with embedded Interface Protection System, the following benefits are guaranteed:

- Ekip UP performs interface protections with every possible switching device, ensuring also reclosing operation when grid is restored. The reclosing logics are granted with air circuit breaker, molded case circuit breakers, switch disconnecter or contactor.
- If the Ekip UP is installed on the generator feeder, the unit will be able to perform the double function of Interface Protection System and Generator Protection thanks to the range of protections integrated also in the Ekip UP Protect+ or Control+ unit.
- Ease of use, thanks to Ekip Connect software which allows an immediate and intuitive commissioning phase.
- Power generation remote monitoring with the main energy and power quality parameters available through cloud-based platform.


For more info check out the product note for Interface Protection Systems, 1SDC210103D0201.



— Ekip UP as Microgrid Main protection unit

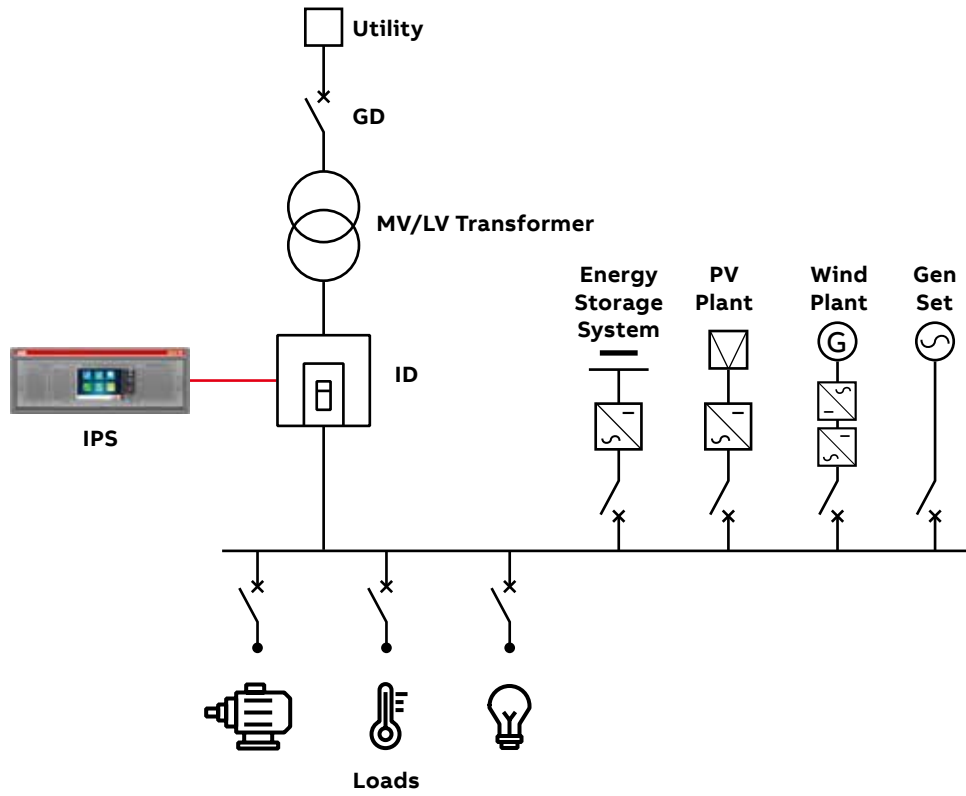

— Ekip UP as local generation protection unit

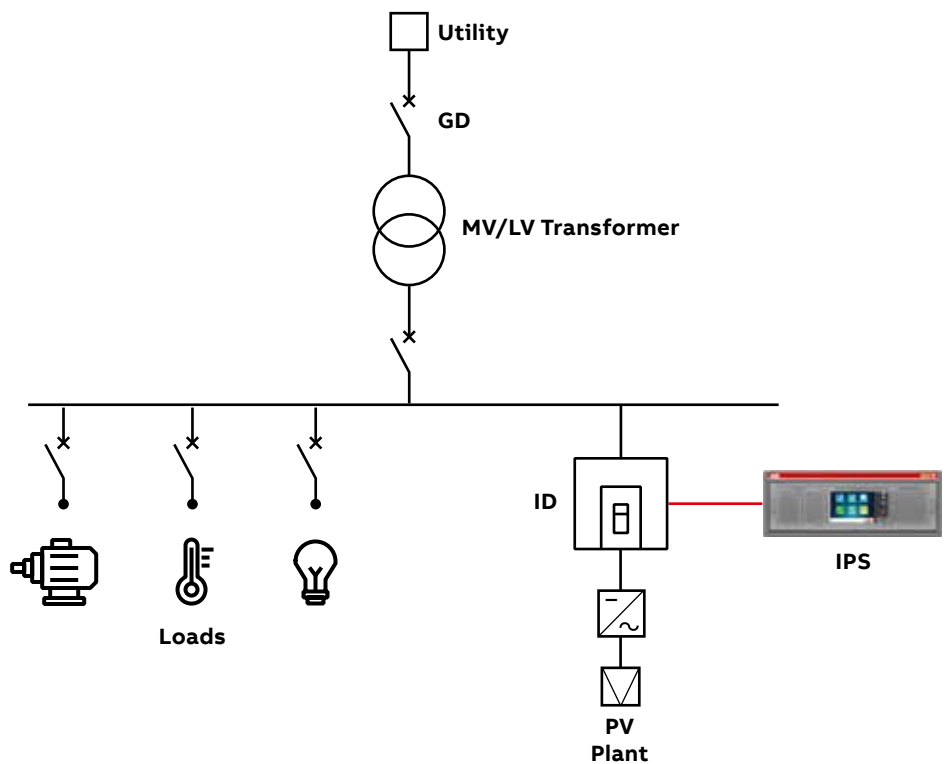

Adaptive Protections

Ekip UP offers dual protection level settings to ensure continuous operation during power transfer.

Purpose

User’s plants can work as a LV Microgrid thanks to the energy produced by renewable and local power sources, in particular as a consequence of lacking of the Utility power supply, e.g. due to a fault on the MV voltage side. In order to still guarantee a high level of selectivity and continuity of service, it is important to take into account the variation of the short circuit power when moving from. Indeed, during grid connected condition the fault current on a Microgrid feeder is supplied by the Utility, so it is higher than the one supplied only by the local generation during islanded condition.

As a result, it is desirable that the different protection thresholds of the units can be automatically changed during the transition to the islanding condition. This is possible with Ekip UP Protect+ and Control+ versions.

Application example

A typical case is facility connected to the MV Utility by means of a MV/LV transformer. If the Utility shuts down, the plant will become a Microgrid supplied by the local generator G, which will feed the priority loads by using the load shedding feature of Ekip UP.

In grid-connected condition, the generator G is disconnected. With reference to fig.1:

- Circuit breaker A is closed
- Circuit breaker B is open
- Circuit breakers C are closed. The protections of the one that supplies loads D are upgraded using "Set A" of Ekip UP unit.
- Circuit breakers D are closed
- Circuit breaker E is closed
- Circuit breaker QS1 is closed
- All loads supplied.

The circuit breakers C are selectively coordinated with the upstream main circuit breaker A, supplied by the Utility, and the downstream load circuit breakers D (fig. 2).

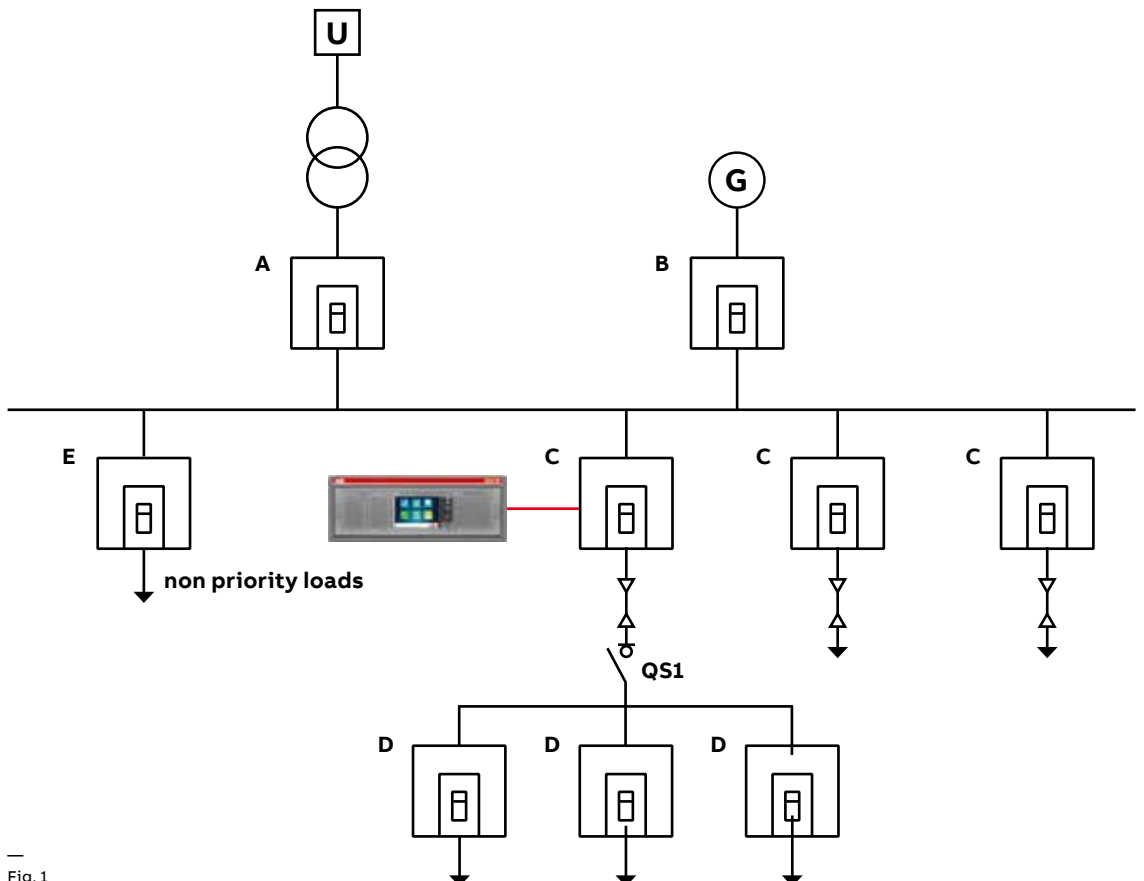


Fig. 1

When there is a Utility outage, circuit breaker A opens and B to switch to the local backup power source (islanded condition). In order to ensure coordination, Ekip UP adaptive protections - added on circuit breaker C - offer a second set of protection level settings to ensure selectivity is maintained in the system. The second set of protection levels are optimized for the characteristics of the local generator ensuring the incoming supply and load side switching devices will remain selectively coordinated.

With reference to Figure 1:

- Circuit breaker A is open
- Circuit breaker B is closed
- Circuit breakers C are closed and the protection thresholds move automatically to “Set B”
- Circuit breakers D are closed
- Circuit breaker E is open
- Circuit breaker QS1 is closed
- No priority loads can be disconnected using another functionality of Ekip UP units (see next paragraph).

The following Figure shows how it is possible to switch to a set of parameters which guarantees selective coordination between switching devices C and B by means of the “Adaptive protections” function embedded in the trip unit of the circuit-breaker C.

Benefits

Ekip UP Protect+ and Control+ offer two sets of settings in a single device providing:

- Overcurrent protection and selectivity when connected to either the main utility power or a local backup power source
- Service continuity in just a single unit of the switchboard
- Ease of use, thanks to the Ekip Connect software which allows quick and easy commissioning.

As Ekip UP shares the same electronics of Emax 2 circuit breaker, for more info check out the white paper " Emax 2, all in one innovation: Adaptive protections" - 1SDC007116G0201.

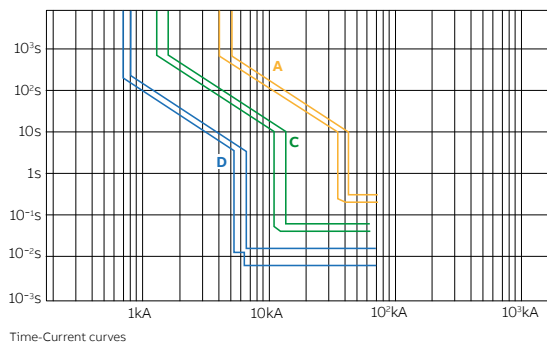


Fig. 2

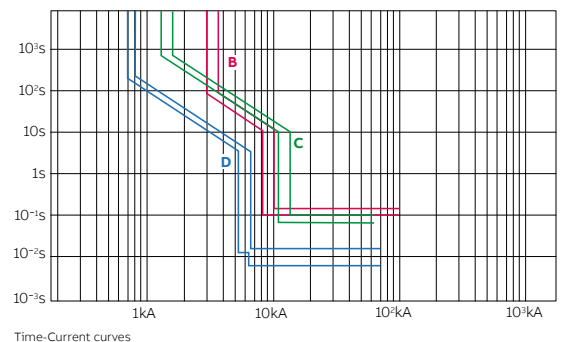


Fig. 3

Load Shedding

Ekip UP has built-in load shedding algorithms to avoid blackouts due to power unbalance in the low voltage plant and reduce stress on the system's components.

Purpose

ABB Ekip UP embeds patented functions based on load shedding which reduces Microgrid stress. Typically it is the main protection relay of the low voltage Microgrid located at the interface point with the medium voltage grid, able to control the facility in every circumstances.

Microgrid in islanding operation

When a circuit breaker or switching device opens due to Ekip UP interface protection systems or an external command, the transition from on-grid to off-grid should be smooth and bumpless. When it is standalone, the power absorption from the main grid ceases, so that the Microgrid loads remains supplied by the local generation, like a diesel GenSet or energy storage systems. This Microgrid generation can always be active or started up by an automatic transfer switching (ATS) logic after the disconnection from the main grid, depending on the plant configuration. During the islanding transition, it is very important to avoid the frequency drop, otherwise the generation protections could trip jeopardizing the Microgrid stability with consequently a long downtime. Ekip UP, employing current and voltage measurement, integrates two different fast load shedding logics to reduce this blackout risk, protecting the Microgrid during the intentional or unintentional islanding operation:

- Basic Load Shedding is a simple logic able to recognize the Microgrid disconnection event and shed a predefined group of non-priority loads thus ensuring power balance in a fast reaction time.
- Adaptive Load Shedding is the advanced algorithm available with Ekip UP as an enhancement of the basic version which is standard supplied. The intelligent software embedded in the unit sheds very quickly the non-priority loads according to the Microgrid power consumption and frequency levels. Moreover, this software has a dedicated configuration for ATS configuration with backup generation and it is even able to estimate the energy produced by a solar plant based on plant geography settings.

All the versions are available on Ekip UP Protect, Protect+, Control+ for both the Microgrid situations, sharing some information about the loads under control in the plant.

Application examples

- Facilities with GenSets running along with renewable sources. For example remote PV-diesel communities connect to weak distribution grids with frequent faults, or plants located in geographical areas with frequent environmental events, such as hurricanes or earthquakes.
- Grid-connected plants with back-up GenSets that require high reliability. For example, hospitals, banks or data centers.

Benefits

Thanks to Ekip UP with embedded Load Shedding innovation, the following benefits are guaranteed:

Service continuity

- When a plant remain disconnected from the main grid, even if local production is present, there is a significant stress that turns off all the generators with consequent blackout. Load Shedding logics embedded in Ekip UP reduce the frequency drop that usually makes the local generation protection trip, so maintaining the plant live.

Space saving

- Ekip UP has embedded intelligence for Load Shedding: taking advantage of the current and voltage sockets there is no need for other PLCs.
- In addition, static converters for low voltage photovoltaic production have typically anti-islanding protections: this implies another power deficit to be added to the main grid contribution lost during the Microgrid islanding. Ekip UP is the first digital unit that estimates solar production without additional sensors.
- Load Shedding is suitable with ATS architectures like Main-BusTie-Gen used to distinguish priority/non-priority loads. Where feasible, BusTie switching device is not required anymore and this means:
 - Significant space and material saving up to 50% in the power distribution switchgear for panel builders.

- More flexibility for consultants during plant design. Indeed, Load Shedding dynamically chooses the loads to be shed based on real time power unbalance.
- ATS unit manages only two sources, without interlock, logic programming and wiring connections for the third circuit breaker with less time required for installation.


Ease of use

- Load Shedding logic usually requires high level engineering and customization utilizing PLCs.
- Ekip UP guarantees easy installation through templates and a user friendly graphic interface.

For more info check out the product note for Load Shedding - 1SDC210105D0201.



Typical load shedding application

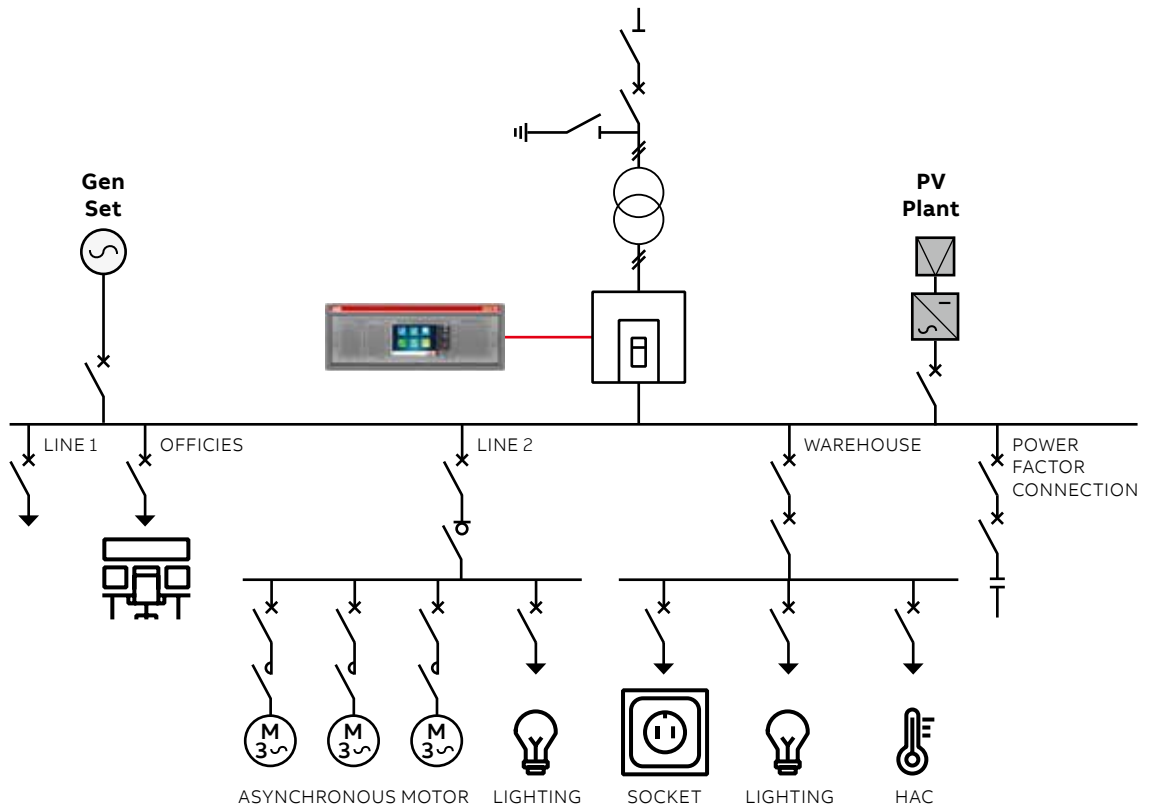

Synchrocheck logics

Ekip UP is able to analyze voltage waveforms from different power sources.

Purpose

Thanks to its advanced electronics, Ekip UP is the first smart unit able to island a Microgrid when faults or power quality events occur and reconnect to the distribution network when the conditions are right.

Synchrocheck logics operates the ANSI 25A, with possible automatic re-closing capabilities based on the synchronism status detection.


Using the Ekip Synchrocheck cartridge module, Ekip UP monitors the voltage amplitude, the frequencies and the phase displacement. Thanks to this information, it is possible to realize simple logics to adapt the Microgrid voltage and frequency to the main grid ones. This basic regulation based on up and down signals sent to the local generator controllers can be realized by Ekip Signalling contacts in order to reach synchronization. The switching device may be automatically reclosed when Ekip UP identifies that the synchronism is achieved using Ekip Synchrocheck and the closing actuator.


As an alternative, Ekip Synchrocheck can send an indication signal of synchronism achieved.

Application examples

Synchrocheck protection and logics are perfect for the following applications:

- During Microgrid reconnection to the main grid, speeding up paralleling between two systems with different steady states.
- When there is the closed transition of an automatic transfer switch, the main grid should be connected to the same busbar with the backup Microgrid generation in order to guarantee continuous load operation, with or without a bus-tie switching device.
- For single Gen Set paralleling operations.

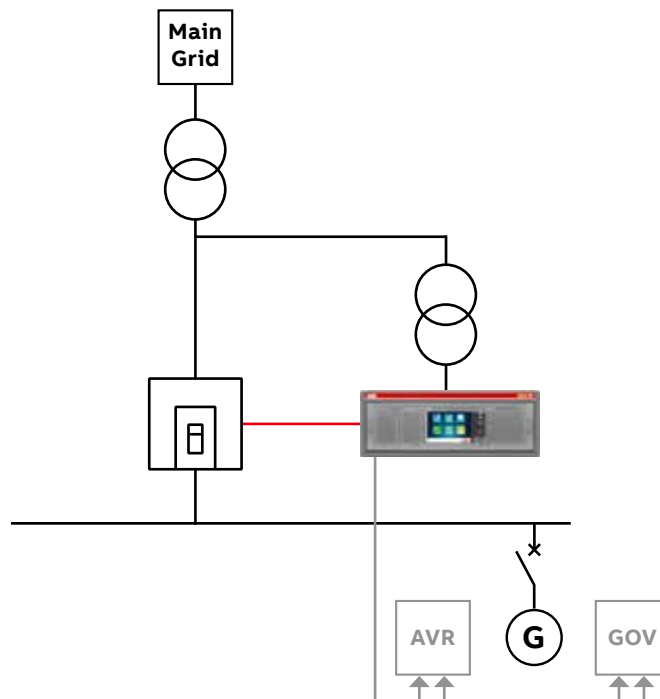

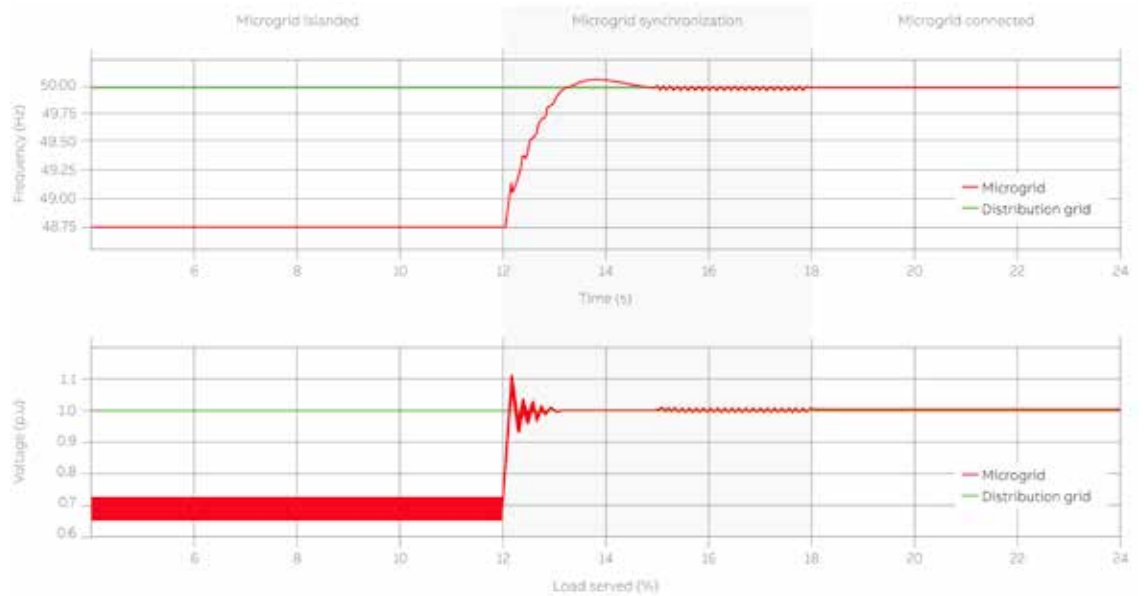

Benefits

Ekip UP with embedded Synchrocheck provides:

- A single unit, more ANSI functions
 - Components reduction with no external synchrocheck relay and less voltage transformers required if compared with traditional approaches of multiple devices.
 - Increased reliability and time saving during the installation with less cabling and related installation complexity.

Ease of use

Embedded protections and logics simplified configuration, eliminate the need for programming and engineering skills.

Power Controller


Ekip UP is able to control loads and generator to ensure bill savings and enable demand response applications according to power management strategies.

Purpose

Thanks to Power Controller software, Ekip UP manages the power to shave the peaks and shift the loads. In this way, it is possible to cut electricity bills, increase energy efficiency up to 20% and be ready for demand response programs. Power Controller function is based on a patented calculation algorithm that allows a load list to be controlled through a remote command of relevant switching device (like circuit breaker, switch disconnecter, contactor, drive) or control circuit according to a priority defined locally by the user or remotely by a load aggregator or utility, based on his own requirements and types of load.

The algorithm is based on a forecast average power absorption over a determined time interval, and is set by the user. Whenever this value exceeds the fixed power, the Power Controller function intervenes to bring it back within the limits.

This system can be realized with a single Ekip UP Control or Ekip UP Control+ standard equipped with this function and installed as the low voltage plant controller. Furthermore, the control unit, has the ability to not only control passive loads, it can also manage a reserve generator.

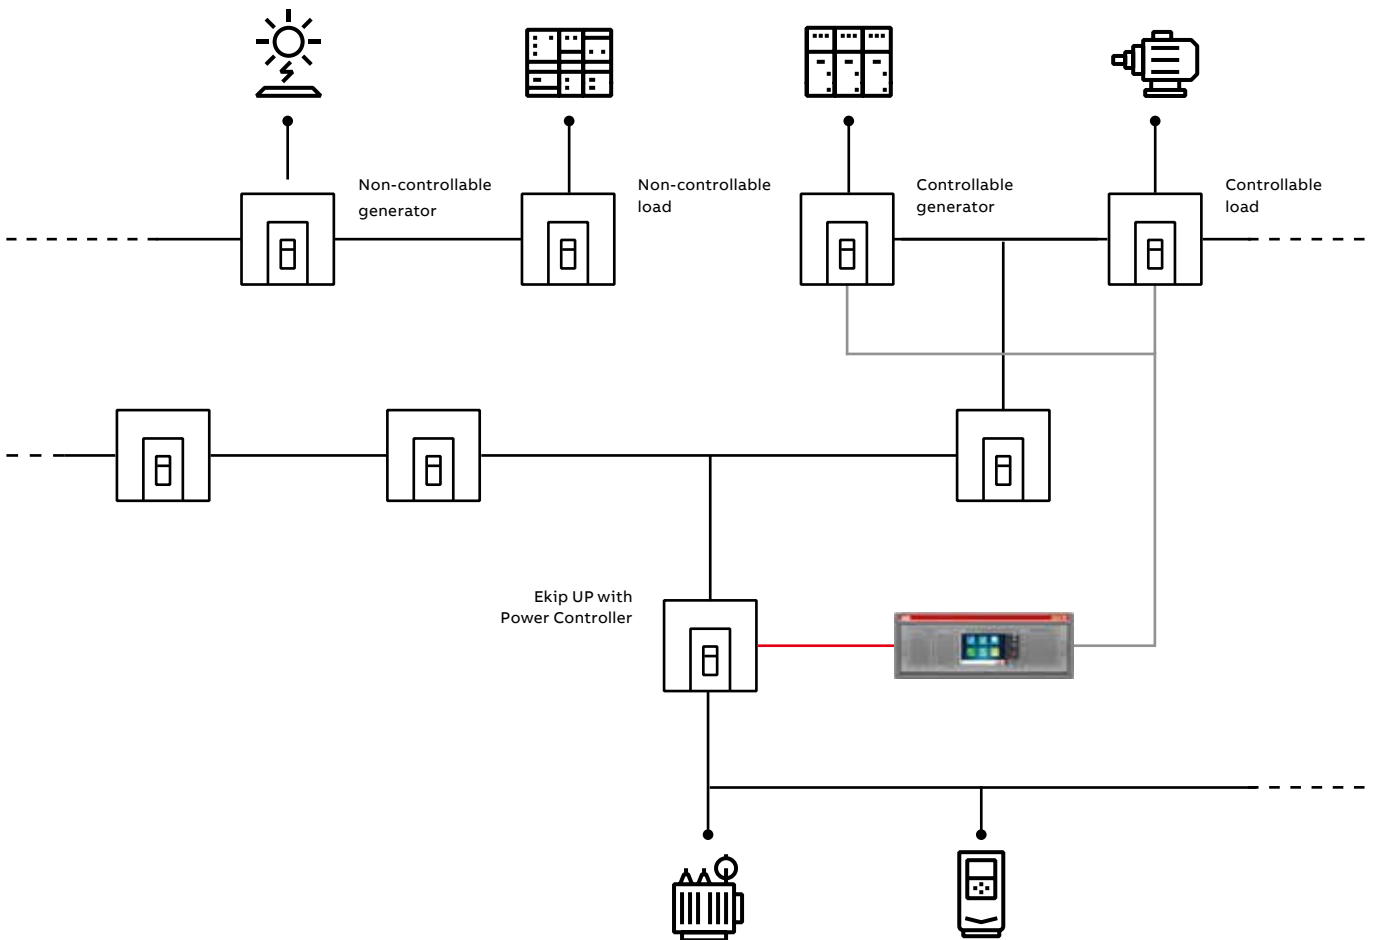

In installations that are already equipped with energy management systems, the load limit can be controlled remotely. OpenADR communication standards (see Chapter 4) provides another way to receive power set-points from load aggregators or utilities.

Loads can be controlled through two ways:

- through the wired solution, by commanding the shunt opening/closing releases or acting on the motor operators of the loads to be managed;
- through a dedicated communication system Ekip Link (see cap. 4).

The ability to control the loads according to a list of priorities already defined provides significant economical and technical advantages:

- **economical:** controlling energy consumption eliminates penalties due to excess of power absorption in respect of the contractual power set with the Utility. Indeed, in some case the Utility increases automatically the contractual power as a consequence of repeated limit excesses. Besides, Power Controller enables demand response applications, thus give the possibility to receive rebates and profits for the services offered.
- **technical:** controlling power reduces the risk of malfunctioning, ageing of system components, or worse, black outs due to plant overload. Combining Power Controller with Load Shedding ensures also the possibility to avoid protection trips, even managing the average power for economical reasons.

—

The exclusive Power Controller function available on the new Ekip UP units monitors the power, keeping it below the limit set by the user. As a result of this more effective use, the peak of power consumed can be limited, thus reducing electricity bills.

The Power Controller, patented by ABB, disconnects non-priority utilities, such as electric car charging stations, lighting or refrigeration units, during the times when consumption limits need to be respected, and connects them again as soon as it is appropriate. When required, it automatically activates auxiliary power supplies such as generator sets. No other supervision and control system is required: it is sufficient to set the required load limit on Ekip UP, which can control any switching device located downstream, even if it is not equipped with a measurement function.

Application examples

Electricity bill savings, demand response, avoiding power overload are the typical scenarios where Power Controller is adopted.

As it operates on non-critical loads, it is common in office building, shopping malls, hotels, campuses, waste and water industries or every plant that works like a low voltage Microgrid.

Power Controller

Benefits

Thanks to Ekip UP with embedded Power Controller, the following benefits are guaranteed:

- Reduction of energy costs with minimum impact.
- The loads are disconnected from the power supply as few times as possible, enabling power consumption peaks to be limited. This allows re-negotiation of electrical contracts for power allocated to reduce total energy costs.
- Power limited only when necessary. Power Controller function manages up to four different time bands, it is therefore possible to respect a particular power limit according to whether it is during the day (peak) or night (off peak). In this way, consumption during the day when rates are at their highest can be limited.
- Power Controller function allows the installation to be managed efficiently with a simple architecture. Thanks to a patented design, it can measure the total power of the installation without needing to measure the power consumed by each load. Installation costs and times are thereby reduced to a minimum.
- Power Controller function does not require the writing, implementing and testing of complicated programs like in PLC cases: the logic is built in the protection unit and ready to use. Parameters can be set simply from a smart phone or directly from the Ekip UP display.
- From the electrical system point of view, significantly helps to flatten the load curve, limiting the use of peaking power plants in favour of base load power plants with greater efficiency.
- Thanks to integrated communication modules, Power Controller can receive the maximum absorbable power directly from the Utility control system, determining consumption for the next 15 minutes. Power Controller, according to the information received, manages the switching off of non-priority loads and the switching on of reserve generators. The software gives maximum priority to preferred energy sources, such as wind and solar, and they are therefore considered uninterruptable. In the event the production of internal power to the controlled network is reduced, due, for example, to decreased production of solar power, Power Controller will disconnect the necessary loads to respect the limit set.
- This benefit is used, for example, in installations with a system of cogeneration. Power Controller controls the total consumption drawn from the electrical network, interrupting non-critical loads when production is reduced and reconnecting them when generator power is sufficient. This offers multiple advantages: reduction in energy costs, maximum use of local production and greater overall energy efficiency.

For further information, please refer to the product note for Power Controller - 1SDC210110D0201.



Commissioning and connectivity

- 4/2** Introduction
- 4/3** Commissioning Software Ekip Connect
- 4/6** Connectivity and Supervision on the field
- 4/8** Connectivity and Supervision to the cloud
- 4/10** Predictive Maintenance

Introduction

Ekip UP digital units are flexible and easy to configure to meet the supervision and control levels of each applications.

Ekip UP simplifies the business thanks to plant upgrade without new design or replacements. In addition, its commissioning is really easy leveraging free commissioning tools. Ekip Connect simplifies the user experience. Everyone can visualize energy and power quality measured by Ekip UP, set protections thresholds, configure communication and signalling modules. Even the setup of advanced software functions, like interface protection functions or load shedding logics, becomes intuitive like using an app on a laptop.

The supervision of the power grid is enabled by advanced connectivity built-in Ekip UP, with more than 3000 data points available. The low voltage plant, like Microgrid, can be monitored from the field by the integration with Scada systems leveraging on embedded up to 8 fieldbus or from the cloud, based on Internet technology. Ekip UP is able to connect low voltage switchgear to the energy management system based on Microsoft Azure cloud called ABB Ability™ Electrical Distribution Control System. Thanks to this, Ekip UP is the single unit that digitalizes every gear, even existing ones.



Commissioning Software

Ekip Connect

Ekip Connect is a free tool which optimizes Ekip UP's ability to manage power, acquire and analyze electrical values, and test protection, maintenance and diagnostic functions.

Overview of the software

An overview of the software available and their main characteristics are given below:

Software	Functions	Distinctive characteristics
Ekip Connect	<ul style="list-style-type: none"> - commissioning - analysis of faults - testing of communication bus 	<ul style="list-style-type: none"> - simple and intuitive use - integrated with DOC electrical design software - useable via EtherNet™ - automatic updating from Internet - off-line mode - multi-media (tablet or PC)

Most of the configurations are available from Ekip UP intuitive touchscreen display. Either way the ABB programming and commissioning Ekip Connect software tool allows the user to unlock the full potential of Ekip UP, having a user-friendly graphic interface and saving all project settings. From commissioning to implementation, through monitoring, testing and analysis, Ekip Connect is the perfect tool for guiding the user in the management of ABB devices throughout the whole product life cycle.

Using Ekip Connect, the user can manage power, acquire and analyze electrical values, and test protection, maintenance and diagnostic functions. Ekip UP units can be connected to the laptop, PC or tablet simply using the mini-USB interface port with Ekip Programming or Ekip T&P accessories. Other possibility is to scan the unit from the communication network where integrated. By this tool protection configuration and testing are available.

Commissioning Software

Ekip Connect

—
Panel builders
- 50% commissioning time




Ease of use

Imagine you are a panel builder. You have to commission a switching device and you need to save time. You can! Using Ekip Connect it is possible to cut commissioning time by up to 50% instead of doing it manually. Providing a stress-free relationship with the device complexity, Ekip Connect is an easy-to-use software that has all the answers.

Ekip Connect's simple and intuitive interface means that, from the very start, it is possible to easily navigate through the tool and access every switching device operation. At a glance, the user can see all the information he needs, giving him the possibility to quickly and effectively assess any situation.

—
Facility manager
100% full exploitation of your device



Full exploitation

Imagine you are a facility manager. You need to perform fast and precise diagnosis in order to have everything under control and avoid failures. You can! Using Ekip Connect you can exploit the full capabilities of your device and thanks to the customizable dashboard you can organize your window into the deepest functions of the device just the way you want it. It is possible to manage all the CB settings and specifications directly with Ekip Connect, making it the perfect instrument for exploring and using the breaker.

Diagnostics are easy too: It is possible to consult and download the log of events, alarms and unit trips, thereby facilitating the identification and understanding of any anomalies.

One single software able to manage all ABB low voltage devices, giving a full integration.

—
Consultant/system integrator
Complex logic at your fingertips



Product enhancement

Imagine you are a consultant or a system integrator and you want to implement advanced features while avoiding the risk of any error. You can! Using Ekip Connect it's possible to implement complex logic with a few clicks of your mouse.

To add, set and manage advanced functions has never been so easy. Automatic transfer switch logic, load shedding, advanced protection and demand management can be managed and easily set through the Ekip Connect software.

Expand software features by purchasing and downloading software packages for advanced functions directly using Ekip Connect.

Accessing the full potential of the switching device is finally possible. Thanks to Ekip Connect software, you can achieve complete utilization of the unit and more with a few clicks of your mouse.



Configuration

- Set protections
- Configure system and communication parameters
- Unit start-up



Monitoring & analysis

- View CB status and measure
- Read events list



Product implementation

- Set advanced protections
- Logic activation
- Enable advanced functions

Test




Testing & reporting

- Check correct functionality
- Perform tests
- Export report

For more information please refer to the product note for Ekip Connect - 1SDC210102D0201.



Ekip Connect is available for free download at <http://www.abb.com/abblibrary/Download-Center/>

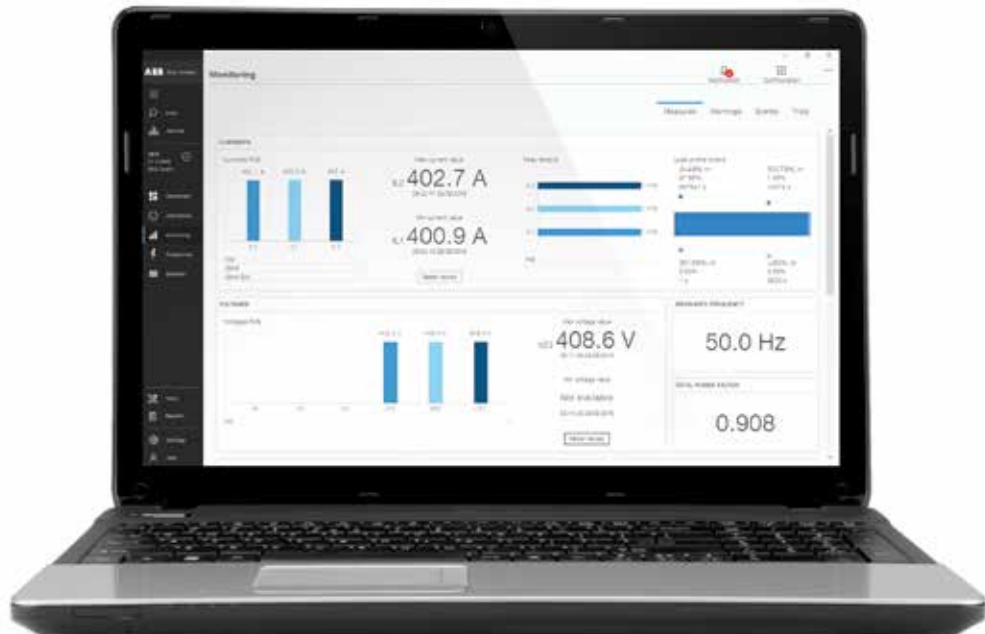

Connectivity

Supervision on the field

The integration of low voltage devices in fieldbus communication networks is perfect for automated industrial processes, industrial and petrochemical sites, modern data centers and intelligent electricity networks, better known as Microgrids or Smart Grids.

Ekip Com Modules


Thanks to the wide range of communication protocols, Ekip UP can be integrated into communication networks without the need of external interface devices.

The distinctive characteristics of the Ekip UP offering for industrial communication are:

- **A wide range of supported protocols:** the Ekip Com communication modules enable integration with the most common communication protocols based on RS485 serial lines and the most modern communication systems based on EtherNet™ infrastructures, which guarantee an exchange of data in the order of 100 Mbit/s.
- **Installation times reduced to a minimum** due to the plug & play technology of the communication modules.
- **Redundancy of communication for greater reliability of the system;** the unit can be equipped with two communication modules of the same protocol at the same time, thus allowing information to be exchanged simultaneously on two buses.
- **More protocols available at the same time,** like Modbus TCP/IP for BMS, Profinet for PLC and IEC 61850 for Scada.

Having advanced protocol connectivity, Ekip UP is ready for:

- **interaction with medium voltage grid:** the Ekip Com IEC61850 module is the solution for integrating Ekip UP into automated electrical substations based on the IEC 61850 standard without external devices. Ekip UP offers both input and output goose capabilities making communication with MV relays easy for selectivity and interlocking logics.
- **Demand response programme:** the Ekip Com OpenADR module enables Ekip UP to exchange data-reports with load aggregators and utilities as well receive power set point to be managed. Based on Internet wireless technology, the OpenADR standard certifies cybersecurity.
- **Power automation logics:** Ekip Link is based on proprietary ABB bus that ensures robustness granted by third party and unlock control capability in low voltage plants.
- **Manage I/O based on protocols** to execute opening and closing commands to switching devices from external supervision system.

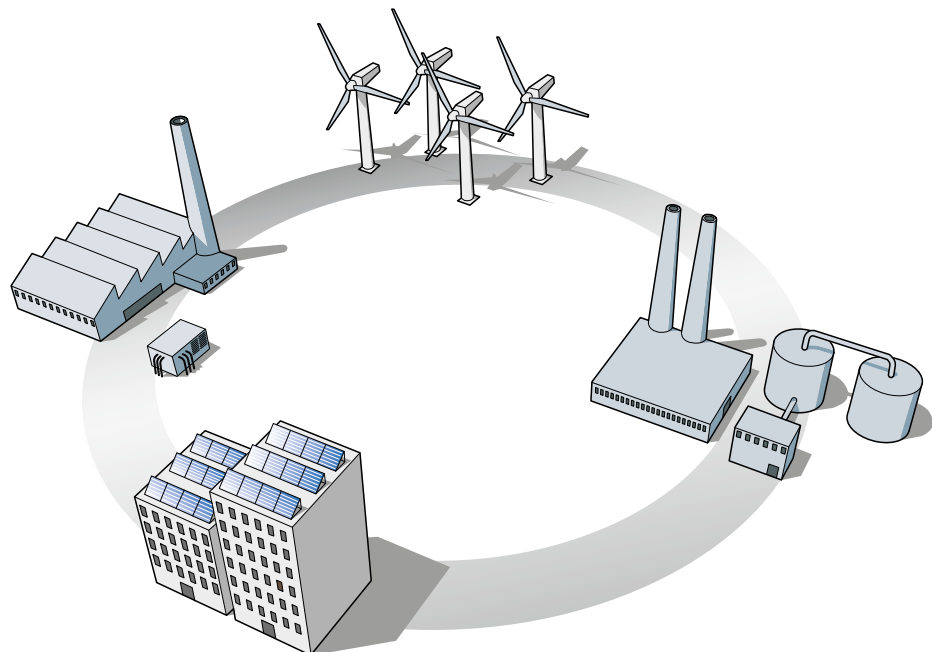

Fiedbus supervision of the electrical installation		
Ekip UP range	Monitor/Control	Protect/Protect+/Control+
Protocols supported:		
Modbus RTU	Ekip Com Modbus RTU	
Profibus-DP	Ekip Com Profibus	
DeviceNet™	Ekip Com DeviceNet™	
Modbus TCP/IP	Ekip Com Modbus TCP	
Profinet	Ekip Com Profinet	
EtherNet/IP™	Ekip Com EtherNet™	
IEC61850	Ekip Com IEC61850	
Open ADR	Ekip Com OpenADR	
ABB bus	Ekip Link	
Control functions		
Switching devices opening and closing	●	●
Measurement functions		
Currents	●	●
Voltages	●	●
Powers	●	●
Energies	●	●
Harmonics	●	●
Network analyzer	●	●
Data logger	●	●
Adjustment functions		
Setting of thresholds		●
Resetting of alarms		●
Diagnostic		
Protection function alarms		●
Device alarms	●	●
Protection unit tripping details		●
Events log	●	●
Protection unit tripping log		●
Other data		
Local/remote mode	●	●

For more information, please refer to the product note for the Communication - 1SDC210101D0201.



Connectivity

Supervision to the cloud

ABB Ability™ Electrical Distribution Control System is the innovative cloud-computing platform designed to monitor, optimize and control the electrical system.

Part of the ABB Ability™ offering, ABB Ability™ Electrical Distribution Control System is built on a state-of-the-art cloud architecture for data collection, processing and storage. This cloud architecture has been developed together with Microsoft in order to enhance performance and guarantee the highest reliability and security. Through a compelling web app interface, ABB Ability™ Electrical Distribution Control System assists anytime and anywhere via smartphone, tablet or personal computer so the user can:

- **Monitor**
Discover plant performance, supervise the electrical system and allocate costs to improve productivity and efficiency.
- **Optimize**
Schedule and analyze automatic reports, improve the use of assets and take the right business decision.
- **Predict**
Suggest the best maintenance date and reliability curve of installed assets based on real conditions to ensure opex savings.

- **Control**
Set up alerts and notify key personnel, and remotely implement an effective power management strategy to achieve energy savings in a simple way.


The user can choose Ekip Com Hub module plugged into Ekip UP units to connect the switchgear into the cloud. ABB Ability™ Electrical Distribution Control System immediately connects to the low-voltage power distribution panel with plug and play devices:

- Air circuit breakers
- Molded-case circuit breakers
- Miniature circuit breakers
- Metering devices
- Switches and fusegears
- Arc-guard devices
- Soft starters
- Low voltage or medium voltage relay

Ekip UP solution with Ekip Com Hub

Ekip UP equipped with Ekip Com Hub cartridge module establishes the cloud connection for the whole switchboard. This dedicated cartridge type communication module just needs to be inserted into the terminal box and connected to the internet using an external router.

For more information, please visit <http://new.abb.com/low-voltage/launches/abb-ability-edcs>.

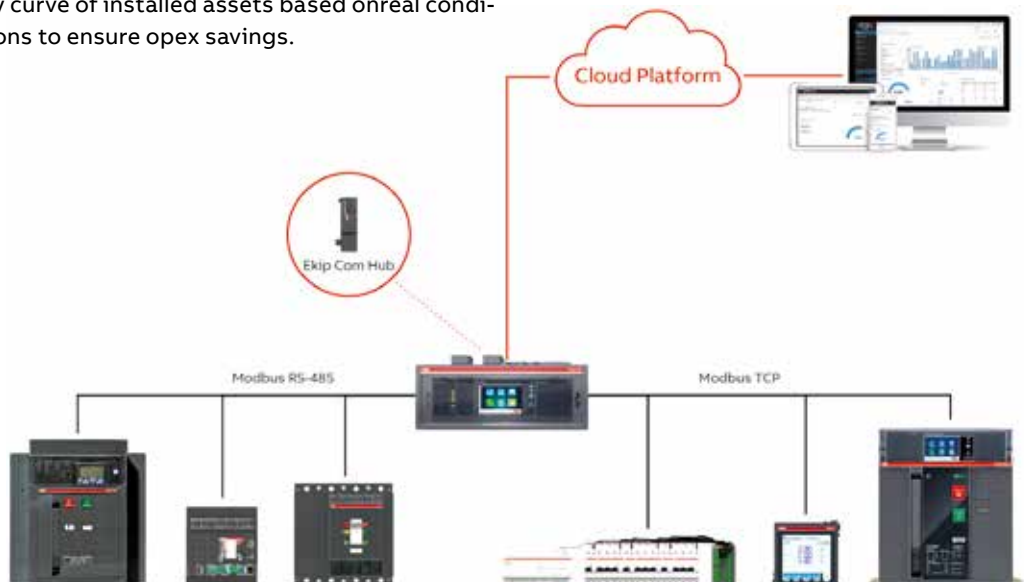





Predictive Maintenance

Energy & Assets Management improves efficiency and reliability

In addition to safety protections and energy management, Ekip UP predicts the future of installed ABB assets. The digital unit enables the predictive maintenance function on existing circuit breakers or switch disconnectors available in the cloud-based platform ABB Ability™ EDCS. Measuring directly the operation number, contact wear, current flowing in steady state and protection trip (overload., short circuit, earth faults),

the environmental factors (temperature, humidity, corrosion, dust level and vibrations) and thanks to the know how of ABB switching devices, the algorithm in ABB Ability EDCS provides the device reliability curve and suggests the next maintenance date.

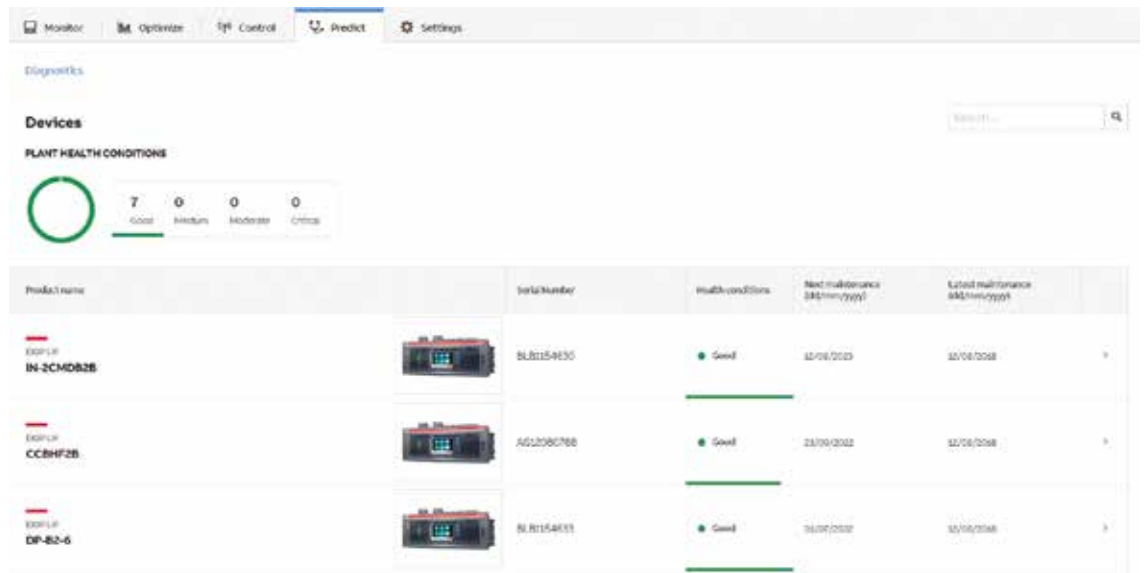

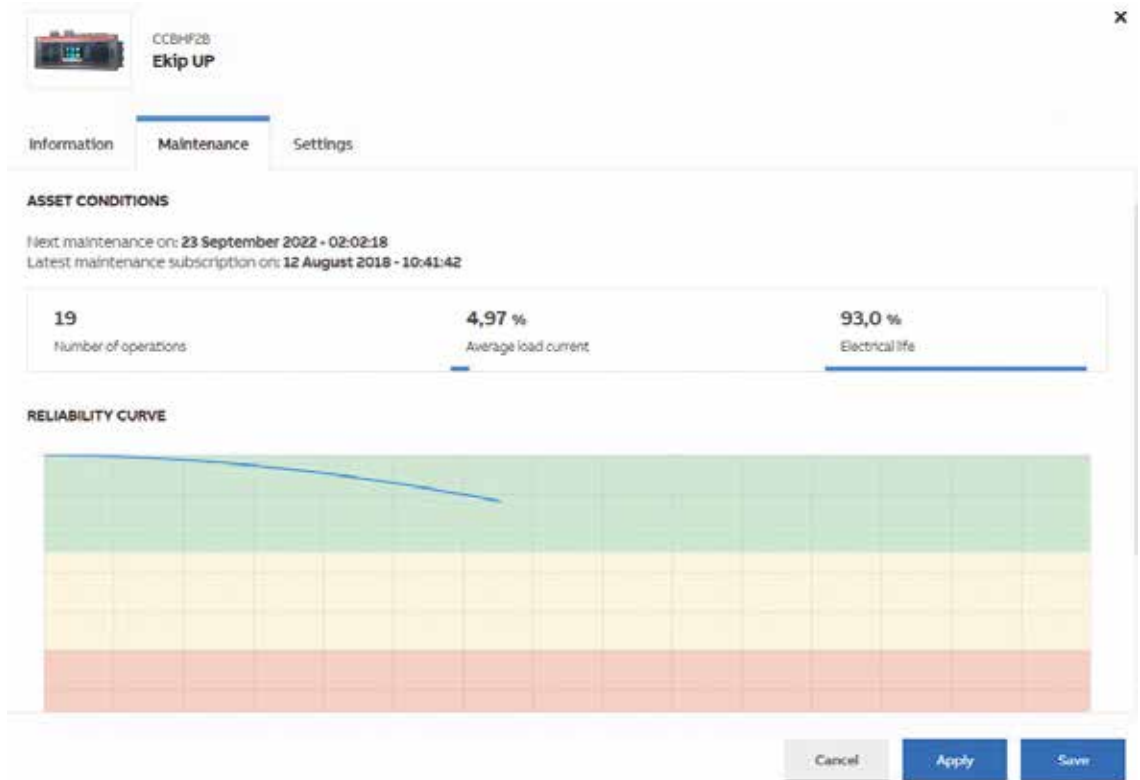

The tool shows also the date of latest maintenance available in the device. Clicking on every single device, the reliability curve shows the historical trend of the product up to now. Maintenance performed at the right time by ABB Authorized field service engineers has a positive influence on product health trends. With the right ABB training (ABB MAN or ABBL L2 or L3), the proper tools and genuine spare parts extending the working life of installations is simple. When latest maintenance is performed by not ABB authorized personnel, there is not effect on the reliability curve.

When an important event occurs to influence the next maintenance date, an automatic notification is sent. ABB Ability EDCS's Predict feature for Ekip UP digital units enables users to optimize their power availability with targeted maintenance for both standard and critical applications, while maintaining. This function is coming soon in Ekip UP Protect, Protect+ and Control+ versions when applied with ABB New Emax and Emax 2 or GE Entelliguard devices.



Improve service profitability by optimizing maintenance costs



Extend product life by optimizing performance



Manage and connect from anywhere thanks to the ABB Ability ECDS Cloud based platform



Increase safety for devices and personnel by reducing the risk of unexpected shutdowns

Accessories

- 5/2** **Ekip UP standard supply**
- 5/3** **Accessories for Ekip UP units**
- 5/3** **Power supply**
- 5/4** **Connectivity**
- 5/5** **Signalling**
- 5/6** **Measurements and protection**
- 5/8** **Current sensors**
- 5/9** **Testing and programming**
- 5/10** **Service**

Ekip UP standard supply

ABB Ekip UP comes standard with four input/output contacts and a measuring module for voltage metering. A rating plug needs to be selected during ordering and factory installed (see Chapter 8).

—
(1) Type A are provided with a pallet packaging due to weight.

Ekip UP is made in Italy and comes packaged with:

- Mounting clips (DIN-rail, door-mounted), terminals and insertion bridge for voltage sockets. This is useful in the applications in which voltage measurements are not strictly required.
- Mandatory accessory
 - Current sensors in the different types available ⁽¹⁾
 - Cable kit
 - Power supply module
- Optional accessory
 - Cartridge module for connectivity, signaling, synchrocheck
- Getting Started and module Kit Sheet

The content of the package is visible from the ordering label.

Other accessories are packaged separately. Each Ekip UP is provided with a production report to maintain complete traceability of the product, with primary current injection tests executed from factory.

Ekip UP packaging is transit tested by ISTA. QR code printed there enables the access to product global web-site.



Accessories for Ekip UP units

All Ekip UP accessories are plug& play, they come pre-configured for easy installation.

Installation	Modules	Highlights
Terminal box	Cartridge modules: - Ekip Com - Ekip Link - Ekip 2K - Ekip Supply - Ekip Synchrocheck - Ekip 3T	<ul style="list-style-type: none"> - The Ekip Supply module enables the trip units to be supplied with a range of DC control voltages - The Ekip Supply module is a mandatory accessory. - The Ekip Supply module has a dedicated position in the installation area in the terminal box; the other modules can be installed as desired in the positions available - Up to 4 additional modules, among Ekip 2k, Ekip 3T, Ekip Com and Ekip Synchrocheck, can be installed together with Ekip Supply. Up to 3 Ekip 2k can be used.
Accessorizing area	Ekip Measuring Ekip Signalling 4K Rating Plug Battery for Ekip	<ul style="list-style-type: none"> - These are installed in specific housings - Ekip Measuring module is all time provided with Ekip UP units and enables voltage measurements, directly or using voltage sensors. - Ekip Signalling 4k, standard supplied, makes the interface of Ekip UP units for protection easy with switching devices or switch-disconnectors. As 4 digital I/O, these can be used also for signalling based on event, increasing the remote signalling possibilities, or activating internal logics. - In Ekip UP Protect, Protect+ and Control+ versions the I/O contacts enable opening and closing commands of switching devices as well as status feedbacks. - Ekip UP from the factory installed own rating plug according to plant rated current. It is possible to change it, even after the installation according to new requirements (for example, plant extension). - Internal battery enables the cause of the fault to be indicated after a trip, without a time limit. In addition, the battery enables date and time to be updated, thus ensuring the chronology of the events.
Ekip trip unit test port	Ekip T&P Ekip TT	<ul style="list-style-type: none"> - These accessories can be connected to the front test port of the trip units even with the device in operation to perform commissioning activity on Ekip Connect. - Compatible also with the SACE Tmax XT and SACE Emax 2 ranges.
External	Ekip 10K Ekip Signalling Modbus TCP Homopolar toroid Differential toroid	<ul style="list-style-type: none"> - Several Ekip Signalling 10K can be connected at the same time to the same Ekip UP units using local bus or ABB Ekip Link bus based on ethernet. - This DIN-rail distributed I/O allow open/closed contacts to be received by Ekip UP in the cloud architecture. - These are connected to the trip unit by the terminal box of the Ekip UP to perform Rc (differential earth fault) and Gext (source ground fault, also for restricted/unrestricted earth fault diagnosis) protections.



Fig. 1

Power supply

Ekip Supply module (Fig.1)

The Ekip Supply module supplies all Ekip UP units and modules present on the terminal box of the digital unit with DC auxiliary power available in the switchgear.

The module is mounted in the terminal box and permits the installation of the other advanced modules. It is installed at the first installation of the device.

The available module is:

- Ekip Supply 24-48V DC

Electrical diagram reference: figures 31, 32

Accessories for Ekip UP units



Fig. 2

Connectivity (Fig.2)

The Ekip Com modules enable all Ekip UP units to be integrated in an industrial communication network for remote supervision and control of the circuit-breaker. They are suitable for all Ekip UP versions. Several Ekip Com modules can be installed at the same time, thereby enabling connection to communication systems that use different protocols.

The Ekip Com modules for Modbus RTU, Profibus-DP and DeviceNet™ contain a terminating resistor and dip switch for optional activation to terminate the serial network or bus.

The Profibus-DP module also contains a polarization resistor and dip switch for its activation.

For industrial applications where superior reliability of the communication network is required, the Ekip Com R communication modules, installed together with the corresponding Ekip Com modules, guarantee redundant connection to the network.

The Ekip Com modules enable Ekip trip units to be connected to networks that use the following protocols:

Protocol	Ekip Com Module	Ekip Com Redundant Module
Modbus RTU	Ekip Com Modbus RS-485	Ekip Com R Modbus RS-485
Modbus TCP	Ekip Com Modbus TCP	Ekip com R Modbus TCP
Profibus-DP	Ekip Com Profibus	Ekip Com R Profibus
Profinet	Ekip Com Profinet	Ekip Com R Profinet
EtherNet/IP™	Ekip Com EtherNet/IP™	Ekip Com R EtherNet/IP™
DeviceNet™	Ekip Com DeviceNet™	Ekip Com R DeviceNet™
IEC61850	Ekip Com IEC61850	Ekip Com R IEC61850
Open ADR	Ekip Com OpenADR	-
Cloud connectivity	Ekip Com Hub	-

Electrical diagram reference: figures from 51 to 59. Redundant version from 61 to 67.



Fig. 3

Ekip Link Module (Fig.3)

The Ekip Link module enables the Ekip UP units to be connected to ABB communication system for power automation logics, like Power Controller, ATS or load shedding logics.

It is suitable for all Ekip units and can be factory or field installed in the device terminal box, even when Ekip Com communication modules are present. In this way, it is possible to have a complete supervision of the system by means of the Ekip Com modules connected to the communication network.

Electrical diagram reference: figure 58



Fig. 4

Ekip Com Hub (Fig.4)

Ekip Com Hub is the new communication module for Ekip UP cloud-connectivity.

Ekip UP equipped with Ekip Com Hub can establish the direct connection to ABB Ability™ Electrical Distribution Control System for the whole low-voltage power distribution panel. This dedicated cartridge-type communication module just needs to be inserted into the terminal box and connected to the internet.

For further information related to ABB Ability™ Electrical Distribution Control System, please see Chapter 4.

Electrical diagram reference: figures 59



Fig. 5

Ekip Com OpenADR (Fig. 5)

Ekip Com OpenADR is the latest communication module for Ekip UP that become ready for demand response applications. In compliance with OpenADR profile 2.0b, thanks to this module, Ekip UP becomes the virtual end node of demand response, communicating directly with utilities or load aggregators virtual top nodes, in order to change power flow setpoints of the low voltage plant and send reports with metering data.



Fig. 6

Signalling

Ekip 2K Signalling modules (Fig.6)

The Ekip 2K Signalling modules supply two input and two output contacts for control and remote signalling of alarms and switching device status/trips. They can be programmed from the unit's display or through Ekip Connect software. Furthermore, when using Ekip Connect, combinations of events can be freely configured. They are suitable for all Ekip UP versions. Three versions of the Ekip 2K Signalling modules are available: Ekip 2K-1, Ekip 2K-2, Ekip 2K-3.

Electrical diagram reference: figures 41, 42, 43



Fig. 6A

Ekip 3T Signalling (Fig.6A)

The Ekip 3T Signalling modules supply three analog inputs for thermo-resistances PT1000 and one analog input 4-20mA for external sensors (for example, gas/humidity meters). These input data are available in the digital unit. Through the Ekip Connect software is possible to set different thresholds and link them to digital signals. Up to two cartridge module can be installed in the same unit. PT1000 sensors are available as options. The Ekip 3T Signalling modules are suitable for all Ekip UP versions.

For more information, please refer to the product note for Ekip Signalling 3T - 1SDC210109D0201.



Fig. 7

Ekip 4K signalling module (Fig.7)

The Ekip 4K Signalling module, available as standard in all Ekip UP units, supplies four digital input contacts and four digital output contacts for control and remote signalling. Related to the contact, green led lights are available from the front of the unit. It can be programmed from the touchscreen display or through the Ekip Connect software.

Furthermore, when using Ekip Connect, combinations of events can be freely configured.

The terminals are provided in the package of Ekip UP. In Ekip UP Protect/Protect+/Control+ versions, there is this configuration to be ready for protection:

Ekip Signalling 4k	Ekip UP Protect/Protect+/Control+
4k.Out1	open command
4k.Out2	close command*
4kIn.1	open status**
4k.In2	closed status**

* possible change to normal use with Ekip Connect

** possible change to normal use or with 4K. In2 for close status with Ekip Connect

The signalling contact switching time is 7ms max.

It is possible to connect directly the open and closing contacts to actuators on switching devices.

These can be opening or, where possible to program external trip function, trip coil to open the switching device and closing coils or motor operators to close it. The time to open the switching device is the sum of protection trigger (depending on timing settings), contact switching time and switching device opening time through opening or trip coil. If needed, a dedicated contact can be programmed to open the switching device through under-voltage coil. If the actuators inrush power requested exceeds the value listed below, it is necessary to use auxiliary relays.

Rated Voltage [V]	Inrush Power [W/VA]
30 Vdc	60
50Vdc	40
150Vdc	30
250Vac	1000

For more details, please refer to dedicated manual, doc. 1SDH002003A1001.

Electrical diagram reference: figure 20A, 20B

Accessories for Ekip UP units



Fig. 8

Ekip 10K signalling unit (Fig.8)

Ekip 10K Signalling is an external signalling unit designed for DIN rail installations for Ekip UP distributed I/O. The unit provides ten contacts for electrical signalling of timing and tripping of protection devices. If connected via Ekip Connect software, the contacts can be freely configured in association with any event and alarm or combination of both.

The Ekip 10K Signalling module can be powered either by direct or alternating current and can be connected to all the units via internal bus or Ekip Link modules.

Several Ekip 10K Signalling can be installed at the same time on the same Ekip unit; max 3 by local bus, according to Ethernet band rate if using Ekip Link architecture.

Electrical diagram reference: figure 103



Fig. 9

Ekip Signalling Modbus TCP (Fig.8)

It is an external signalling unit designed for DIN rail installations. Function of the signalling module is to share - via an Ethernet network with Modbus TCP communication protocol - information about the state of other switching devices that might not have the ability to provide such information via Ethernet, and also to allow these products to be operated via remote control.

Characteristics of output contacts		Number of contacts		
Type	Monostable	Ekip 2K	Ekip 4K	Ekip 10K
Maximum switching voltage	150V DC / 250V AC			
Maximum switching current				
	30V DC			
	50V DC	2 output + 2 input	4 output + 4 input	10 output + 11 input
	150V DC			
	250V AC			
Contact/coil insulation	1000 Vrms (1min @50Hz)			

Ekip 10K signalling unit power supply

Auxiliary supply	24-48V DC, 110-240V AC/DC
Voltage range	21.5-53V DC, 105-265V AC/DC
Rated power	10VA/W
Inrush current	1A for 10ms

Measurement and protection

Ekip Measuring module (Fig.10)

The Ekip Measuring module enables the unit to measure the phase and neutral voltages, power and energy. The Ekip Measuring module is always installed on the front, right housing of the units, without having to remove the touchscreen display itself. The voltage busbars can be connected to the Ekip Measuring four input sockets according to scheme in Chapter 7:

- directly with insulation requirements according to IEC 61010 and UL508 Standards
- using single-phase voltage transformers to comply with IEC 60255-27 Standard for protective relays with these specifications
 - secondary voltage rating 100:√3
 - precision class 0.2
 - power absorpction 4VA

The module must be disconnected during the dielectric withstand tests on the main busbars.

Electrical diagram reference: figures 11, 12, 13, 14



Fig. 10



Fig. 11

Ekip Synchrocheck (Fig.11)

This module enables the control of the synchronism condition when placing two lines in parallel enabling ANSI 25. The module can be used with Ekip UP Protect/Protect+/Control+.

Ekip Synchrocheck measures the voltage values on two phases of one line through an external transformer and compares them to the measured voltages at Ekip UP. An output contact is available, which is activated upon reaching synchronism, and enables the switching device interfaced to be closed by means of wiring with the closing coil.

Characteristics of output contacts		Number of contacts
Type	Monostable	Ekip Synchrocheck
Maximum switching voltage	150V DC / 250V AC	
Maximum switching current		
30V DC	2A	1 output
50V DC	0.8A	
150V DC	0.2A	
250V AC	4A	
Contact/coil insulation	1000 Vrms (1min @50Hz)	

Electrical diagram reference: figure 44

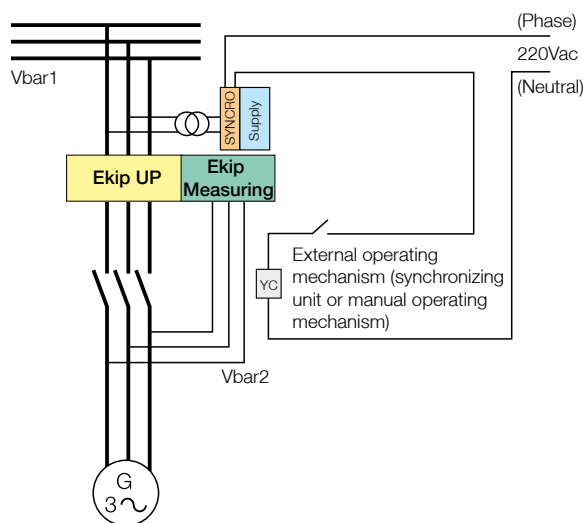


Fig. 12

Rating Plug (Fig.12)

The rating plugs are field-interchangeable from the front on all units and enable the protection thresholds to be adjusted according to the actual rated current of the system. Rating Plug is a mandatory accessory for Ekip UP units, but can be purchased also as loose accessory.

This function is particularly advantageous in installations that may require future expansion or in cases where the power supplied needs to be limited temporarily (e.g. mobile Gen Set).

Digital unit	Rating plugs available
Ekip UP all versions	100-200-250-400-600-630-800-1000-1200-1250-1600-2000-2500-3000-3200-3600 -4000 5000-6000-6300

Special rating plugs are also available for differential protection against earthing faults in combination with a suitable toroid to be installed externally.

Digital unit	Rating plug available for Rc protection
Ekip UP all versions	100-200-250-400-600-630-800-1000-1200-1250-1600-2000-2500-3000-3200-3600 -4000

Accessories for Ekip UP units

Current sensors

Current sensors for three/four lines

Ekip UP units have four types of current sensors' technology suitable that are included in the package as mandatory configured accessories. The current sensor can be ordered as loose accessories only for replacement or changing from 3 poles to 4 poles reasons. Except insertion bridges, being based on Rogowski technology, without core-saturation effect, they guarantee high flexibility, huge range linearity, from few Amps to hundred kAmps without frequency limit, and easy detection of quickly current variations as well as harmonic contents. Ekip UP has a compact solution for every situation, available both for 3 or 4 poles. 3 meters of cable enable the connection in every switchgear, maintaining EMC performances. A specific getting started explains the installation procedure.

- **Type A (Fig.13)** This type is a closed sensor with copper terminals for busbars. Type A current sensors are recommended for new plants to optimize current capacity in the reduced space inside the switchgear. Type A current sensors have a dedicated label for phase and polarity, so as to get an easy installation. They are calibrated directly from the factory with also primary injection tests done.
- **Type B (Fig.14)** This type is a closed sensor without copper terminals inside. Type B current sensors are recommended as a cost-effective solution for new and existing electrical systems, especially with cable connections. As Type A, also type B current sensors has a dedicated label for phase and polarity as well as the same calibration procedure.
- **Type C (Fig.15)** This type is a plug-in sensor, very light and flexible so to be installed even in small spaces and suspended on measured conductor, with no external power supplier required. Type C current sensors are typically used in old switchgear, as they can be added even without shutdown if the technician can work under voltage condition according to local standards. The installation time is less than 80% compared to traditional current transformers and there is no need to disconnect cables or busbars thanks to the split-core. They have a dedicated printed label for polarity indication. The busbars or cables can be positioned using dedicated devices.

The following table summarize main performances as examples of connections for cables or busbars.

Electrical diagram reference: figure 17, 18

Current Sensors				
Description	d X D [mm]*	In max [A]	Example of connections	
Type A closed sensors with junction copper	50,3 x 77	2000	Busbar [mm]	2x80x10
	60 x 89	4000	Busbar [mm]	4x100x10
Type B closed sensors	29,6 x 56	400	Cable [mm]	1 x 1 x 10,5
	60 x 89	1600	Cable [mm]	2 x 2 x 11
	57x89	2500	Busbar [mm]	2 x 60 x 10
Type C open sensors	100 x 112	4000	Cable [mm]	2 x 60 x 10
	120 x 132	4000	Busbar [mm]	2 x 100 x 10
	200 x 212	4000	Busbar [mm]	4 x 100 x 10
	290 x 302	6300	Busbar [mm]	6 x 100 x 10

*d: internal diameter - D: main external dimension

- **Type D (Fig.16)** This type refers to insertion bridges for current sockets that can be used in the applications in which current sensors are not strictly required, for example for Interface Protection System (IPS) or special gateway applications. Four insertion bridges are provided for each phase current that can be excluded. Configured with insertion bridges, Ekip UP is ready to be used with Type C 100 or Type C 120 current sensor kits, 3 or 4 poles.

Positioning device (Fig. 17)

Thanks to this device, positioning of busbars and cables with type C current sensors becomes easier, as no other ties or equipments are needed. It is compatible with busbar connection up to 2x80x10 [mm].



Fig. 13



Fig. 14



Fig. 15




Fig. 16



Fig. 17



Fig. 18

Homopolar toroid for the earthing conductor of main power supply (Fig.18)

Ekip UP Protect/Protect+/Control+ can be used with an external toroid positioned, for example, on the conductor that connects the star center of the MV/LV transformer to earth (homopolar transformer): in this case, the earth protection is called Source Ground Return. There are four sizes of the toroid: 100A, 250A, 400A, 800A. The homopolar toroid is an alternative to the toroid for differential protection.

—
Electrical diagram reference: figure 25



Fig. 19

Toroid for differential protection (Fig.19)

Connected to the Ekip UP Protect/Protect+/Control+ equipped with a rating plug for differential protection, this toroid enables earth fault currents of 3...30A to be monitored. To be installed on the busbar system, it is an alternative to the homopolar toroid.

—
Electrical diagram reference: figure 24, 24A

Testing and programming

Ekip TT testing and power supply unit (Fig.20)

Ekip TT is a device that allows you to verify that the Ekip UP opening and closing contacts based on protection trip mechanism is functioning correctly (protection test).

The device can be connected to the front test connector of any touchscreen display of Ekip UP; trip test can be also performed with auxiliary supply using the dedicated section in the touchscreen display without this accessory.



Fig. 20

Ekip T&P testing kit (Fig.21)

Ekip T&P is a kit that includes different components for programming and testing the electronic protection trip units. The kit includes:

- Ekip T&P unit;
- Ekip TT unit;
- USB cable to connect the T&P unit to the Ekip units;
- installation CD for Ekip Connect and Ekip T&P interface software.

The Ekip T&P unit is easily connected from your PC (via USB) to the unit (via mini USB) with the cable provided. The Ekip T&P unit can perform simple manual or automatic tests on the unit functions. The Ekip T&P will also provide the ability to conduct more advanced function configuration that allows the addition of harmonics and the shifting of phases to more accurately represent the real conditions of an application. Thus, setting of more suitable protection functions usually required for critical applications becomes easier. Ekip T&P can also generate a test report as well as help you to monitor maintenance schedules.



Fig. 21

Ekip Programming Module (Fig.22)

The Ekip Programming module is used for programming Ekip units from your PC via USB using the Ekip Connect software that can be downloaded on-line. This can be useful for uploading/ downloading entire sets of parameters for multiple switching devices both for set-up as well as for maintenance (for a periodical back-up of the protection parameters in case of a catastrophic situation).

For more details about Ekip Connect, please see Chapter 4.



Fig. 22

Service



Extended warranty

For ABB Low Voltage digital unit, extending the 1-year standard factory warranty to up to 5 years has never been so simple.

Extended warranty activation can be requested after the online registration in the Extended Warranty tool. This web-tool verifies that the application of the digital unit is within the recommended guidelines, and grant the registration of the Ekip UP.


When end users details are registered, one year of extra warranty is offered free-of-charge.

Extended Warranty can be ordered by following the steps:

- 1) Registration in the online tool (Extended Warranty Tool) to verify the application.
- 2) Extended Warranty part number(s) and registration code received by email
- 3) Place the order of the digital unit together with:
 - Extended warranty part number(s)
 - Unique registration code

Warranty coverage:

- Any possible issues related to circuit breaker quality for the complete extra warranty time
- Accessories mounted by the factory only.

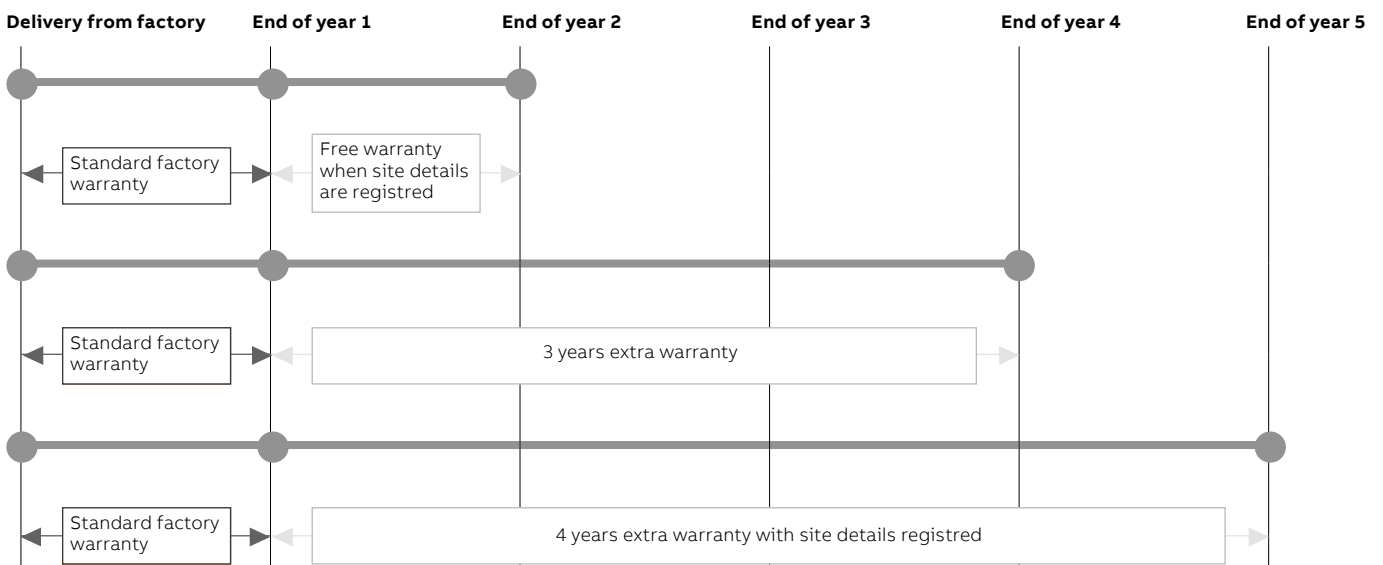

Dimensions

6/2 **Ekip UP unit dimensions**

6/7 **Current sensor dimensions**

Ekip UP unit dimensions





Ekip UP is a plug & play unit that ensures easy installation, even adding current and voltage sensors wherever wanted in the plant layout.

Ekip UP can be door-on rail mounted, fitting all the requirements either in power distribution or either in process automation. DIN-rail mounting option is also very useful when it is better not to occupy space on the front doors of the switchgears. Ekip UP depth is one of the smallest among external units, so it is suitable for many

switchgear sizes. Besides, the terminals (of the signaling contacts) can rotate according to the mold-printed mounting options.


Current and voltage sensors should be applied to the dedicated numbered sockets. Current sockets are directly provided by ABB in different versions, as 3/4 poles or opening/closing Rogowski coils. They fit the current range and the space available among bus-bars/cables in the switchgear. Commercial voltage sensors can be applied following ABB specifications as described in Chapter 5.

Ekip UP unit door-mounted without modules/terminals

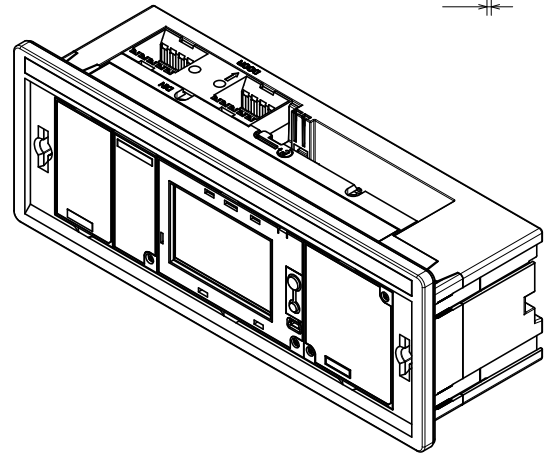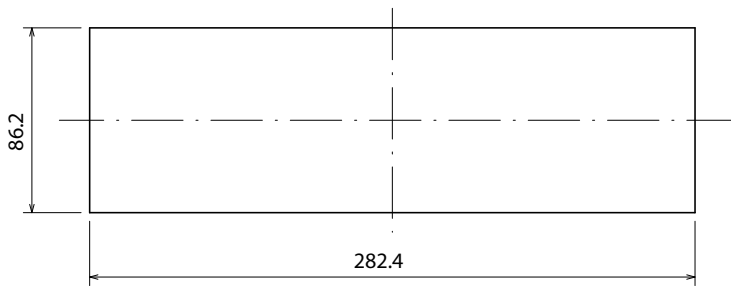
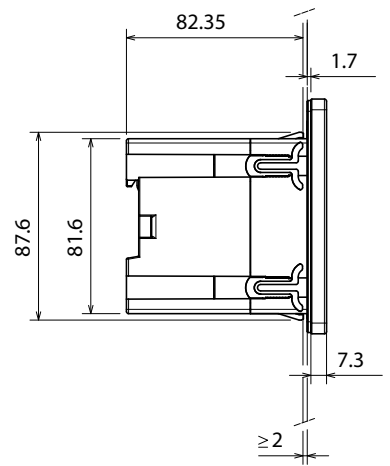
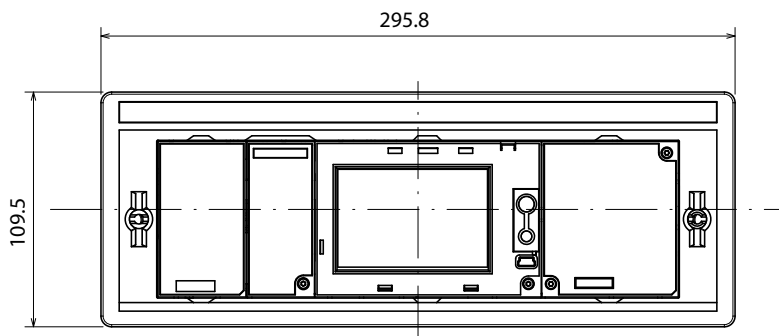


Ekip UP unit dimensions

Ekip UP unit door-mounted with modules/terminals

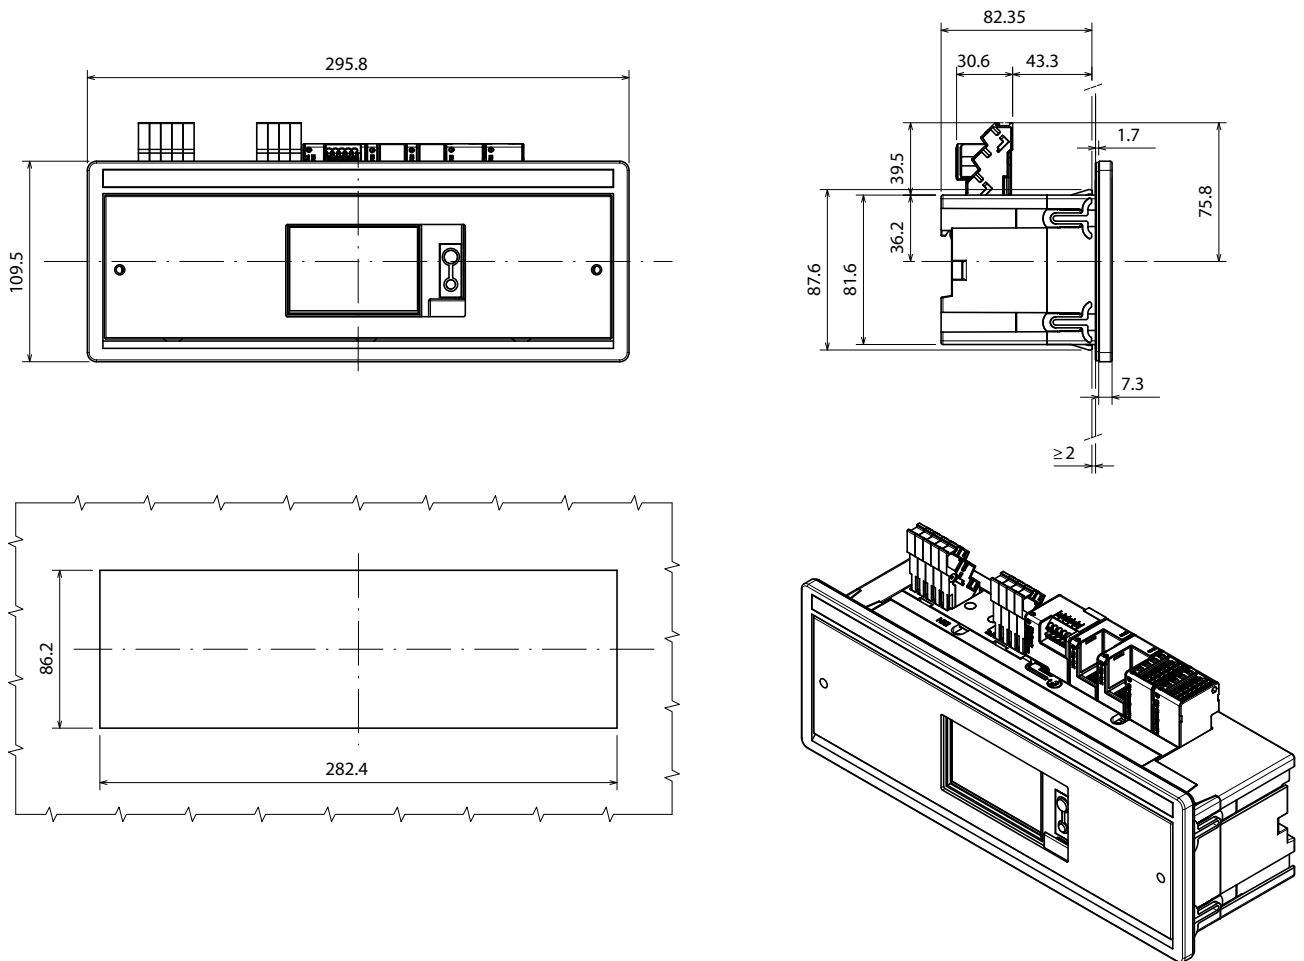


Ekip UP unit DIN-rail mounted without modules/terminals

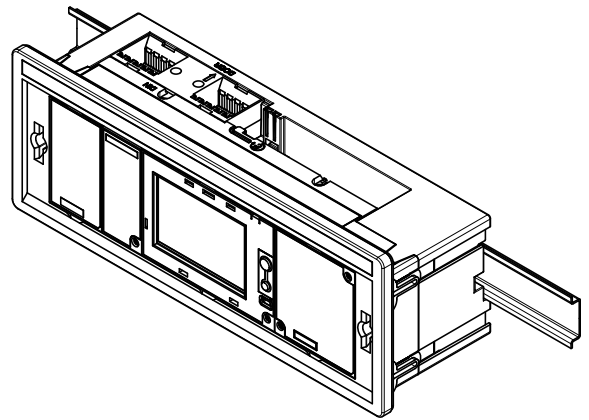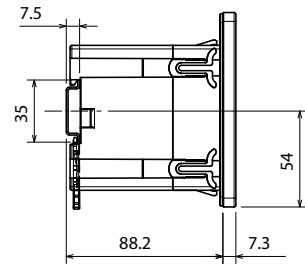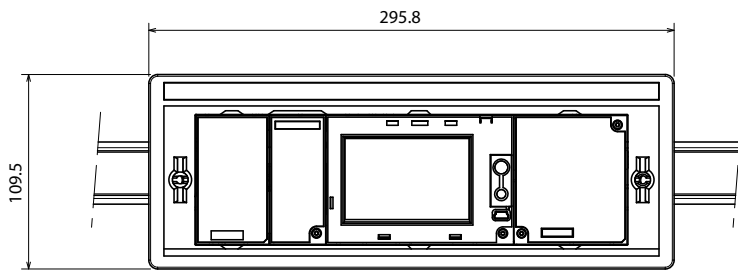


Ekip UP unit dimensions

Ekip UP unit DIN-rail mounted with modules/terminals

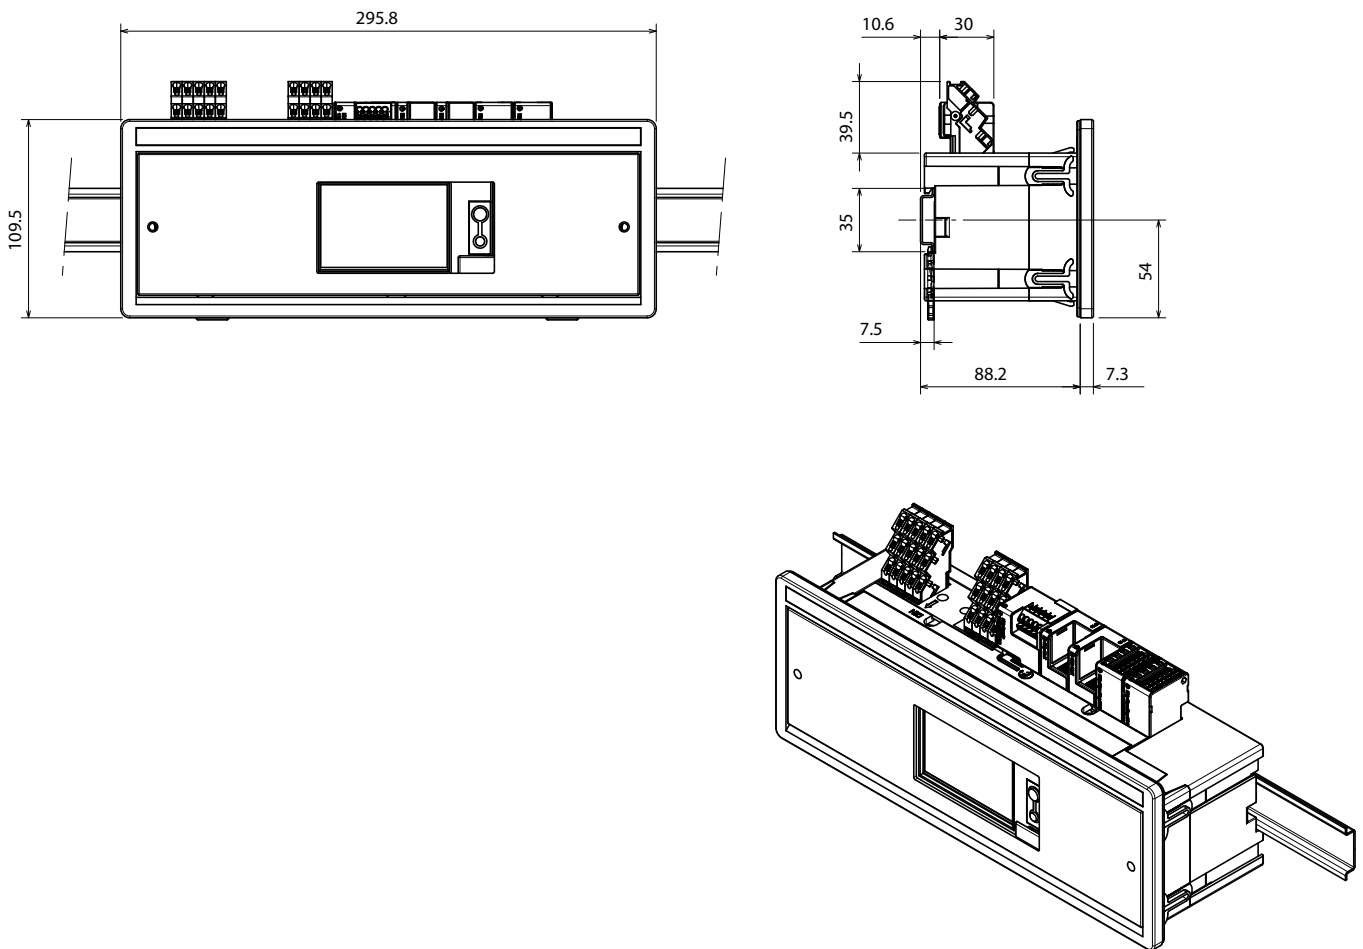


Current sensor dimensions

Current sensor type A 100A-2000A

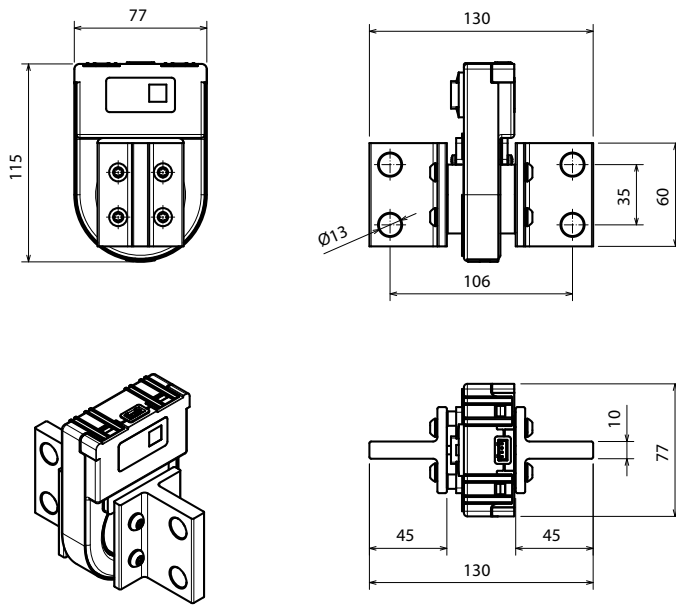


Current sensor type A 2000A-4000A

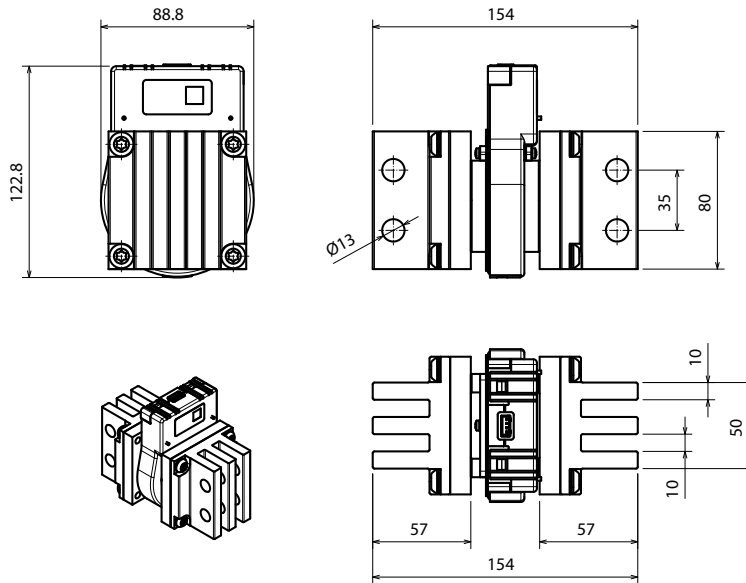


Current sensor dimensions


Current sensor type B 100A-400A

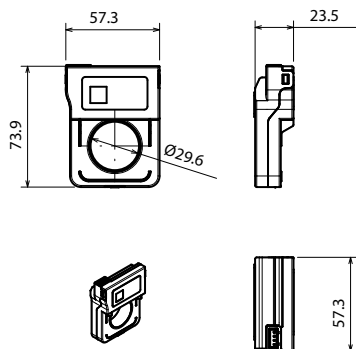


Current sensor type B 400A-1600A

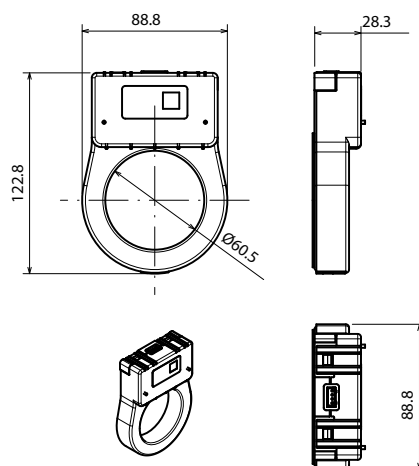


Current sensor type B up to 1600A




Current sensor type B up to 2500A

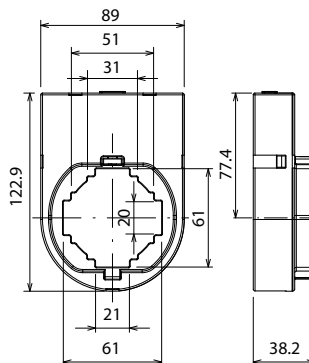

**Current sensor type C
120mm-200mm**

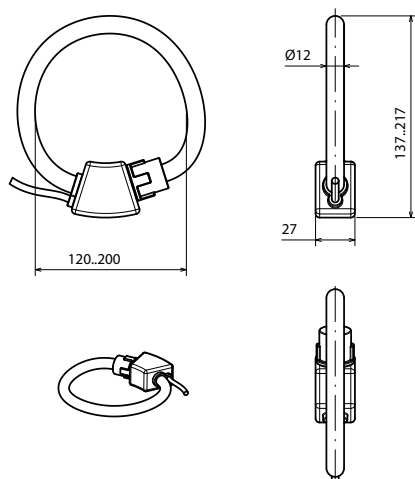

**Current sensor type C
Ø 100-120-200 mm up to 4000A
Ø 290 mm from 2000A to 6300A**

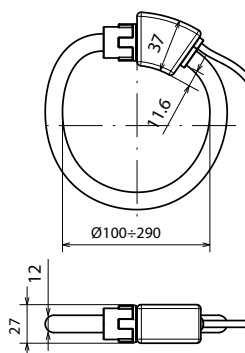

Wiring diagrams

- 7/2** **Reading information**
- 7/5** **Terminal blocks**
- 7/6** **Ekip UP unit**
- 7/13** **Electrical accessories**

Reading information

Description of figures	Key	
11) Ekip UP with external voltage transformer and 3P configuration	*	= See the note indicated by the letter
12) Ekip UP with external voltage transformer and 4P configuration	A3	= Applications located on terminal board and connector of Ekip Up
13) Ekip UP without external voltage transformer and 3P configuration	A4	= Indicative devices and connections for control and signalling, outside Ekip Up
14) Ekip UP without external voltage transformer and 4P configuration	BUS1	= Serial interface with external bus
15) Ekip UP for residual voltage protection (only for Protect+ and Control+) with external transformer	BUS2	= Redundant serial interface with external bus
16) Ekip UP for residual voltage protection (only for Protect+ and Control+) without external transformer	LINK BUS	= Interface with the external Link bus
17) Ekip UP current sensor connection and 4P configuration	GZi(DBi)	= Zone selectivity input for G protection or backward input for D protection
18) Ekip UP current sensor connection and 4P configuration	GZo(DBo)	= Zone selectivity output for G protection or backward output for D protection
19A) Bridges for Ekip UP without current connections	I O1...32	= Programmable digital inputs
19B) Bridges for Ekip UP without voltage connections	K51	= Electronic device Ekip Up for control and measuring
20A) Ekip UP 4k	K51/COM	= Communication module
20C) Ekip 4k on Ekip UP protect, protect+, and control+ version with YO and YC command and 2 status input	K51/MEAS	= Measurement module
24) RC residual current protection sensor input (ANSI 64&50NTD)	K51/SIGN	= Signalling module
24A) RC differential ground fault protection sensor input (ANSI 87N)	K51/SUPPLY	= Auxiliary supply module (110-240VAC/DC and 24-48VDC)
25) Transformer star center sensor input	K51/SYNC	= Synchronization module
26) Zone selectivity	K51/YC	= Closing control from the EKIP protection trip unit
32) Auxiliary supply through module 24-48V DC and local bus	K51/YO	= Opening control from the EKIP protection trip unit
41) Ekip Signalling 2K-1	M	= Motor for loading closing springs
42) Ekip Signalling 2K-2	O 01...32	= Programmable signalling contacts
43) Ekip Signalling 2K-3	O SC	= Contact for synchronism control
44) Ekip Sinchrocheck	RC	= RC (residual current) protection sensor
51) Ekip Com Modbus RTU	SZi(DFi)	= Zone selectivity input for S protection or forward input for D protection
52) Ekip Com Modbus TCP	SZo(DFo)	= Zone selectivity output for S protection or forward output for D protection
53) Ekip Com Profibus DP	TU1...TU2	= Insulation voltage transformer (outside circuit-breaker)
54) Ekip Com Profinet	Uaux	= Auxiliary supply voltage
55) Ekip Com Devicenet™	UI/L1-L2-L3	= Current sensor phase L1-L2-L3
56) Ekip Com Ethernet/IP™	UI/N	= Current sensor on neutral
57) Ekip Com IEC 61850	UI/O	= Homopolar current sensor
58) Ekip Link	W2	= Serial interface with internal bus (local bus)
59) Ekip Hub	W9...W14	= RJ45 connector for communication modules
61) Ekip Com Redundant Modbus RTU	W9R.W12R	= RJ45 connector for redundant communication modules
62) Ekip Com Redundant Modbus TCP		
63) Ekip Com Redundant Profibus DP		
64) Ekip Com redundant Profinet		
65) Ekip Com redundant Devicenet™		
66) Ekip Com redundant Ethernet/IP™		
67) Ekip Com redundant IEC 61850		
103) Ekip Signalling 10k		

Notes


- A For the zone selectivity and local bus function the presence of auxiliary power supply (refer to diagram 1SDM000116R0001 figure 32)
- B The connections between the RC residual current protection sensor and the poles of X connector of Ekip Up must be made with 4-pole shielded cable with conductors twisted in pairs (type BELDEN 9696 or equivalent) 10 m maximum length.
- C The connection between terminals 1 and 2 of the current transformer and Ge+ and Ge- unit I/O terminals of the upper X terminal box must be made with shielded and stranded 2-pole cable (type BELDEN 9841 or equivalent) 15 m maximum length.
- D Obligatory in case of presence of Ekip modules Ekip module.
- E The Ekip Com module selected can be redundant if required, by choosing between Fig. 61...67.
- F Use cables type BELDEN 3105A or equivalent.
- G Terminal box available in DIN mounting configuration.
- H Use cables type BELDEN 3105A or equivalent, 15 m maximum length.
- I RJ45 recommended cable: CAT6 STP.
- J For the serial line connection EIA RS 485, refer to "Technical Application Paper QT9: Bus Communication with ABB Circuit-Breakers".
- K Bridge-connect the terminals "120 Ohm on" if you want to insert a termination resistance on the Local Bus.
- L Use cables type Belden 3079A or equivalent. For further details see White Paper 1SDC007412G0201 "Communication with SACE Emax2 Circuit-Breakers"
- M Use cables type Belden 3084A or equivalent. For further details see White Paper 1SDC007412G0201 "Communication with SACE Emax2 Circuit-Breakers"
- O For connection of W3 and W4 see Fig 32.
- P Use a twisted pair shielded and stranded cable type BELDEN 8762/8772 or equivalent. The shield must be earthed on the selectivity input side (for zone selectivity) or on both sides (for others applications).
- Q The maximum secondary rated voltage admitted is 120V.
- R The connection without transformer does not comply with the insulation required by the standard IEC 60255-1.

- S Input and output are shown as factory default setting with 1 status input: O 01 output connected to the opening coil of the circuit-breaker/disconnector; O 02 output connected to the closing coil (or motor) of the circuit-breaker/disconnector; I 01 input connected to status input (contact closed equals to CB status = Open). For the operating limits, the configuration solutions of O 02 and I 01 and for the setting of all other input/output see the Ekip UP user manual, s(section Ekip 4k).


For more Ekip UP wiring diagrams, please refer to 1SDM000116R0001.

Reading information


Graphical symbols for electrical diagrams (Standards IEC 617)




Screen, shield (it may be drawn in any convenient shape)




Connection of conductors




Make contact




Mechanical connection (link)




Terminal




Break contact




Converter with galvanic separator




Plug and socket (male and female)




Current sensing element




Conductors in a screened cable, three conductors shown



Voltage transformer




Twisted conductors, three conductors shown



Winding of three-phase transformer, connection star


Terminal blocks

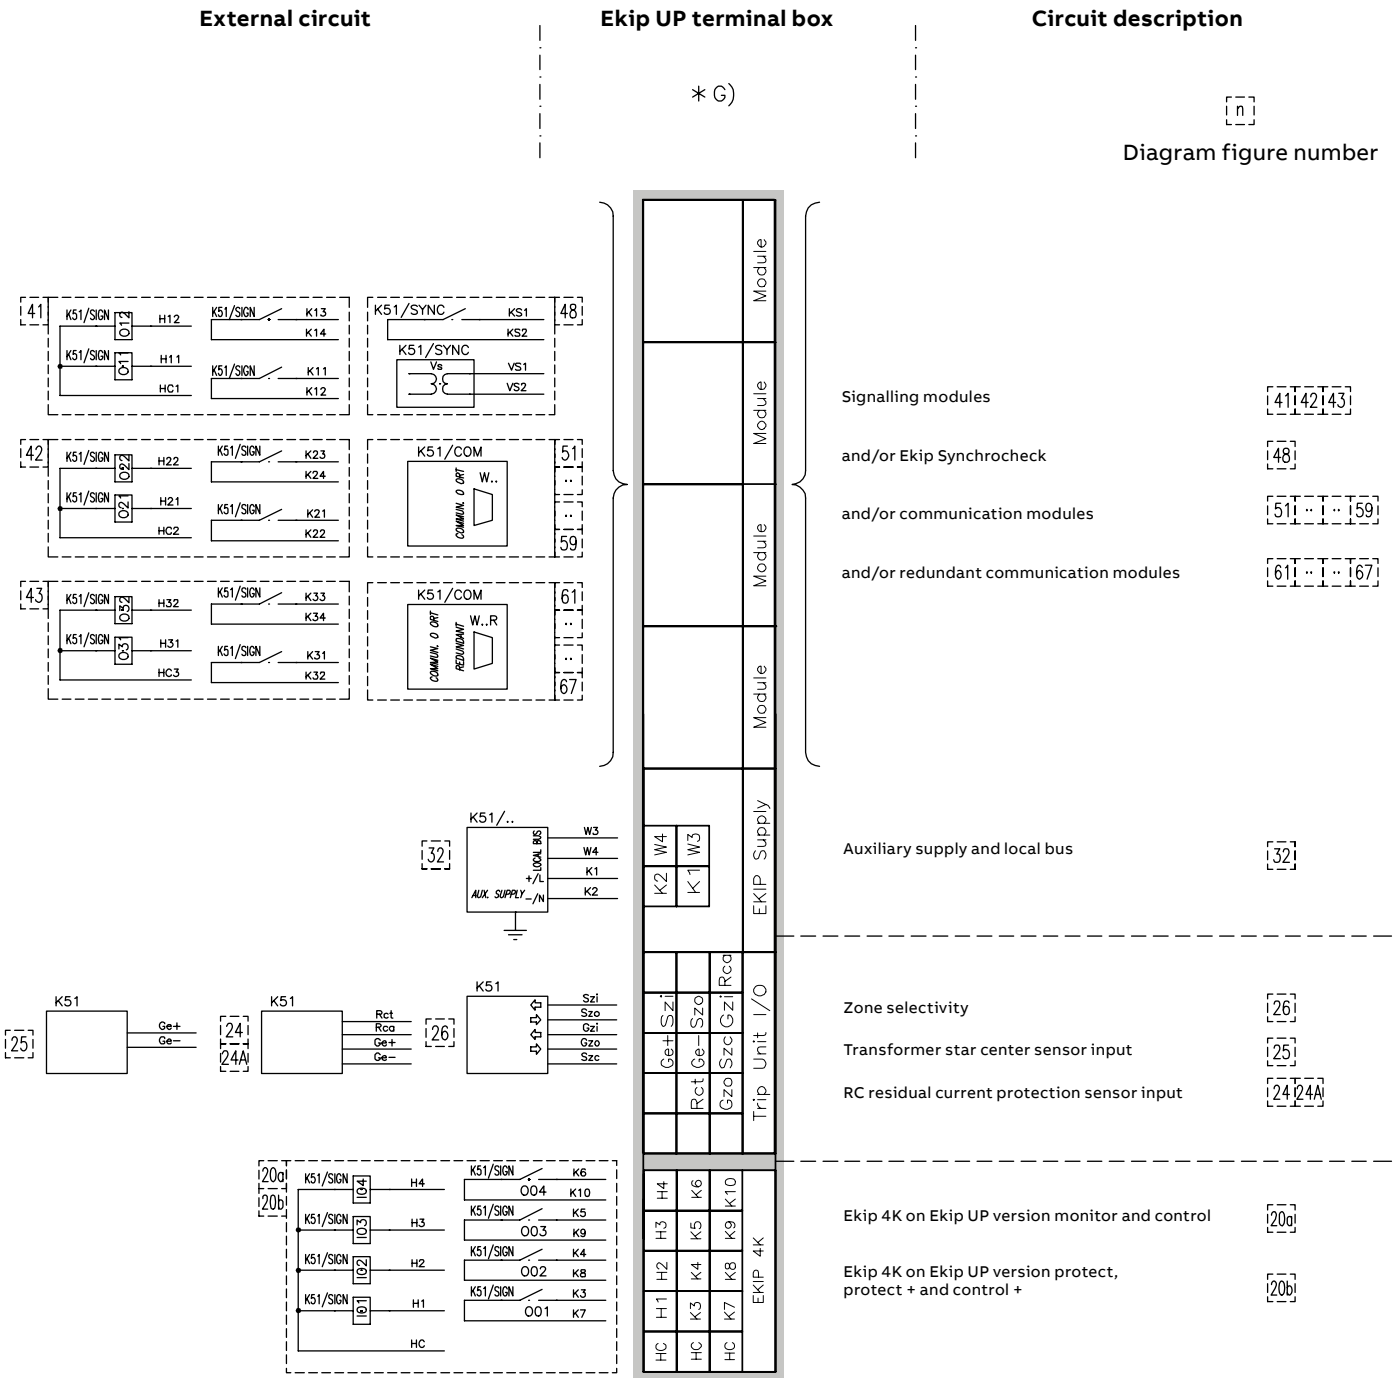

Ekip UP unit


11) Ekip UP with external voltage transformer and 3P configuration

12) Ekip UP with external voltage transformer and 4P configuration

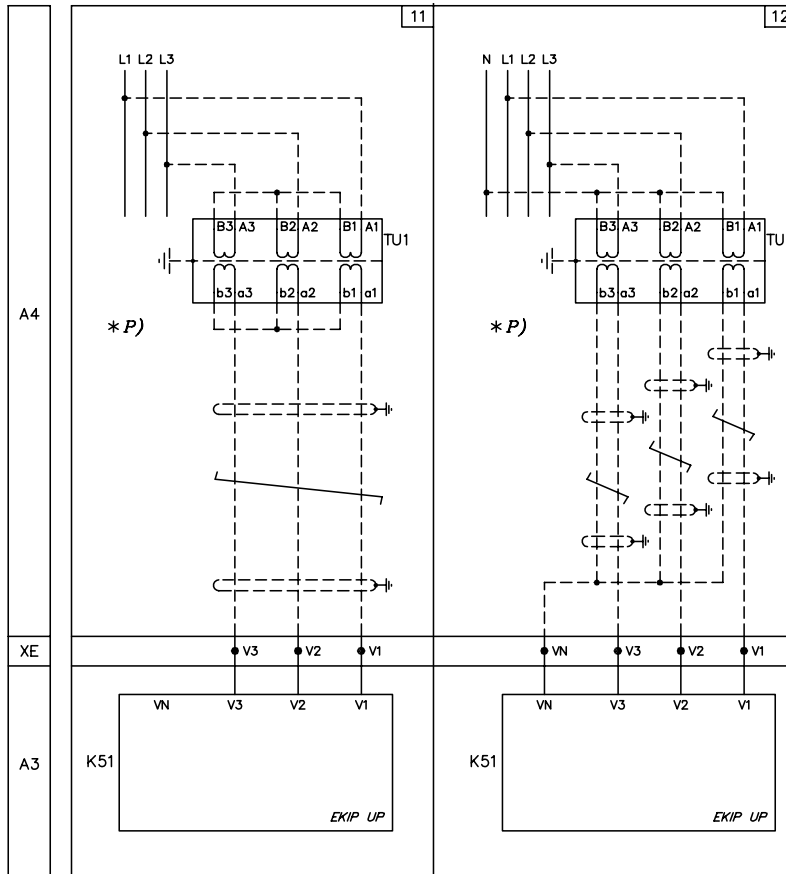

13) Ekip UP without external voltage transformer and 3P configuration


14) Ekip UP without external voltage transformer and 4P configuration

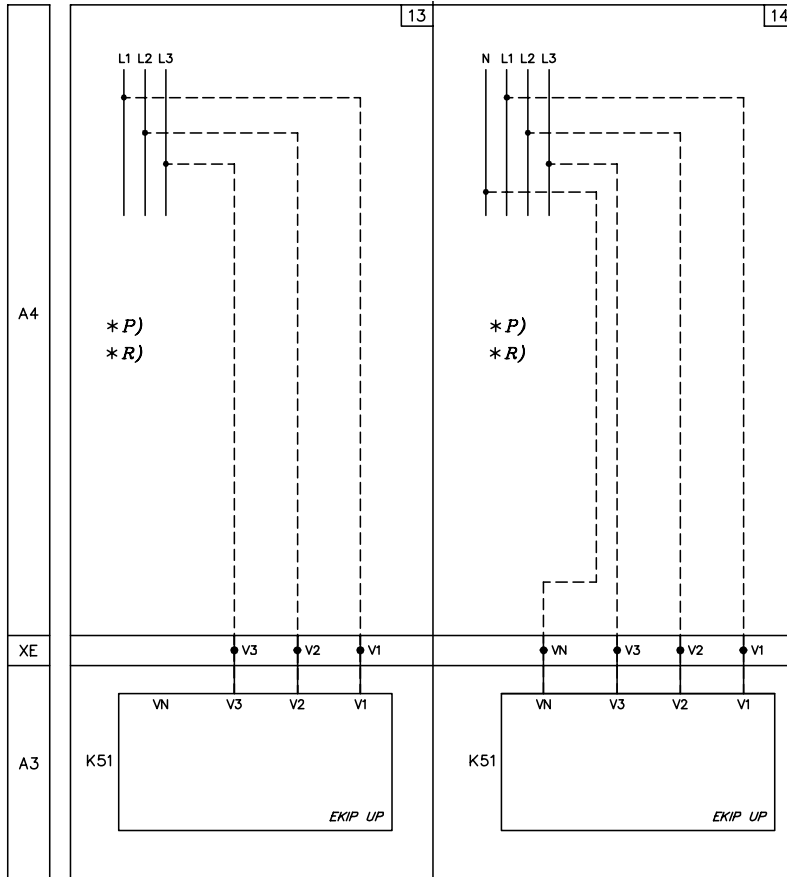

Ekip UP unit


17) Ekip UP current sensor connection and 3P configuration

18) Ekip UP current sensor connection and 4P configuration

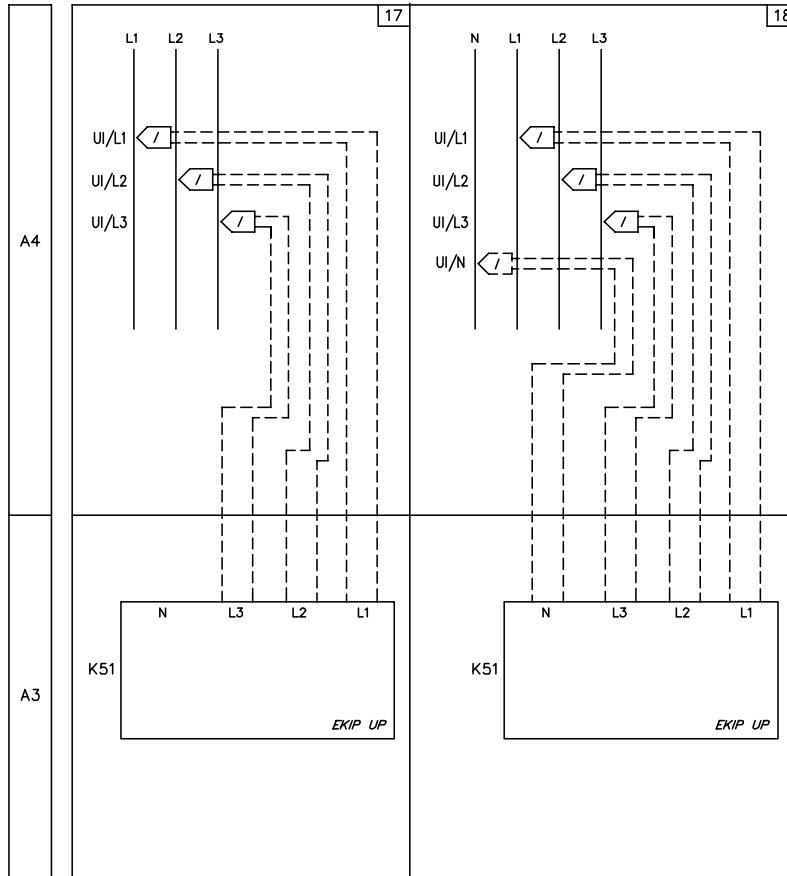

19A) Bridges for Ekip UP without current connections

19B) Bridges for Ekip UP without voltage connections

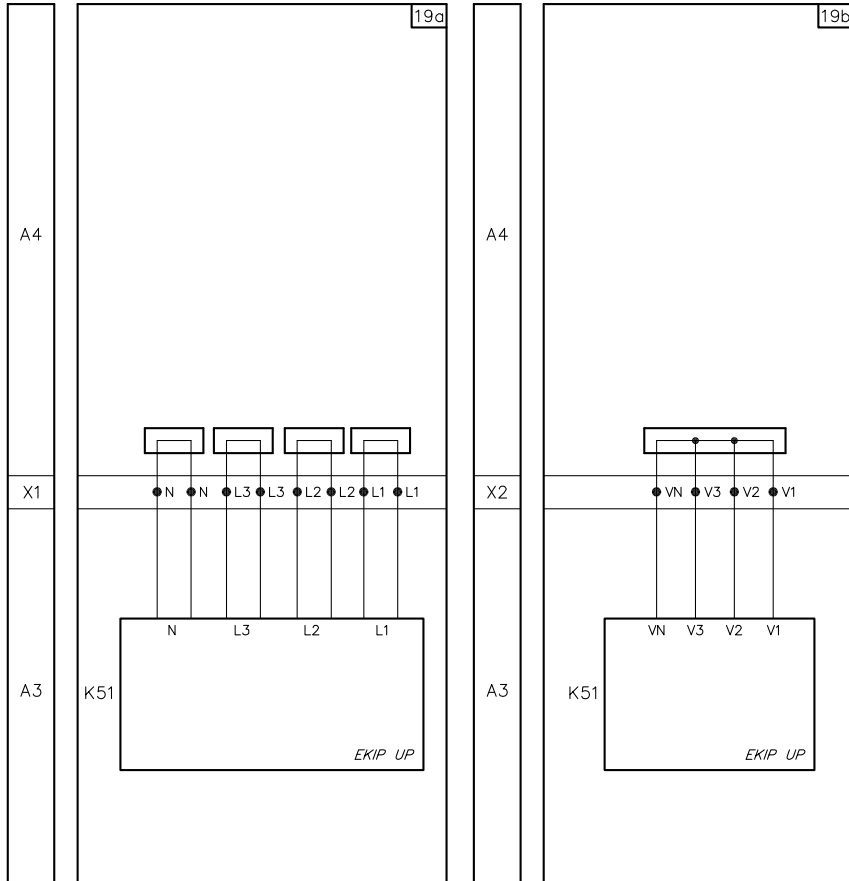


Ekip UP unit

HC	H1	H2	H3	H4			Ge+	Szi			K2	W4					
HC	K3	K4	K5	K6			Rct	Ge-	Szo			K1	W3				
HC	K7	K8	K9	K10			Gzo	Szc	Gzi	Rca							
EKIP 4K					Trip Unit I/O				EKIP Supply		Module		Module		Module		

HC	H1	H2	H3	H4
HC	K3	K4	K5	K6
HC	K7	K8	K9	K10
EKIP 4K				

20A) Ekip 4k on Ekip UP monitor and control version

- monitor → Monitor
- protect → Protect
- protect+ → Protect+
- control → Control
- control+ → Control+

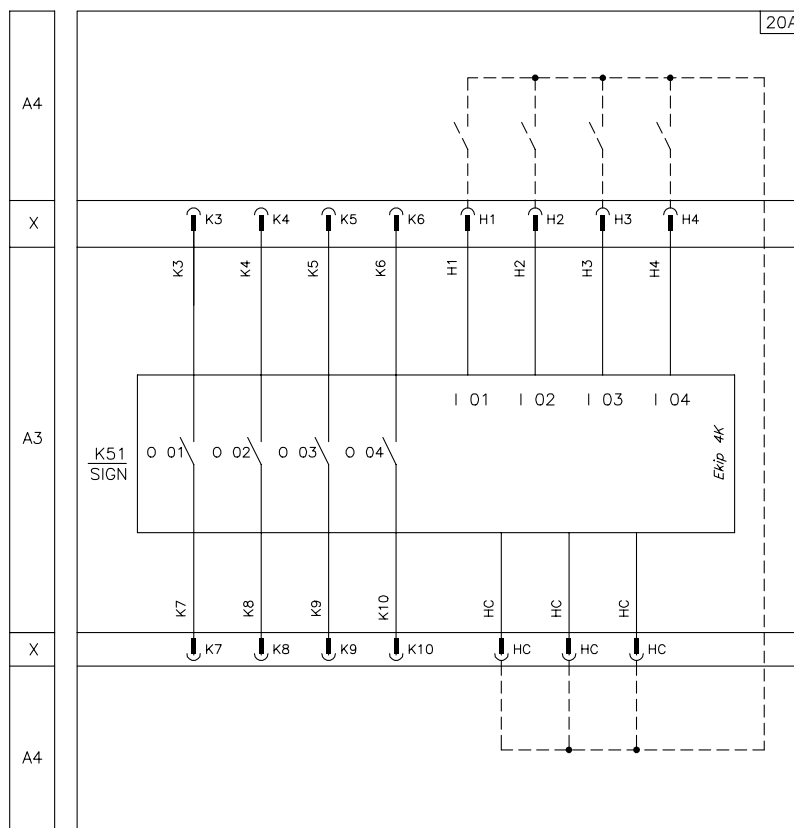


HC	H1	H2	H3	H4			Ge+	Szi			K2	W4					
HC	K3	K4	K5	K6			Rct	Ge-	Szo			K1	W3				
HC	K7	K8	K9	K10			Gzo	Szc	Gzi	Rca							
EKIP 4K					Trip Unit I/O				EKIP Supply		Module		Module		Module		

HC	H1	H2	H3	H4
HC	K3	K4	K5	K6
HC	K7	K8	K9	K10
EKIP 4K				

20C) Ekip 4k on Ekip UP protect, protect+, and control+ version with YO and YC command and 2 status input


* S)

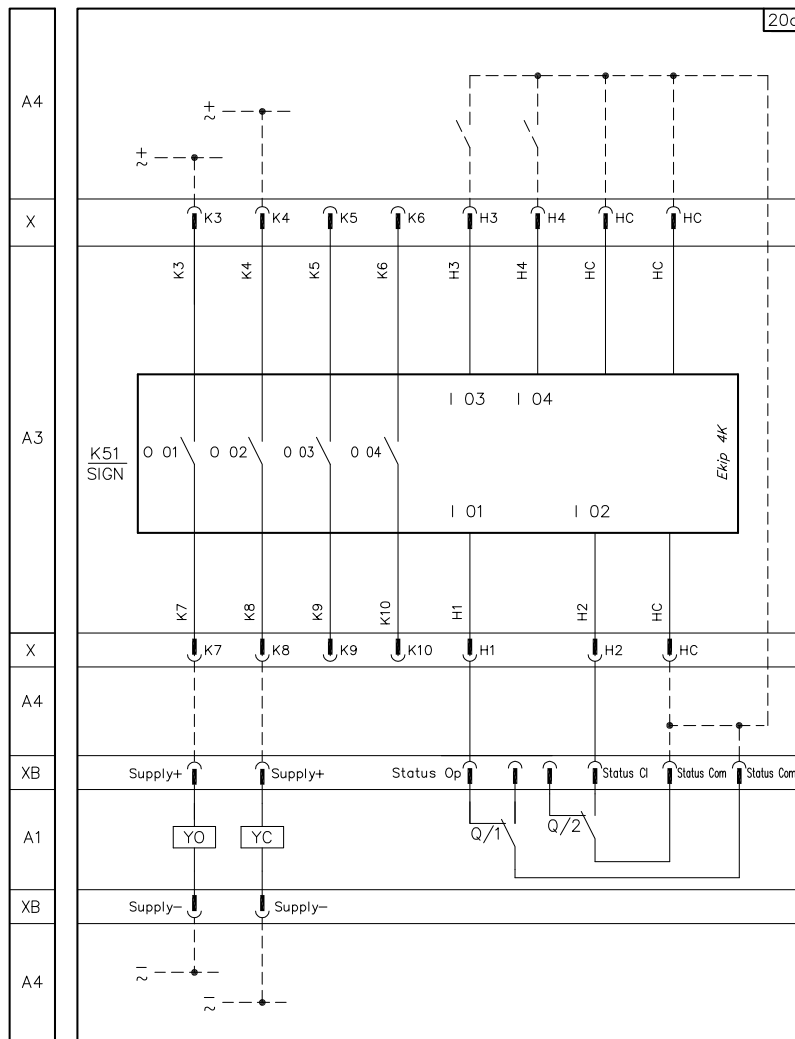

Ekip UP unit

15) Ekip UP for residual voltage protection (for protect+ and control + only) with external transformer

16) Ekip UP for residual voltage protection (for protect+ and control + only) without external transformer

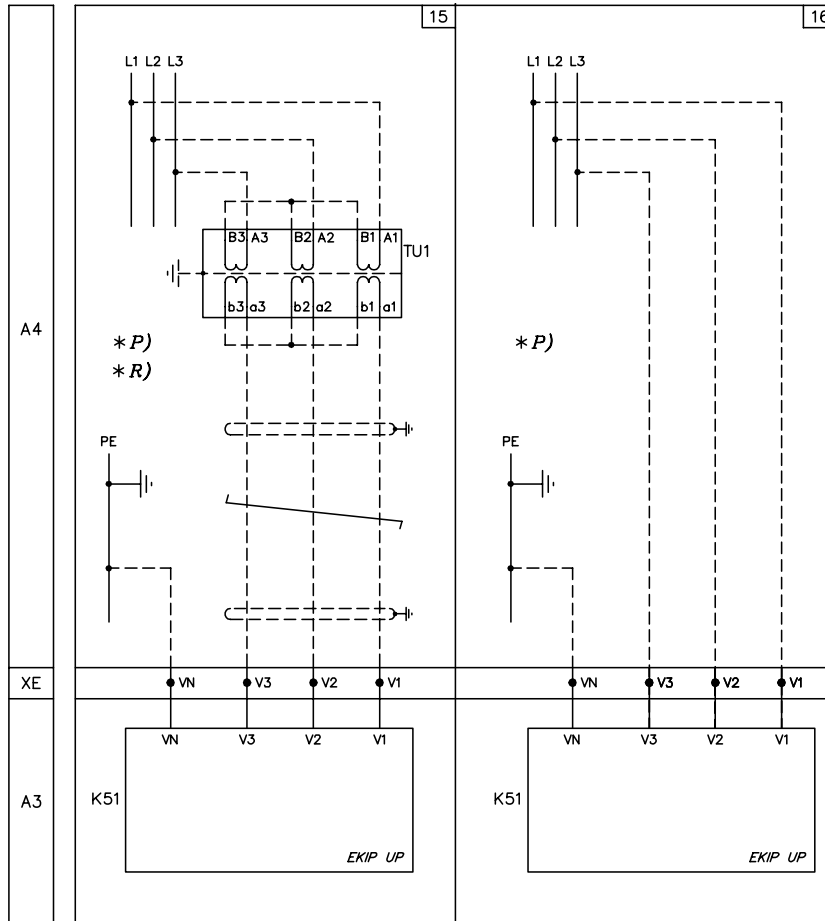


Electrical accessories

HC	H1	H2	H3	H4			Ge+	Szi			K2	W4							
HC	K3	K4	K5	K6		Rct	Ge-	Szo			K1	W3							
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca										
EKIP 4K					Trip Unit I/O					EKIP Supply		Module		Module		Module		Module	



24) RC residual current protection sensor input (ANSI 64&50NTD)
24A) RC differential ground fault protection sensor input (ANSI 87N)

As an alternative to each other or to figure 25

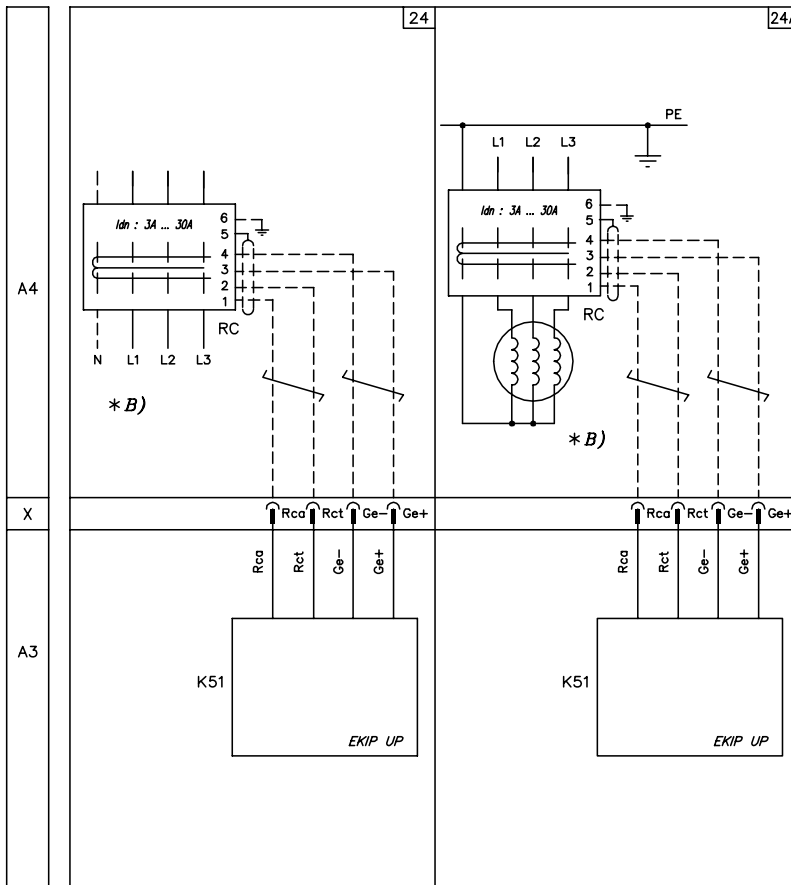


Electrical accessories

HC	H1	H2	H3	H4			Ge+	Szi			K2	W4					
HC	K3	K4	K5	K6		Rct	Ge-	Szo			K1	W3					
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca								
EKIP 4K					Trip Unit I/O					EKIP Supply		Module		Module		Module	



25) Transformer star center (homopolar) current sensor input


As an alternative to figures 24-24A

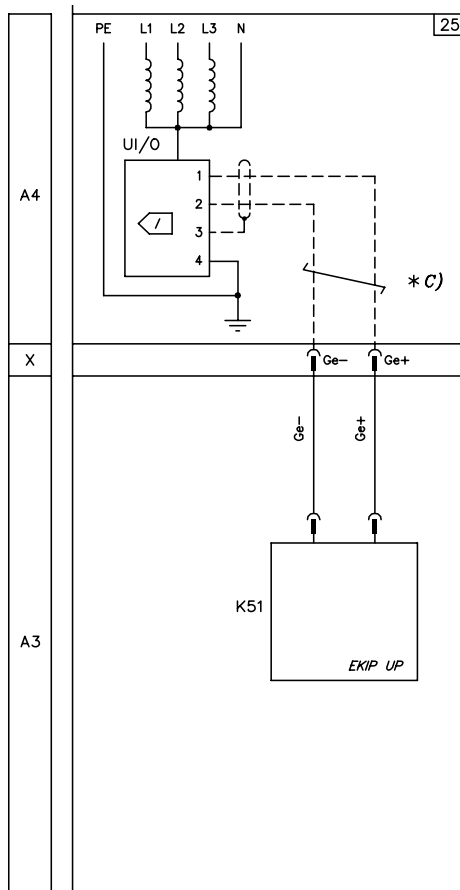


HC	H1	H2	H3	H4		Ge+	Szi			K2	W4							
HC	K3	K4	K5	K6		Rct	Ge-	Szo		K1	W3							
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca									
EKIP 4K					Trip Unit I/O				EKIP Supply		Module		Module		Module		Module	



26) Zone selectivity

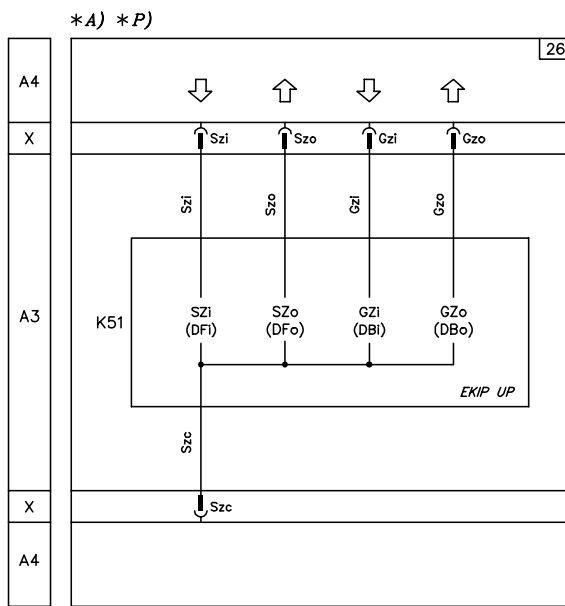


Example for application diagram (among 3 devices)

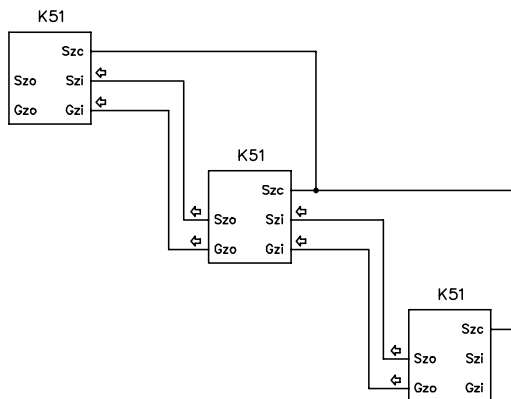


Electrical accessories


HC	H1	H2	H3	H4			Ge+	Szi			K2	W4							
HC	K3	K4	K5	K6			Rct	Ge-	Szo		K1	W3							
HC	K7	K8	K9	K10			Gzo	Szc	Gzi	Rca									
EKIP 4K					Trip Unit I/O					EKIP Supply		Module		Module		Module		Module	



32) Auxiliary supply through module 24-48V DC and local bus

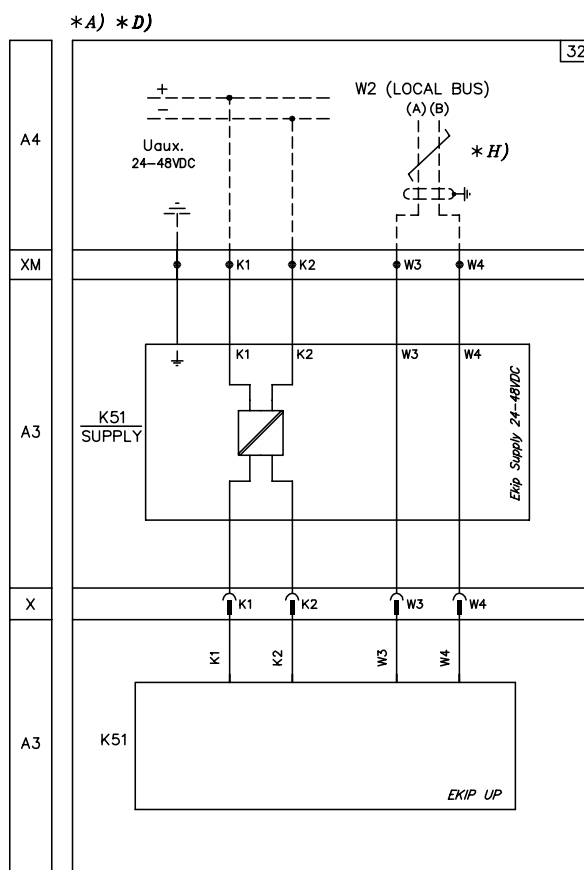


HC	H1	H2	H3	H4		Ge+	Szi		K2	W4						
HC	K3	K4	K5	K6		Rct	Ge-	Szo	K1	W3						
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca							
EKIP 4K					Trip Unit I/O				EKIP Supply		Module	Module	Module	Module		

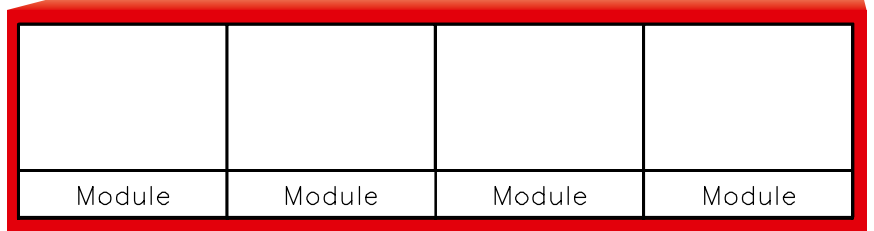

41) Ekip Signalling 2K-1

42) Ekip Signalling 2K-2

*E)

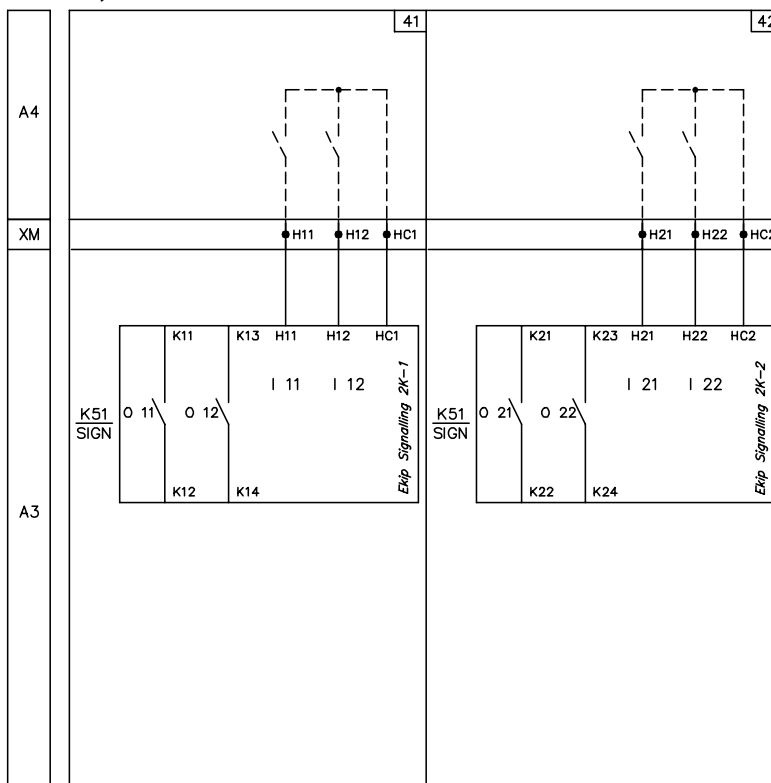


Electrical accessories

HC	H1	H2	H3	H4			Ge+	Szi			K2	W4					
HC	K3	K4	K5	K6			Rct	Ge-	Szo		K1	W3					
HC	K7	K8	K9	K10			Gzo	Szc	Gzi	Rca							
EKIP 4K					Trip Unit I/O					EKIP Supply		Module		Module		Module	


Module	Module	Module	Module

43) Ekip Signalling 2K-3

44) Ekip Sinchrocheck

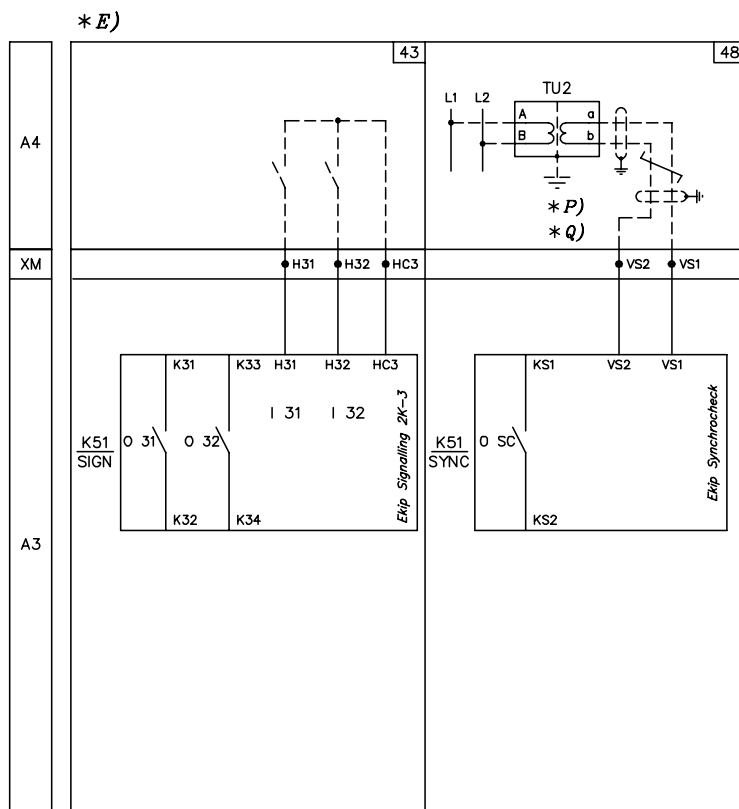


HC	H1	H2	H3	H4		Ge+	Szi			K2	W4							
HC	K3	K4	K5	K6		Rct	Ge-	Szo		K1	W3							
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca									
EKIP 4K					Trip Unit I/O				EKIP Supply		Module		Module		Module		Module	

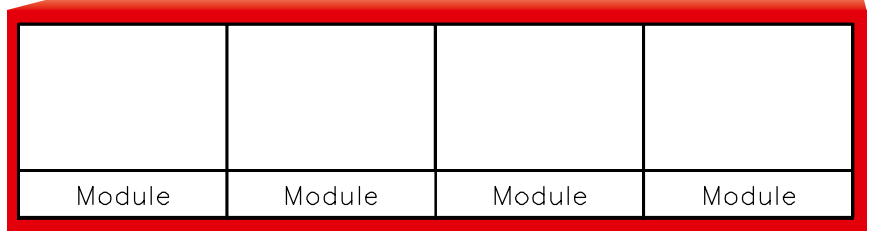


- 51) Ekip Com Modbus RTU
- 52) Ekip Com Modbus TCP
- 53) Ekip Com Profibus DP

*E)

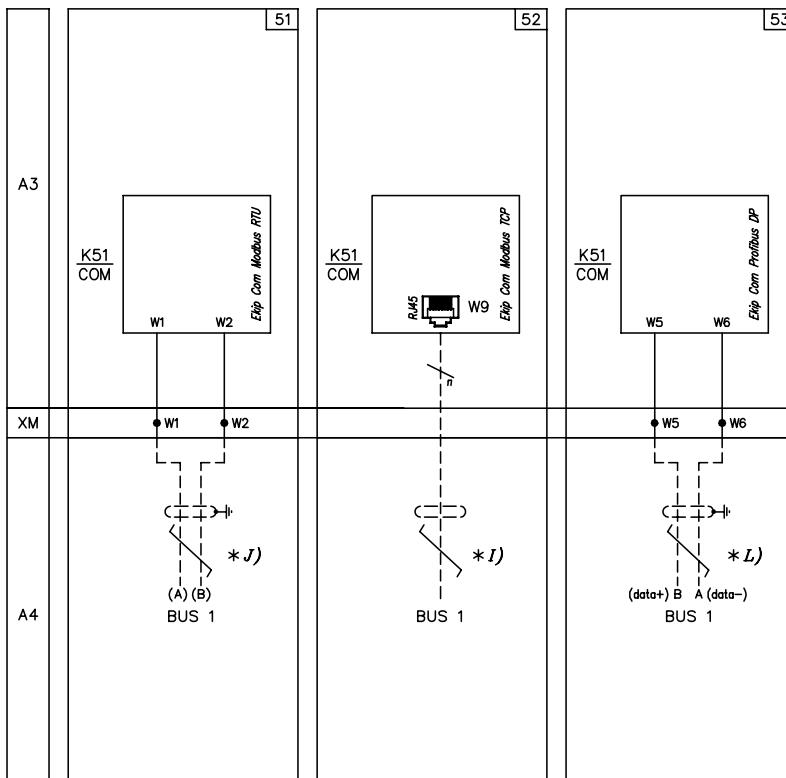


Electrical accessories


HC	H1	H2	H3	H4		Ge+	Szi			K2	W4							
HC	K3	K4	K5	K6		Rct	Ge-	Szo		K1	W3							
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca									
EKIP 4K					Trip Unit I/O				EKIP Supply		Module		Module		Module		Module	

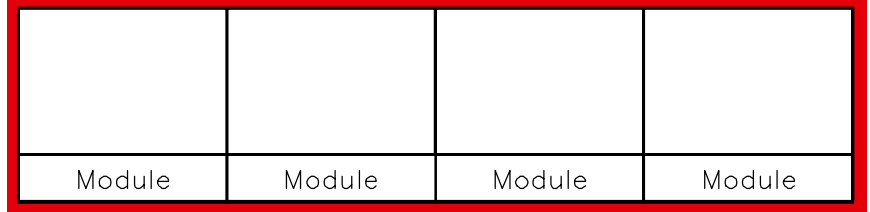

- 54) Ekip Com Profinet
- 55) Ekip Com Devicenet™
- 56) Ekip Com Ethernet/IP™

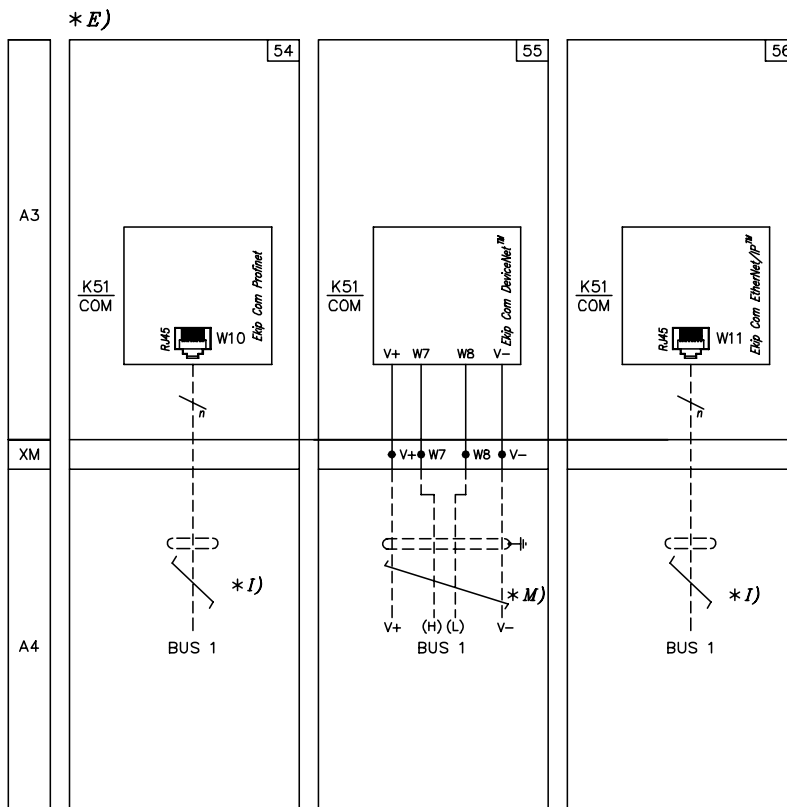

HC	H1	H2	H3	H4		Ge+	Szi		K2	W4						
HC	K3	K4	K5	K6		Rct	Ge-	Szo	K1	W3						
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca							
EKIP 4K					Trip Unit I/O				EKIP Supply		Module	Module	Module	Module		

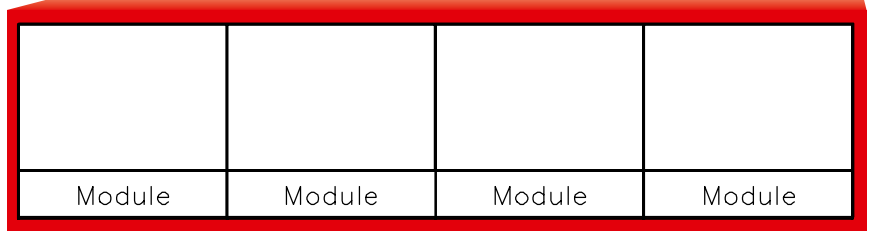


57) Ekip Com IEC 61850

58) Ekip Link


59) Ekip Hub

*E)

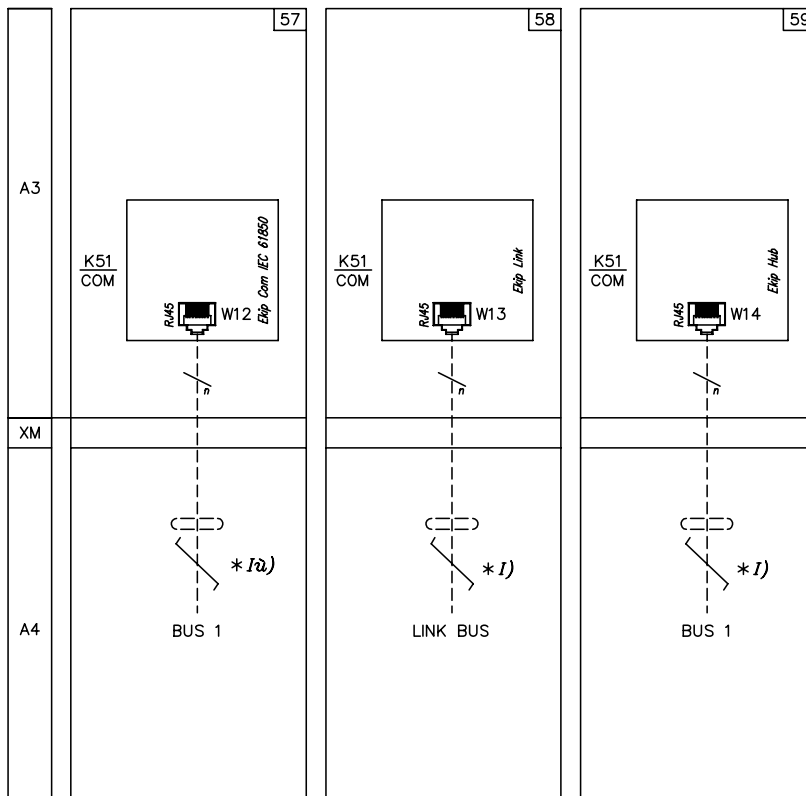


Electrical accessories


HC	H1	H2	H3	H4			Ge+	Szi			K2	W4					
HC	K3	K4	K5	K6			Rct	Ge-	Szo			K1	W3				
HC	K7	K8	K9	K10			Gzo	Szc	Gzi	Rca							
EKIP 4K					Trip Unit I/O				EKIP Supply		Module		Module		Module		

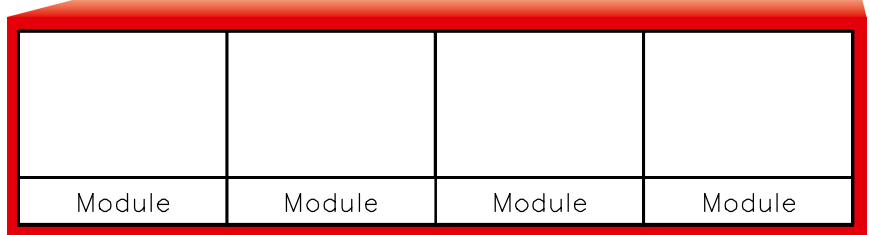


- 61) Ekip Com Redundant Modbus RTU
- 62) Ekip Com Redundant Modbus TCP
- 63) Ekip Com Redundant Profibus DP

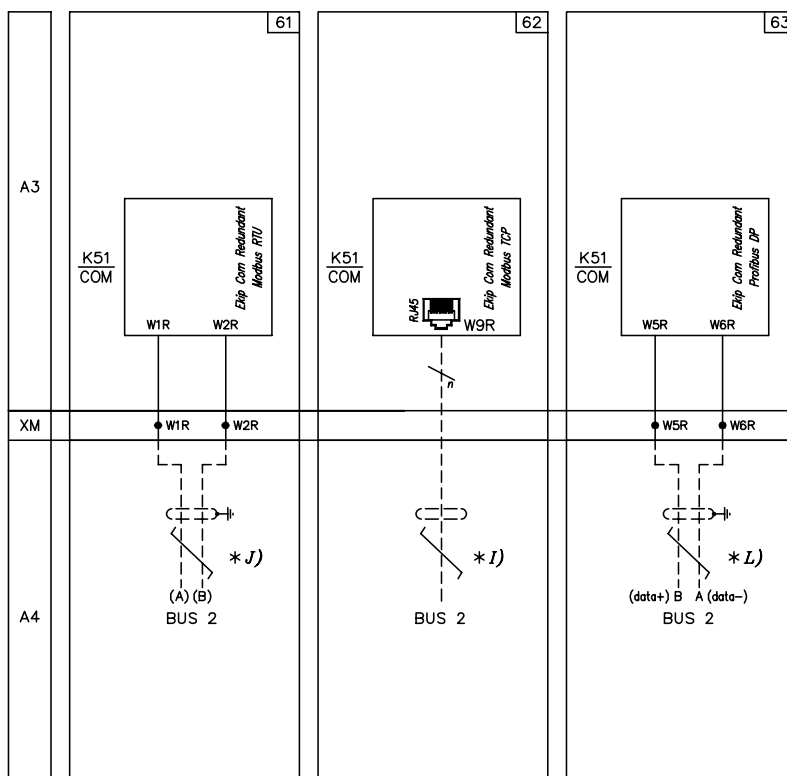

HC	H1	H2	H3	H4		Ge+	Szi			K2	W4					
HC	K3	K4	K5	K6		Rct	Ge-	Szo		K1	W3					
HC	K7	K8	K9	K10		Gzo	Szc	Gzi	Rca							
EKIP 4K					Trip Unit I/O				EKIP Supply		Module		Module		Module	

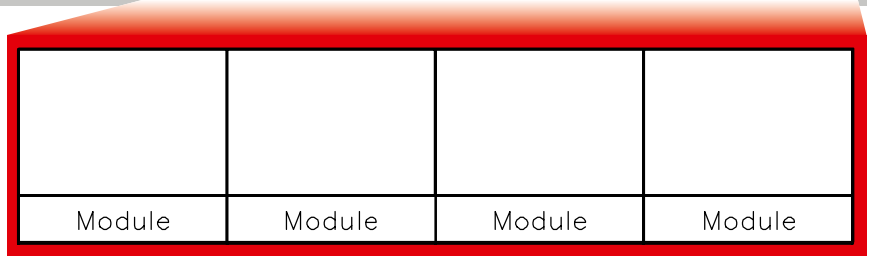


- 64) Ekip Com redundant Profinet
- 65) Ekip Com redundant Devicenet™
- 66) Ekip Com redundant Ethernet/IP™
- 67) Ekip Com redundant IEC 61850

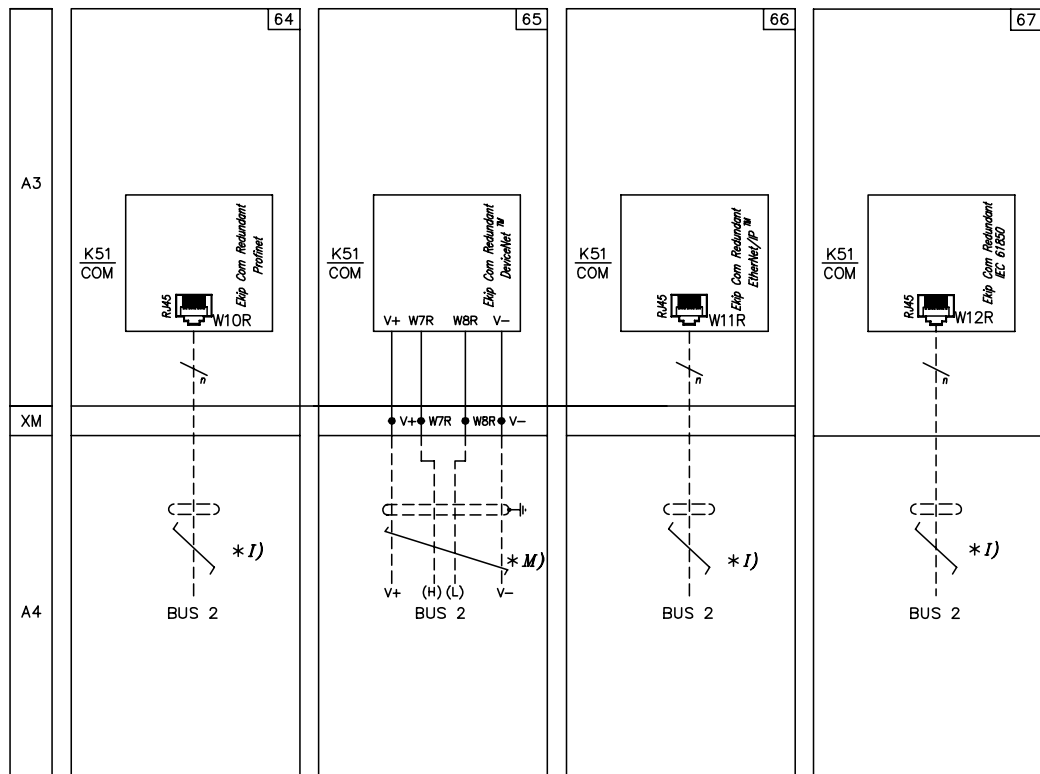

Electrical accessories

103) Ekip Signalling 10k

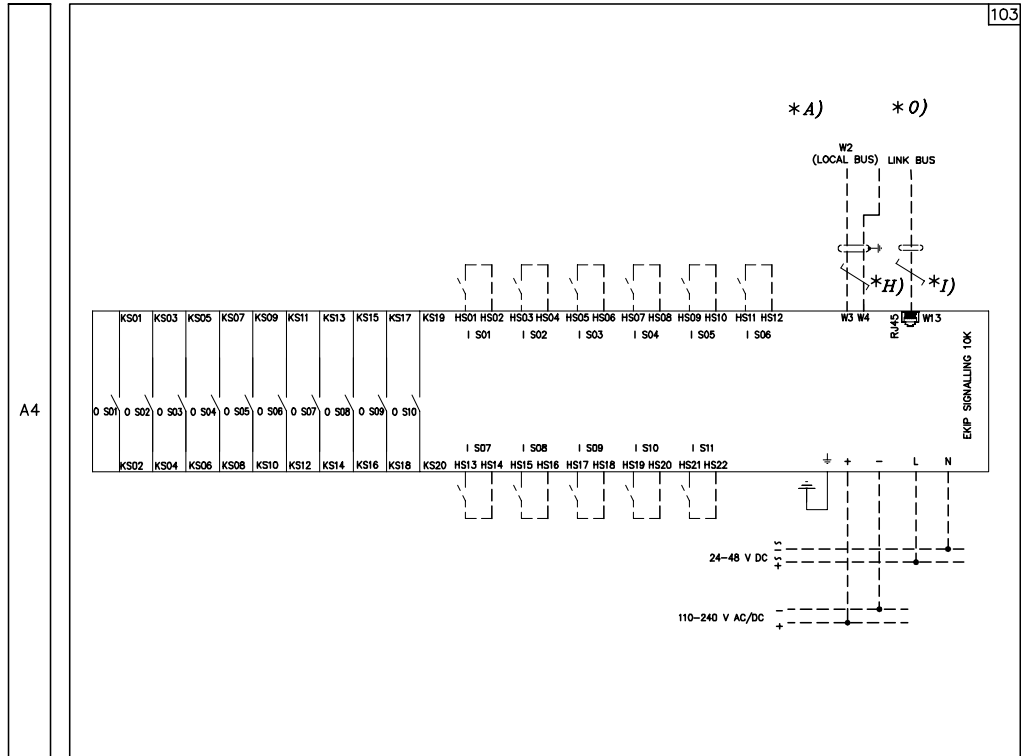

Ordering codes

- 8/2** **Instructions for ordering**
- 8/4** **Ekip UP versions**
- 8/5** **Ekip UP mandatory accessories**
- 8/7** **Ekip UP optional accessories**
- 8/10** **Ekip UP Part Numbering System**

Instructions for ordering

Ordering examples

Standard version Ekip UP to be accessorized are identified by commercial codes.

To order Ekip UP unit:

1. Choose Ekip UP version with main code.
2. Select the mandatory accessories:
 - a. One type of current sensors
 - b. Installed rating plugs related to current sensor type chosen
 - c. Power supply module
3. Select optional accessories, as they can ordered mounted on the unit or loose:
 - a. Cartridge connectivity modules
 - b. Cartridge synchrocheck module
 - c. Cartridge signalling modules
Remind that maximum 4 slots can be occupied by cartridge connectivity, signaling and synchrocheck modules in the Ekip UP accessorizing area.
 - d. DIN-rail signalling modules
Remind that maximum 3 pieces of Ekip Signalling 10k can be connected by local bus. This limit is not present with Ekip Link connectivity.
 - e. External toroids
 - f. Software functions
Remind the software compatibility described in Chapter 3.
 - g. Commissioning modules
 - h. Spare parts
 - i. Loose rating plugs as spare part to change the rated current related to the installed current sensors.

Ekip UP package contains:

- Ekip UP unit
 - Current sensors
 - Power supply modules
 - Optional cartridge connectivity, synchrocheck, signaling modules
- DIN-rail signalling modules (Ekip Signalling 10k, Ekip Signalling Modbus TCP), external toroids, commissioning modules, spare parts, loose rating plugs are provided only external from Ekip UP package.
- Standard warranty is 1 year but it can be extended up to 5 years (see chapter 5).
- The "Coming soon!" codes can be updated in next version of this catalog.

[Here you can find the online configurator](#)

Example

Shopping list for the unit with advanced protection to be installed in an existing four-phase plant, rating plug 2500A, Modbus TCP/IP connectivity

and connection to cloud platform, cartridge signalling module, synchrocheck module and 3 pieces of DIN-rail signaling modules for load shedding function:

Ekip UP version

Type	Code
Ekip UP Protect +	1SDA083361R1

Mandatory accessories

Type	Code
Open CS 4P type C 120	1SDA083373R1
Rating Plug 2500A	1SDA074268R1
Ekip Supply 24-48Vdc	1SDA074173R1

Optional accessories

Type	Code
Ekip Com Modbus TCP	1SDA074151R1
Ekip Com Hub	1SDA082894R1
Ekip Synchrocheck	1SDA074183R1
Ekip Signalling 2K-1	1SDA074167R1
Load shedding - adaptive	1SDA082921R1
Ekip Signalling 10K*	1SDA074171R1
Ekip Signalling 10K*	1SDA074171R1
Ekip Signalling 10K*	1SDA074171R1

*provided externally from package.

Ekip UP

Ekip UP versions



Type	Code
Ekip UP Monitor	1SDA083359R1
Ekip UP Protect	1SDA083360R1
Ekip UP Protect +	1SDA083361R1
Ekip UP Control	1SDA083362R1
Ekip UP Control +	1SDA083363R1

Ekip UP

Mandatory accessories



Current sensors

Type	Code
CS 100-2000A 3P + COPPER type A	1SDA083368R1
CS 100-2000A 4P + COPPER type A	1SDA083369R1
CS 2000-4000A 3P + COPPER type A	1SDA083370R1
CS 2000-4000A 4P + COPPER type A	1SDA083371R1
CS 100-400A 3P type B	1SDA083364R1
CS 100-400A 4P type B	1SDA083365R1
CS 400-1600A 3P type B	1SDA083366R1
CS 400-1600A 4P type B	1SDA083367R1
CS 400-2500A 2P type B shaped	1SDA085561R1 coming soon
CS 400-2500A 4P type B shaped	1SDA085562R1 coming soon
Open CS 3P type C 100	1SDA085566R1
Open CS 4P type C 100	1SDA085564R1
Open CS 3P type C 120	1SDA083372R1
Open CS 4P type C 120	1SDA083373R1
Open CS 3P type C 200	1SDA085565R1
Open CS 4P type C 200	1SDA085563R1
Open CS 3P type C 290	1SDA107696R1
Open CS 4P type C 290	1SDA107695R1
Insertion bridges CS type D	1SDA104662R1

Ekip UP

Mandatory accessories



Installed Rating Plugs

Rating plugs mounted on Ekip UP

Type	Code
Rating Plug 100A	1SDA074258R1
Rating Plug 200A	1SDA074259R1
Rating Plug 250A	1SDA074260R1
Rating Plug 400A	1SDA074261R1
Rating Plug 600A	1SDA079826R1
Rating Plug 630A	1SDA074262R1
Rating Plug 800A	1SDA074263R1
Rating Plug 1000A	1SDA074264R1
Rating Plug 1200A	1SDA079828R1
Rating Plug 1250A	1SDA074265R1
Rating Plug 1600A	1SDA074266R1
Rating Plug 2000A	1SDA074267R1
Rating Plug 2500A	1SDA074268R1
Rating Plug 3200A	1SDA074269R1
Rating Plug 3600A	1SDA079829R1
Rating Plug 4000A	1SDA074270R1
Rating Plug 5000A	1SDA074271R1
Rating Plug 6000A	1SDA112838R1
Rating Plug 6300A	1SDA112839R1
Rating Plug RC 100A	1SDA074288R1
Rating Plug RC 200A	1SDA074289R1
Rating Plug RC 250A	1SDA074290R1
Rating Plug RC 400A	1SDA074291R1
Rating Plug RC 630A	1SDA074292R1
Rating Plug RC 800A	1SDA074293R1
Rating Plug RC 1250A	1SDA074294R1
Rating Plug RC 2000A	1SDA074295R1
Rating Plug RC 3200A	1SDA074296R1
Rating Plug RC 4000A	1SDA074297R1



Power supply modules

Type	Code
Ekip Supply 24-48V DC	1SDA074173R1

Ekip UP

Optional accessories



Cartridge connectivity modules

Type	Code
Ekip Com Modbus RS-485	1SDA074150R1
Ekip Com Modbus TCP	1SDA074151R1
Ekip Com Profibus	1SDA074152R1
Ekip Com Profinet	1SDA074153R1
Ekip Com DeviceNet™	1SDA074154R1
Ekip Com EtherNet/IP™	1SDA074155R1
Ekip Com IEC61850	1SDA074156R1
Ekip Com Hub	1SDA082894R1
Ekip Com R Modbus RS-485	1SDA074157R1
Ekip Com R Modbus TCP	1SDA074158R1
Ekip Com R Profibus	1SDA074159R1
Ekip Com R Profinet	1SDA074160R1
Ekip Com R DeviceNet™	1SDA074161R1
Ekip Com R EtherNet/IP™	1SDA074162R1
Ekip Com R IEC61850	1SDA076170R1
Ekip Link	1SDA074163R1
Ekip Com OpenADR	1SDA085814R1



Cartridge synchrocheck modules

Type	Code
Ekip Synchrocheck	1SDA074183R1



Cartridge signalling modules

Type	Code
Ekip Signalling 2K-1	1SDA074167R1
Ekip Signalling 2K-2	1SDA074168R1
Ekip Signalling 2K-3	1SDA074169R1
Ekip Signalling 3T-1 AI - Temp PT1000*	1SDA085693R1
Ekip Signalling 3T-2 AI - Temp PT1000*	1SDA085694R1

* External probe PT1000 with 3m cable is available as option with 1SDA085695R1 (coming soon!)

Ekip UP

Optional accessories



DIN-rail signalling modules

Type	Code
Ekip Signalling 10k*	1SDA074171R1
Ekip Signalling Modbus TCP*	1SDA082485R1

*Only as spare part



External toroids

Homopolar toroid for the grounding conductor of the transformer

Type	Code
Homopolar toroid 100A*	1SDA073743R1
Homopolar toroid 250A*	1SDA076248R1
Homopolar toroid 400A*	1SDA076249R1
Homopolar toroid 800A*	1SDA076250R1

*Only as spare part



Toroid for differential protection

Type	Code
Toroid RC small size*	1SDA073741R1
Toroid RC big size*	1SDA073742R1

*Only as spare part

SW function accessories

Type	Code
IPS - Interface Protection	1SDA082919R1
Ekip UP single code for IPS (CEI 0-16)*	1SDA107690R1
Load shedding - adaptive	1SDA082921R1

* it contains all the accessories needed for Interface Protection System like current insertion bridges, Ekip Synchrocheck, Ekip 2k-1 and the IPS sw function
Note: Load Shedding - basic is always supplied in Ekip UP Protect, Protect+ and Control+ versions.



Commissioning modules

Type	Code
Ekip T&P - Programming and Test unit	1SDA066989R1
Ekip TT - Trip Test unit	1SDA066988R1
Ekip Programming	1SDA076154R1



Loose Rating Plugs

Rating plug for Ekip UP units as spare parts

Type	Code
Rating Plug 100A	1SDA074218R1
Rating Plug 200A	1SDA074219R1
Rating Plug 250A	1SDA074220R1
Rating Plug 400A	1SDA074221R1
Rating Plug 600A	1SDA079826R1
Rating Plug 630A	1SDA074222R1
Rating Plug 800A	1SDA074223R1
Rating Plug 1000A	1SDA074224R1
Rating Plug 1200A	1SDA079730R1
Rating Plug 1250A	1SDA074225R1
Rating Plug 1600A	1SDA074226R1
Rating Plug 2000A	1SDA074227R1
Rating Plug 2500A	1SDA074228R1
Rating Plug 3200A	1SDA074229R1
Rating Plug 3600A	1SDA079827R1
Rating Plug 4000A	1SDA074230R1
Rating Plug 5000A	1SDA074231R1
Rating Plug 6000A	1SDA079731R1
Rating Plug 6300A	1SDA074232R1
Rating Plug RC 100A	1SDA074248R1
Rating Plug RC 200A	1SDA074249R1
Rating Plug RC 250A	1SDA074250R1
Rating Plug RC 400A	1SDA074251R1
Rating Plug RC 630A	1SDA074252R1
Rating Plug RC 800A	1SDA074253R1
Rating Plug RC 1250A	1SDA074254R1
Rating Plug RC 2000A	1SDA074255R1
Rating Plug RC 3200A	1SDA074256R1
Rating Plug RC 4000A	1SDA074257R1

Spare Parts

Type	Code
DIN/DOOR installation kit	1SDA085567R1
Cable kit	1SDA085568R1
Cover	1SDA085569R1
Positioning device type C	1SDA085570R1

Extended warranty


Type	Code
Warranty 2 years	1SDA104660R1
Warranty 4 years	1SDA085815R1
Warranty 5 years	1SDA104661R1



Note:
Warranty periods
are measured from
the date the Ekip UP
leaves the factory.

Ekip UP Part Numbering System

For United States of America and Canada only



1/2 - Ekip UP Prefix

Ekip UP Prefix	UP
----------------	----

3/4 - Unit type

MONITOR	MX
PROTECT	PX
CONTROL	CX
PROTECT PLUS	PP
CONTROL PLUS	CP

5/6/7/8 - Ratings


100A	0100
200A	0200
250A	0250
400A	0400
600A	0600
630A	0630
800A	0800
1000A	1000
1200A	1200
1250A	1250
1600A	1600
2000A	2000
2500A	2500
3200A	3200
3600A	3600
4000A	4000
5000A	5000
6000A	6000

9/10 - Current sensors

CS 100-2000A 3P + Copper type A	A1
CS 100-2000A 4P + Copper type A	A2
CS 2000-4000A 3P + Copper type A	A3
CS 2000-4000A 4P + Copper type A	A4
CS 100-400A 3P type B	B1
CS 100-400A 4P type B	B2
CS 400-1600A 3P type B	B3
CS 400-1600A 4P type B	B4
CS 400-2500A 3P type B shaped	B5
CS 400-2500A 4P type B shaped	B6
Open CS 3P type C 120 4000A MAX	C3
Open CS 4P type C 120 4000A MAX	C4
Open CS 3P type C 200 4000A MAX	C5
Open CS 4P type C 200 4000A MAX	C6
Open CS 3P type C 290 6000A MAX	C7
Open CS 4P type C 290 6000A MAX	C8
Open CS 3P type C 100 1600A MAX	C9
Open CS 4P type C 100 1600A MAX	C0

11 - Power Supply

E1.2..E6.2 Ekip Supply 24-48VDC	D
---------------------------------	---



12 - Communication module

0	None
2	Ekip Com Modbus RS-485
3	Ekip Com Modbus TCP
4	Ekip Com Profibus
5	Ekip Com Profinet
6	Ekip Com DeviceNet™
7	Ekip Com EtherNet/IP™
8	Ekip Com IEC61850
A	Ekip Com Modbus RS-485 + Ekip Com Modbus TCP
B	Ekip Com Modbus TCP + Ekip Com Profibus
C	Ekip Com Profibus + Ekip Com Profinet
D	Ekip Com Profinet + Ekip Com DeviceNet™
E	Ekip Com DeviceNet™ + Ekip Com EtherNet/IP™
F	Ekip Com EtherNet/IP™ + Ekip Com IEC61850
G	Ekip Com Modbus RS-485 + Ekip Com Profibus
H	Ekip Com Modbus TCP + Ekip Com Profinet
J	Ekip Com Profibus + Ekip Com DeviceNet™
K	Ekip Com Profinet + Ekip Com EtherNet/IP™
L	Ekip Com DeviceNet™ + Ekip Com IEC61850
M	Ekip Com Modbus RS-485 + Ekip Com Profinet
N	Ekip Com Modbus TCP + Ekip Com DeviceNet™
P	Ekip Com Profibus + Ekip Com EtherNet/IP™
Q	Ekip Com Profinet + Ekip Com IEC61850
R	Ekip Com Modbus RS-485 + Ekip Com DeviceNet™
S	Ekip Com Modbus TCP + Ekip Com IEC61850
T	Ekip Com Profibus + Ekip Com IEC61850
U	Ekip Com Modbus RS-485 + Ekip Com EtherNet/IP™
V	Ekip Com Modbus TCP + Ekip Com IEC61850
W	Ekip Com Modbus RS-485 + Ekip Com IEC61850

15 - Warranty

0	None
2	Warranty extension 2 years
4	Warranty extension 4 years
5	Warranty extension 5 years

13 - Redundant Communications & Other Modules

0	None
2	Ekip Com Modbus RS-485
3	Ekip Com Modbus TCP
4	Ekip Com Profibus
5	Ekip Com Profinet
6	Ekip Com DeviceNet™
7	Ekip Com EtherNet/IP™
8	Ekip Com IEC61850
A	Ekip Link
B	Ekip 2k-2 ⁽¹⁾
C	Ekip Synchrocheck ⁽¹⁾
D	Ekip Com Hub

14 - 2nd Redundant Communications & Other Modules

0	None
2	Ekip Com Modbus RS-485
3	Ekip Com Modbus TCP
4	Ekip Com Profibus
5	Ekip Com Profinet
6	Ekip Com DeviceNet™
7	Ekip Com EtherNet/IP™
8	Ekip Com IEC61850
B	Ekip Synchrocheck ⁽¹⁾
C	Ekip 2k-2 ⁽¹⁾
D	Ekip Com Hub
C	Ekip 2k-2 + Ekip 2k-3 ⁽¹⁾

⁽¹⁾ Ekip 2k and Ekip Synchrocheck are listed according to UL1066. All the other Ekip Signalling and Ekip Com accessories are listed according to UL 508 - CSA C22.2 No. 14-13 and UL 1066.

Accessories

Insertion bridges CS type D Ekip UP	UPINSERTCSD
Support CS Rogowski type C D12mm open	UPCENDTYC
Installation kit DIN/DOOR Ekip UP	UPDDKIT
Cable kit Ext 4p Ekip UP	UPCABKIT
Transparent Cover Ekip UP	UPCOV

—
ABB S.p.A.
5, Via Pescaria
I-24123, Bergamo
Phone: +39 035 395.111

abb.com/low-voltage

