



QF(13) - Series Miniature Circuit Breakers



1 Pole
DIN mount

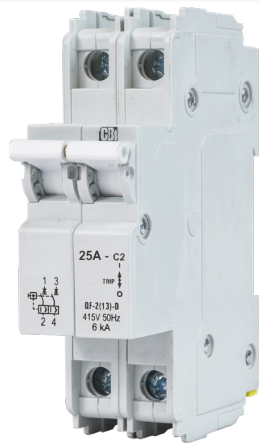

2 Pole
DIN mount

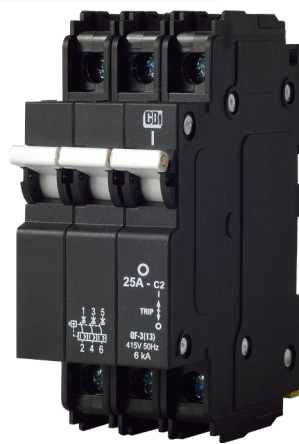

3 Pole
Dual (DIN & mini rail) mount



4 (3 Pole + Neutral)
Dual (DIN & mini rail) mount

Features

- AC circuit breaker
- Hydraulic-magnetic technology
- 100% rating capability, independent of ambient temperature
- One, two, three, four pole, 1+N and 3+N
- VC 8036 compliant (SANS 556-1)
- VDE, EAC and CCC approved, CE certified
- AS/NZS 3111 approved
- Ratings 0.1 A to 25 A
- Optional shunt trip (Approvals pending)
- Wide range of time delays & operating currents
- Precision tripping characteristics
- Ultra compact – 13 mm wide module
- Trip indication with mid-trip position
- Can be switched on immediately after tripping
- DIN mount, 45 mm front escutcheon (Grey)
- Dual (DIN & mini rail) mount, 57 mm front escutcheon (Black)
- Suitable to use for electrical isolation
- Shell designed for easier installation onto busbar

Applications

- AC branch circuit protection (DIN / EN 60947-2)
- Switch disconnecter (DIN / EN 60947-3)
- Telecom / datacom equipment
- Lighting control
- UPS equipment
- Alternative energy equipment
- Mobile power generation equipment
- Railway signalling equipment
- Residential equipment
- Industrial equipment

Auxiliary Switch, Trip Alarm & Combo: Features

- Factory fitted
- Attached to right hand side of the circuit breaker
- Compact 6.5 mm width
- Auxiliary switch + trip alarm (Dual mount only)
- Trip alarm (Dual mount only)
- UL 489 listed & IEC 60947-5-1
110 Vdc, 0.5 A; 240 Vac, 6 A

Optional Accessories

- Handle lock - QFAP001
- Surface mounting clips - SAAX000
- Busbar - SABBM54
- 57 mm escutcheon blank (Dual mount only) - 235608
- 57 mm safety blank (Dual mount only) - SAEB000

VC 8036



AS/NZS 3111



Hydraulic-Magnetic Circuit Breakers 100% rated, unaffected by ambient temperature

QF13-SERIES-DAT
REV. D
APRIL 2022

2202005

Data Sheet
Page 1 of 8

QF(13) - Series Miniature Circuit Breakers

Technical Data

Product Type	Circuit Breaker				
Approvals	VC 8036 (SANS 556-1)				
Number of Poles	1	2 (1+N)	2	3	4 (3+N)
Operating Voltages	240 Vac		415 Vac		
Minimum Current Rating	1 A				
Maximum Current Rating	25 A				
Ultimate S/C Breaking Capacity (Icu)	5 kA				

Product Type	Circuit Breaker				
Approvals	DIN / EN 60947-2, VDE, CE, UKCA, EAC				
Number of Poles	1	2 (1+N)	2	3	4 (3+N)
Operating Voltages	240 Vac		415 Vac		
Minimum Current Rating	1 A				
Maximum Current Rating	25 A				
Ultimate S/C Breaking Capacity (Icu)	6 kA				

Product Type	Circuit Breaker				
Approvals	GB14048.2				
Number of Poles	1	2 (1+N)	2	3	4 (3+N)
Operating Voltages	240 Vac		415 Vac		
Minimum Current Rating	1 A				
Maximum Current Rating	25 A				
Ultimate S/C Breaking Capacity (Icu)	6 kA				

Product Type	Circuit Breaker				
Approvals	AS/NZS 3111				
Number of Poles	1	2	3	3 + N	
Operating Voltages	240 Vac		415 Vac		
Minimum Current Rating	1 A				
Maximum Current Rating	25 A				
Ultimate S/C Breaking Capacity (Icu)	6 kA				

Product Type	Switch Disconnector				
Approvals	SANS 60947-3, DIN / EN 60947-3				
Number of Poles	1	2	3	4 (3S + N)	
Operating Voltages	240 Vac		415 Vac		
Current Rating	63 A				
Rated S/C Withstand Capacity (Icw)	6 kA, 50 ms				

QF(13) - Series Miniature Circuit Breakers

Technical Data

Auxiliary Module	
Auxiliary Switch	Dual mounting & DIN mounting
Trip Alarm	Dual mounting
Auxiliary Switch / Trip Alarm Combo	Dual mounting

Product Type	QF(13)
Ambient Operating Temperature	-40 °C to +85 °C
Mounting Options	DIN rail mount, Dual (DIN & mini rail) mount & Surface mount
Time Delay Curves	1, 2
Endurance	10000 operations; 1500 with current, 8500 without current (IEC 60947-2 Clause 7.2.4.2)*
Dielectric Strength	1000 - 2000 Vac for one minute (IEC 60947-2 Clause 8.3.3.3)*
Rated Impulse Withstand Voltage	4 kV (IEC 60947-2 Clause 8.3.3.2)
Weight	102 g per pole, 160 g with auxiliary (depending on rating) (unpacked)
Altitude	Certification tests done at altitude ≈ 2000 metres. Will operate at higher altitudes.
Shock	16 G (IEC 60068-2-27)
Vibration	2 G (IEC 60068-2-6) (sinusoidal wave)
Flammability	I3 - Ignition does not persist at 850 °C after glow wire is withdrawn with an oxygen index of ≥ 28
Toxicity	F1 - Smoke index of ≤ 20 which determines the fume class
Pollution Degree	PD2 - Normally only non-conductive pollution occurs. Temporary conductivity caused by condensation is to be expected.

Circuit Breaker	Wire Size (IEC)	Wire Gauge (UL)	Torque (IEC)	Torque (UL)	Comments
Main Terminals	0.75 mm ² - 25 mm ²	18 – 3 AWG	2.5 Nm	20 in-lb	Pozidriv #2 Combi head

QF(13) - Series Miniature Circuit Breakers

Long Code

Example Code: QF--AT-3(13)-DM-2-15A-----

Group	1	2	3	4	5	6	7	8	9	10	11	12	13
Requirement	QF frame	Switch / neutral	Auxiliary switch + trip alarm	Triple pole	13 mm module width	Dual mount	Medium delay curve 2	Current rating 15 A	Future use	Shunt trip	Special requirement	Special termination	Customer specific
Long Code	QF	-	AT	3	(13)	DM	2	15A	-	-	-	-	-


Ordering Information

Group 1: Frame Type	Code	Description	Comments
Group 1: Frame Type	QF	Miniature circuit breaker	
Group 2: Switch/Neutral	Code	Description	Comments
Group 2: Switch/Neutral	-	Not applicable	Overload poles do not have any further coding
Group 2: Switch/Neutral	S	Switch	Green handle
Group 2: Switch/Neutral	N	Neutral	Green handle
Group 3: Auxiliary	Code	Description	Comments
Group 3: Auxiliary	-	Not applicable	Use this code if no auxiliary used
Group 3: Auxiliary	A	Auxiliary switch (1 x Aux in 1 module)	6.5 mm module fitted on right-hand side
Group 3: Auxiliary	T	Trip alarm (1 x Trip alarm in 1 module)	6.5 mm module fitted on right-hand side (Dual mount only)
Group 3: Auxiliary	AT	Auxiliary switch + trip alarm combo (Combined in 1 module)	6.5 mm module fitted on right-hand side (Dual mount only)
Group 4: No of Poles	Code	Description	Comments
Group 4: No of Poles	1	Single pole	
Group 4: No of Poles	2	Double pole	2 pole or 1+N
Group 4: No of Poles	3	Triple pole	
Group 4: No of Poles	4	Four pole	4 pole or 3+N
Group 5: Module Width	Code	Description	Comments
Group 5: Module Width	(13)	13 mm module width	13 mm per pole
Group 6: Mounting	Code	Description	Comments
Group 6: Mounting	D	DIN mount	DIN mount supplied in grey body only - 45 mm front escutcheon
Group 6: Mounting	DM	Dual (DIN & mini rail) mount	Dual mount supplied in black body only - 57 mm front escutcheon
Group 7: Time Delays	Code	Description	Instantaneous Trip Point (x In) Comments
Group 7: Time Delays	1	Long time delay, high instantaneous trip	10 – 20 Orange handle
Group 7: Time Delays	2	Medium time delay	5 – 10 White handle
Group 8: Current Ratings	Code / Description		Comments
Group 8: Current Ratings	1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 12, 15, 16, 20, 25 A		Ratings available vary depending on certification * Other ratings are available as special orders. Check availability.
Group 9	Code	Description	Comments
Group 9	-	Not applicable	For future use
Group 10: Shunt Trip (approvals pending)	Code	Description	Comments
Group 10: Shunt Trip (approvals pending)	-	Shunt trip not fitted	
Group 10: Shunt Trip (approvals pending)	U0	12 Vdc Shunt trip (flying leads)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U1	24 Vdc Shunt trip (fly leads)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U2	48 Vdc Shunt trip (fly leads)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U3	110 Vdc or 110 Vac Shunt trip (fly leads)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U4	220 - 240 Vac Shunt trip (fly leads)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U5	12 Vdc Shunt trip (Box terminal)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U6	24 Vdc Shunt trip (Box terminal)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U7	48 Vdc Shunt trip (Box terminal)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U8	110 Vdc or 110 Vac Shunt trip (Box terminal)	Combination of Neutral + shunt trip
Group 10: Shunt Trip (approvals pending)	U9	220 - 240 Vac Shunt trip (Box terminal)	Combination of Neutral + shunt trip
Group 11: Special Requirement	Code	Description	Comments
Group 11: Special Requirement	-	Not applicable	For future use
Group 12: Special Termination	Code	Description	Comments
Group 12: Special Termination	-	Not applicable	For future use
Group 13: Customer Specific	Code	Description	Comments
Group 13: Customer Specific	-	Not applicable	For future use

For options not listed, please contact CBI

QF(13) - Series Miniature Circuit Breakers


Time Delay Curves

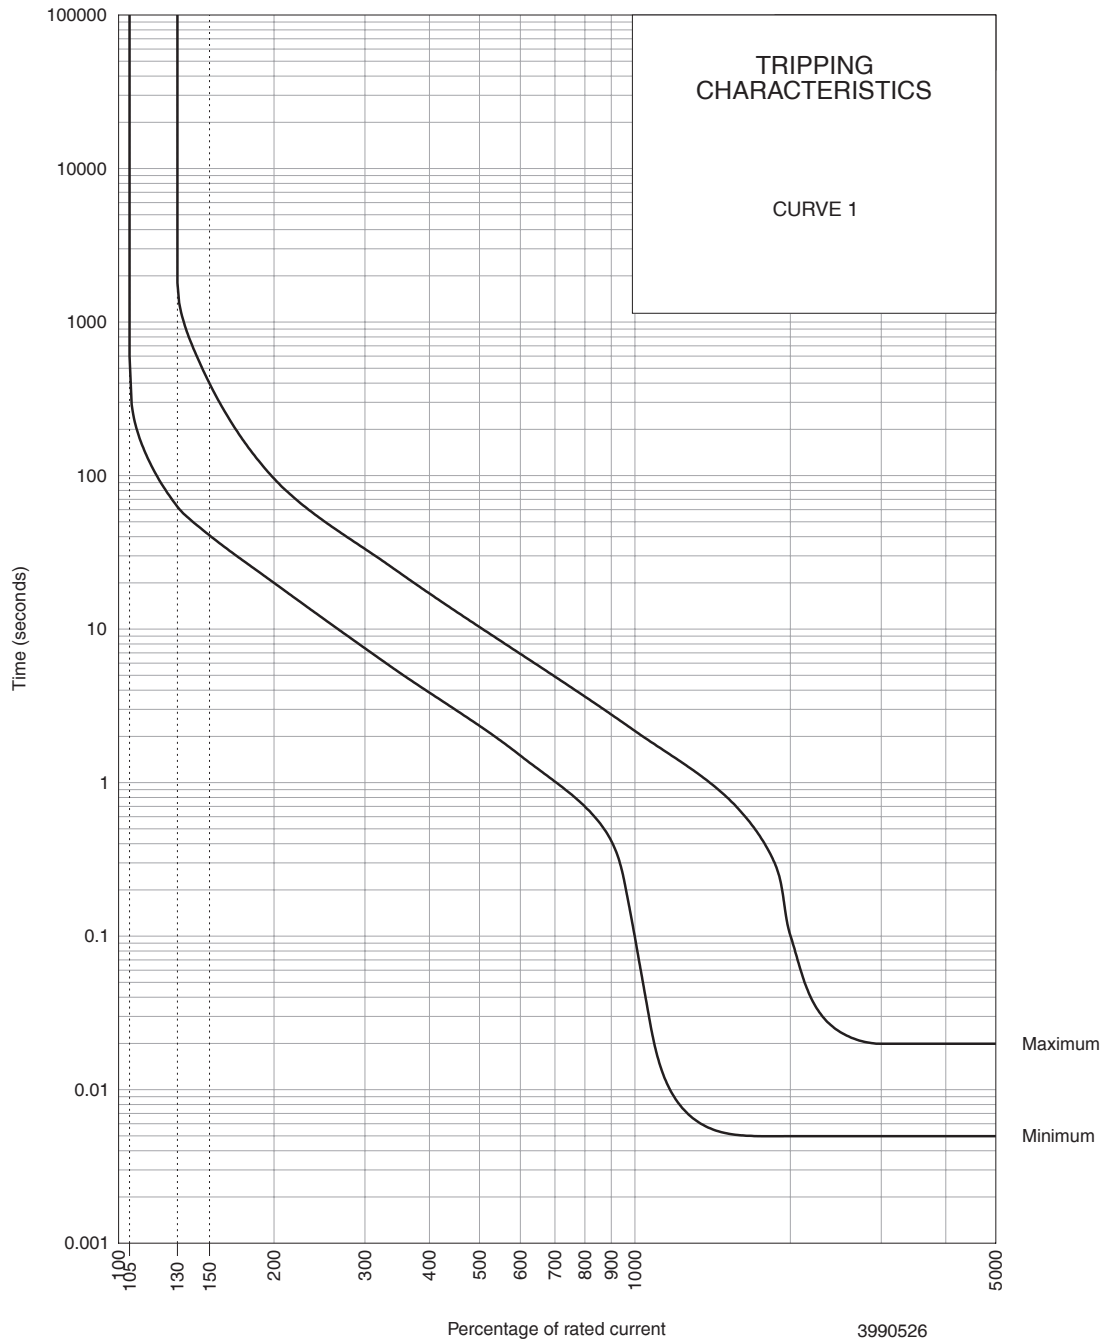

PERCENTAGE OF RATED CURRENT	105%	130%	145%	150%	200%	300%	400%	500%	600%	700%	800%	900%	1000%	2000%
MINIMUM TRIP TIME IN SECONDS	NO TRIP	63	45	41	20	7.5	3.8	2.3	1.5	1.01	0.7	0.42	0.1	0.005
MAXIMUM TRIP TIME IN SECONDS	NO TRIP	1800	503	400	96	34	17	10.3	6.8	4.9	3.6	2.8	2.2	0.1

QF(13) - Series Miniature Circuit Breakers

Time Delay Curves

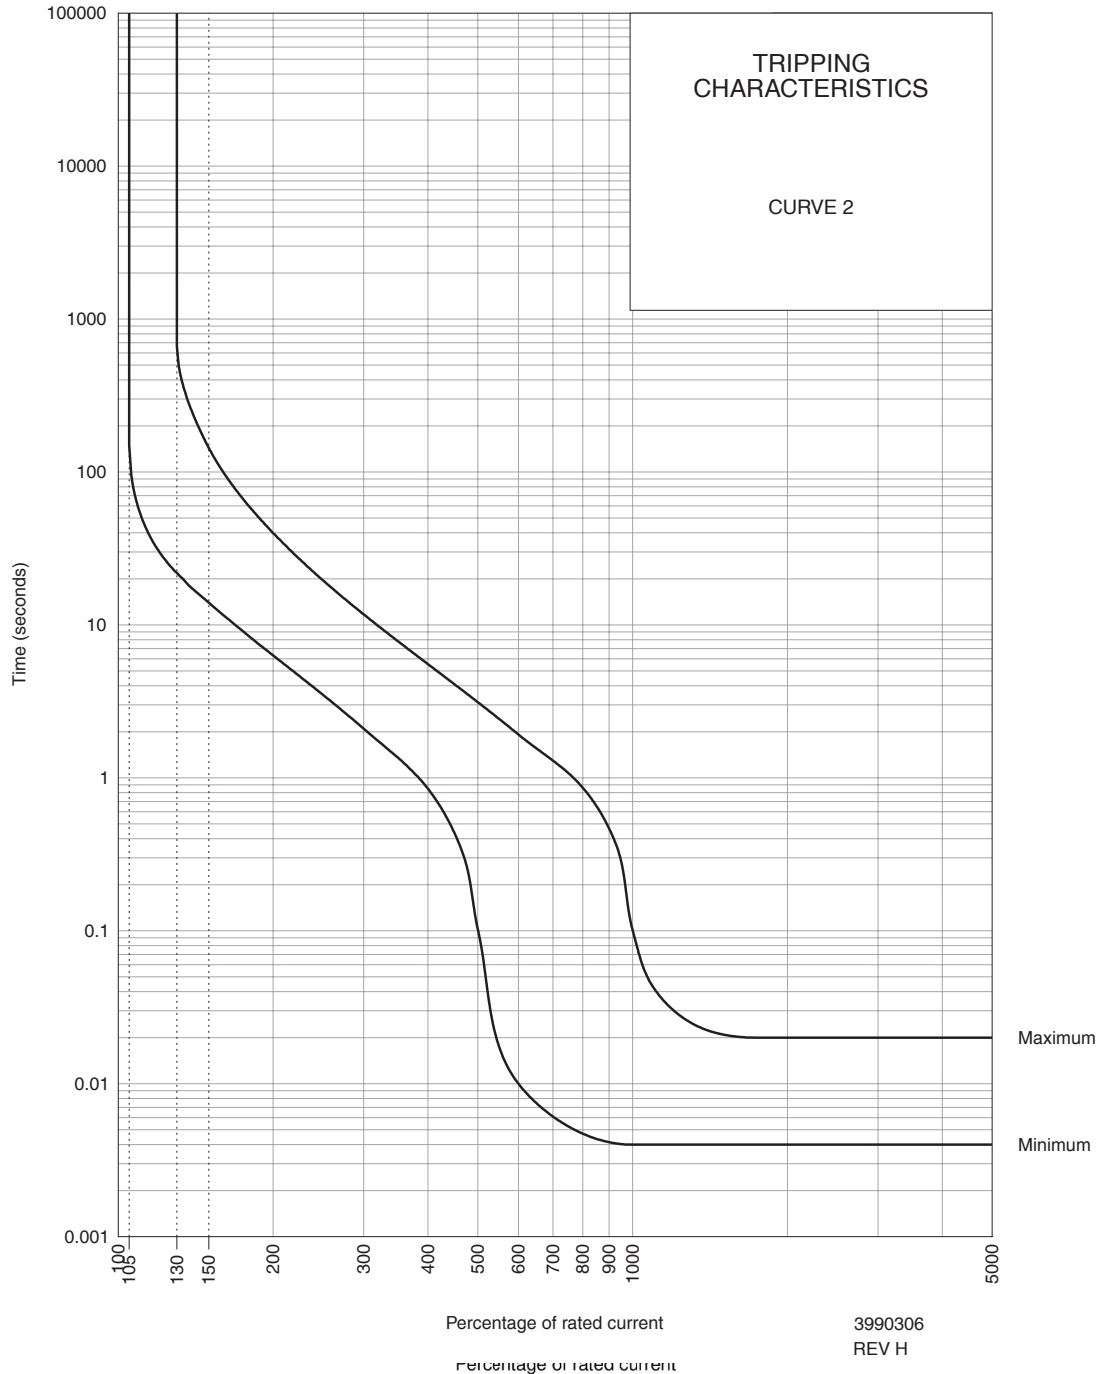


PERCENTAGE OF RATED CURRENT	105%	130%	145%	150%	200%	300%	400%	500%	600%	700%	800%	900%	1000%	2000%
MINIMUM TRIP TIME IN SECONDS	NO TRIP	22	15.4	14	6.3	2.1	0.85	0.1	0.001	0.006	0.005	0.041	0.004	0.004
MAXIMUM TRIP TIME IN SECONDS	NO TRIP	660	180	144	40	12	5.5	3	1.92	1.3	0.86	0.47	0.1	0.02

* The published time delay curves are generated at 30°C ambient temperature with the circuit breaker mounted in the up-right position. The “must hold”, “must trip” and “instantaneous trip” current values are not affected by temperature, although delay time for the other operating current values may have to be adjusted using the temperature compensation curve which is available on request.

QF(13) - Series Miniature Circuit Breakers


Internal Impedance vs Current Rating

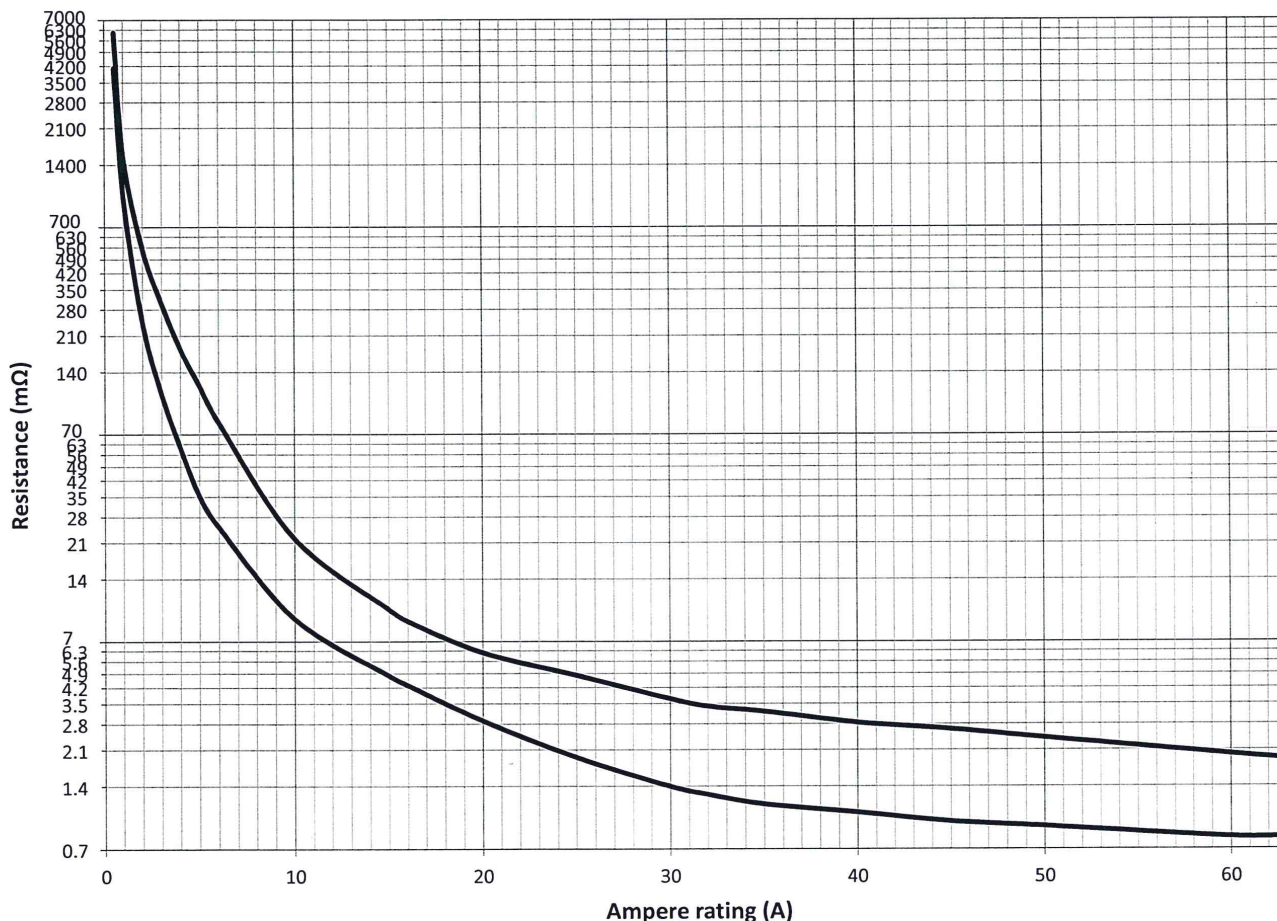


Ampere rating	0.5	1	2	5	6	10	15	20	25	30	32	40	50	60	63
Minimum (mΩ)	4085	970	244	35	25	9.0	4.8	2.9	1.9	1.4	1.3	1.1	0.9	0.8	0.8
Maximum (mΩ)	6065	1527	550	120	80	22	10	6.2	4.8	3.7	3.4	2.8	2.4	2.0	1.9

QF(13) - Series Miniature Circuit Breakers

Outline Dimensions: Dual (DIN & mini rail) mount

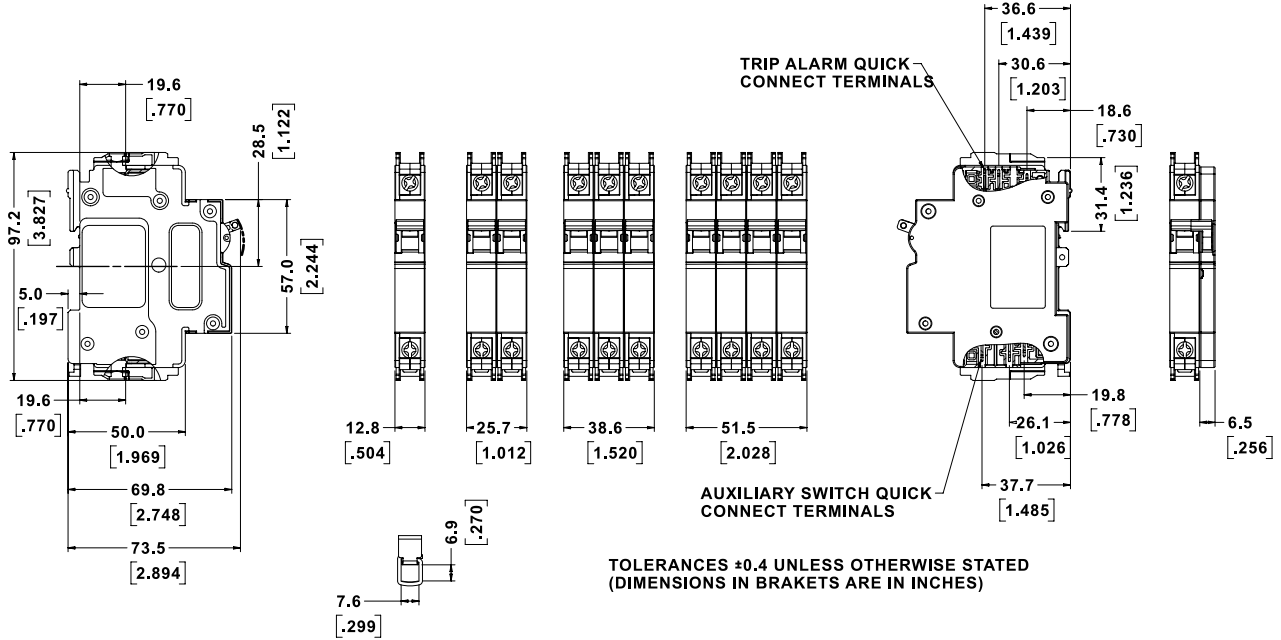

Outline Dimensions: DIN Mount

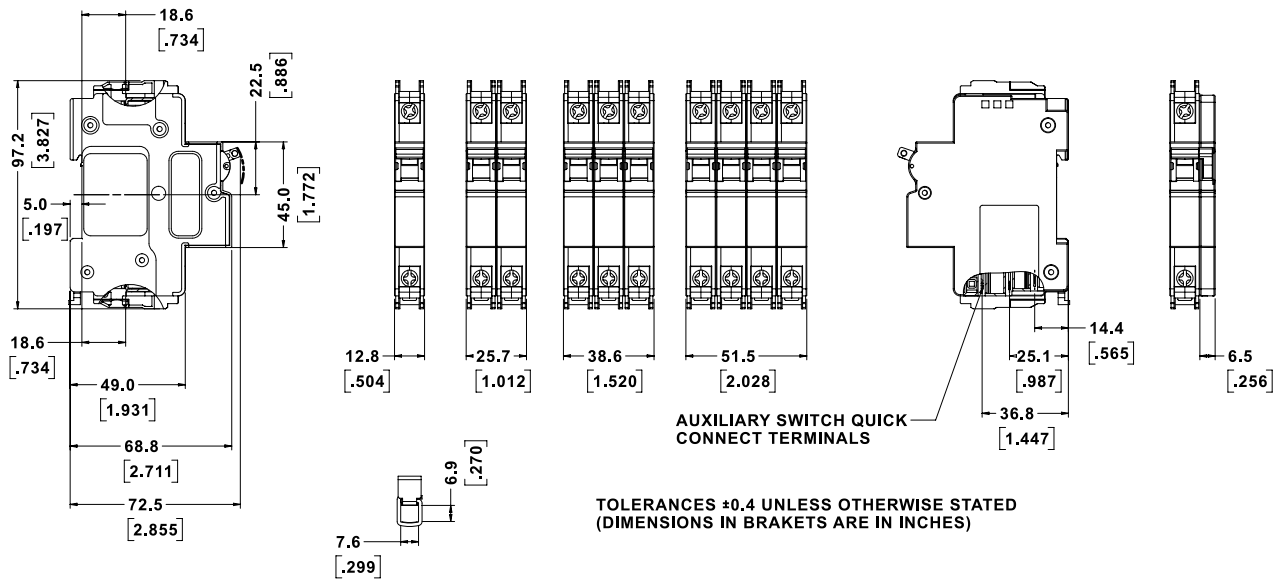

Please review our Customer Terms and Conditions on www.cbi-lowvoltage.co.za

All rights reserved. Unless otherwise indicated, all materials on these pages are copyrighted by CBI (Pty) Ltd. No part of these pages, either text or image may be used for any purpose other than personal use. Therefore, reproduction, modification, storage in a retrieval system or retransmission, in any form or by any means, electronic, mechanical or otherwise, for reasons other than personal use, is strictly prohibited without prior written permission. CBI (Pty) Ltd reserves the right to alter any details of this document without notice and while every effort is made to ensure the accuracy of the content, no warranty is given as to accuracy of this document and no responsibility will be accepted for error or misinterpretation and any resulting loss.

AUSTRALIA

CBI-electric: Australia
27 Wedgewood Rd, Hallam
Victoria 3803 Australia
Tel: +61 3 8752 9300
Fax: +61 3 9796 5407
Email: sales@cbi-electric.com.au
Website: www.cbi-electric.com.au

SOUTH AFRICA

CBI-electric: low voltage
Tripswitch Drive Elandsfontein
Gauteng South Africa
Tel: +27 11 928 2000
Fax: +27 11 392 2354
Email: cbi@cbi-electric.com
internationalsales@cbi-electric.com
Website: www.cbi-lowvoltage.co.za

USA

CBI-electric: North America
35 E. Uwchlan Ave Suite 328
Exton PA 19341 USA
Tel: +1 610 524 9949
Fax: +1 610 524 9945
E-mail: info@cbibreakers.com
Website: www.cbibreakers.com